

Navi Mumbai Campus
Electrician Maintainace Work

26/10/20	P.G. hostel	4 fan Replaced	fan	01	(Fred)	214
31/10/20	Security gate	2 fans Installation 2 Tube Light Repairing	fan	02	supervisor (Driver Room) B.K. Shukla	
31/10/20	Staff G	Tube Light Repairing Rod And etc cherry	Rod	01 01	N. K. Sharma	305
04/11/20	PG hostel	fixe point paper switch chru			Shaw	302
02/11/20	Girls hostel	Tube light properly fitting And Endoctin Cooking Repair			Lab Stone 02/11/20	G. Jay Girls Wash Room

04/11/20	Staffa	Tube Light Repair Statue And of Roof Chng	St- Roof	01 01	<u>Amile</u>	408
05/11/20	Physiology	2. Fans Replaced. 1. Fan Remove for Repairing 4. Fans Capacitor Change.	Capacitor	04		Physiology Dept. Staff Room
05/11/20	PG Hostel	Penta. 6 A. Shoket Change 64 modules Shoket chng switch Board Repairing	Shoket (per Shoket - M	01 01	<u>As</u>	216
05/11/20	PG Hostel	fan changed to fan Regulator fitting Capacitor Change	Fan Regulator Capacitor	01 01 01	<u>As</u>	615
05/11/20	PG Host	Fan Regulator ver 4r	Regulator	01	<u>Anand</u>	362

26/10/20	P.G. Hostel	4 fan replaced	fan	01	Jed	214
31/10/20	Security gate	2 fans Installation 2 Tube Light Repairing	fan	02	Supervisor (Driver Room) B. Kishore	
31/10/20	Staff c	Tube light Repairing Rod And star change	Rod	01 01	Staff	305
04/11/20	PG hostel	fixe point power switch chng			Power	302
02/11/20	Girls Hostel	Tube light properly fixing And Endoctin Corking Rup			Lab Stone 02/11/20	G. Jay Girls Wash Room

04/11/20

Staffa

Tube Light Repair
Socket And
Rod Change

St-
Rod

01
01

Amila

408

05/11/20

Physiology

2. Fans Replaced.
1. Fan Remote fan
Repairing
4. Fan Capacitor
Change.

Capacitor

04

Physiology
Dept.
Staff
Room

05/11/20

PG Hostel

Penta. GA. Socket
Change GA module
Socket change switch
Board Repairing

Socket (Per)
Socket - M

01
01

Amila

216

05/11/20

PG Hostel

fan changed
fan Regulator fitting
Capacitor Change

Fan

01

Regulator

01

Capacitor

01

Amila

605

05/11/20

PG Hostel

Fan Regulator repair
fan

Regulator

01

Amila

362

Date	Department	Type of work	Material	Qty	Signature	Page
05/11/20	PG Hostel	Tube Light Chan LED Light fit GA socket change	LED Socket	01 01	Ju	12
06/11/20	Canteen	16 A. SS. combain Box Repld.	Combain Box	01	Signature	Khen
06/11/20	C.R.L.	4. 20w. PL. LED. light Change 1. 36.w. PL. Light Change	LED	04		C.R.L.
06/11/20	Girls Host	Repaired fan fitting	fan	01	Signature	314
07/11/20	Staff.c	Celling fan fitting LED light fitting Tube light Repl	fan LED fan Champ.	01 01 01	Signature	206
07/11/20	Univesity	one Celling fan Repld. 1 fan Remove for Repairing				Chin Accha
07/11/20	PG Host	LED Light fitting	LED	01	Signature	210

Date Department Type of working use material Qty Sic Room no.

09/11/20 C.R.L. Switch Board Repairing
MCB Connection Change
Power supply on

09/11/20 Biochemistry Ceiling fan Replaced.
old Reman fan
- Repairing And Replaced
- fan fitting

9/11/20 Canteen mess 2. switch board pow-
- supply on MCB
- Trencher on

09/11/20 Staff canteen 1. Givers 3 pin Top New
fitting
2. water heater Repair
3. combain Box change
6A. Shower 1. Change

09/11/20 PG Hostel Switch Board Repair
galea switch change

09/11/20 PG Hostel Repaired fan fitting
old fan Reman

use material Qty Sic Room no.

fan 01 Biochem
Hood Rm


3 pin top 01
3. 16A combain Box 01
6A. Shower 01

Switch 01 Mess

fan 01 301

fan 01 413

fan 01 403

Date	Department	Type of work	Use material	Qty.	Sign	Room No.
10/11/20	Staff. Quarters	A/c fan fitting 3 pin top fitting SS. Combain Box fitting	3. pin top SS. Combain	01 01	 Dr. K. S. ... 10/11/20	206
10/11/20	Boys Hostel :	front side old tube light remove and new LED light fitting diff. front side. LED light change	LED. Light set	02		Passage
10/11/20	Medical. College	Conference Hall Passage. 1. LED. light change	LED.	01		
10/11/20	C.R.L.	Electrical supply timer. removal. and direct power supply on				
10/11/20	Main gate Drives Room	power supply MCB timer on				

11/11/20

Animal House

CLTV. DVR Metal
Rack. Fitting
power point fitting

11/11/20

Anatomy

Demonstration Room
All. Electrical wiring
properly fitting
cassing path fitting
4. ss. Combin
Box - fitting

Combin Box
PVC pipe
sattel path.
L. Bo. Bend

Anatomy
Demo
Hall

12/11/20

Boys Hostel

Main Electrical
Panel. Room
1. LED light change
3rd floor water
coller Room 1. LED
light change And
16. A. combin Box
Change

Combin
LED

01
02

3rd

12/11/20

PG Hostel -

Extra power point
fitting. Hot Box
in Back Room
And fix to 300
Rack

300

Date	Department	Type of working	use material.	Qty.	Site	Room
16/11/20	Staff club	4th And. 5th floor passage Light change	LED Light	02		4th And 5th floor
17/11/20	University	1. ceiling fan Repted. old Remu And repaired fan fitting (Store Section)	Fan	01		Store
18/11/20	Library	16. A. 88. combain Box change And property completion	Combin. Box	01		Library
18/11/20	PG Hostel	giver switch Change	Switch	01	Pubok	212
18/11/20	Girls Hostel	1. ceiling fan fitting	Fan	02	Pubok	Grd.
19/11/20	Anatomy	5 fans Repairing Capacitor change	Capacitor	05		Demonstrat Room

19/11/20

Staff canteen

Ceiling fan change
And fan Regulator
Change.

Regulator
fan

02

01

[Signature]

09/07

19/11/20

Boys Hostel

1. Fan Removal for
Repairing

Fan
Regulator

02

02

[Signature]

013/11/20

19/11/20

Boys Hostel

2. Ceiling fans change
1. old Removal and
repaired fan fitting
2. fans Regulator
New fitting
1. LED light fitting
3. CA. socket Repair

Fan
Regulator

02

02

[Signature]

07

19/11/20

Boys-Hostel

Ceiling fan old Removal
And repaired
fitting

Fan

01

[Signature]

012/11/20

20/11/20

Boys Hostel

2. Lights Repair

LED

02

[Signature]

05/11/20

20/11/20	Boys Hostel	Celling fan Preparation for Repairing - and switch Board connection			Final	413
----------	-------------	--	--	--	-------	-----

21/11/20	PG Hostel	Fan fitting	Fan	01	Final	302
----------	-----------	-------------	-----	----	-------	-----

23/11/20	Staff	Fan Repairing capacitor chng	Capacitor	01	31N Premises	508
----------	-------	---------------------------------	-----------	----	-----------------	-----

23/11/20	Library	3 Fans Change 1 capacitor Change	Capacitor	01		110 MCH Room
----------	---------	--	-----------	----	--	--------------------

23/11/20	Staff	Tube Light Repair stator change And 1 LED Light fitting	LED Stator	01 01	Other	501
----------	-------	--	---------------	----------	-------	-----

28/11/20	Boys Hostel	Fan Repairing Capacitor Chng	Capacitor	01	Final	205
----------	-------------	------------------------------------	-----------	----	-------	-----

24/11/20	PG Hostel	Tube light chng	LED	01	Dr. K...	315
24/11/20	Staff Quarters	2 bulbe + Holder	LED	2	with STA	501
24/11/20	Boys Hostel	3rd floor. 4. Tube LED light properly fitting in light chng	2 LED	02		300 from peng
26/11/20	CRL	6 pl. Light set repairing LED And PL Night on				
26/11/20	Staff c	CFL Bulb Holder Change	holder	01	Dr. K...	501
26/11/20	Staff Quarters	gives point 16 A. shaker change			Arshid	305
26/11/20	Medical cally	Tube light repairing 36 w Rod chng	Rod	01		Stroke

26/11/20 Boys Hostel.

Fan old Remenc
And Repair
fit

Fan

Dr. J. K. ...

307

26/11/20 Boys Hostel

Fan Repairing
And switch
Panel Repair

capacitor 01

Scint.

410

26/11/20 Boys Hostel

Repair fan fitting
old fan prem

Fan 01

Thermax.

405

26/11/20 Boys Hostel

Repair fan
fitting

Fan 01

Faird

413

26/11/20 PG Hostel.

LED light fitting
TBS light fix

LED 01

HR

711

26/11/20 PG Hostel

gypsum switch
chest

Switch 20A 01

R

314

29/11/20 PG hospital

Fan fitting
And LED light
fitting

Fan 01
LED 01

Dr. J. K.

420

30/11/20

PG Hostel

Tube light LED
fitting fan
repairing capacitor
change
2. bulb down

Capacitor
LED

01
01

Salon

307

30/11/20

PG Hostel

Switch Board
Repairing
CFL Bulb Change

Capacitor

✓

507

30/11/20

Boys Hostel

Celling fan
fitting

fan

01

✓

108

30/11/20

Boys Hostel

fan repairing
capacitor change

Capacitor

01

✓

501

30/11/20

Boys Hostel

fan Repairing
Capacitor change

capacitor

01

✓

513

01/12/20	Animal House	LED Light fitting	LED	01	Sabin	Arika
01/12/20	Girls hostel	2 fans change And pantry Tube light repair	Fan	02	01-12-20	014
02/12/20	PG hostel	Switch Board Repairing Switch change	Sw	01	01-12-20	501
02/12/20	Omics	6 model switch Board removal And fitting				Omics 4th floor
02/12/20	Girls Hostel	pantry room light change	LED	01	led single S/G	pantry
08/12/20	PG hostel	switch change			01-12-20	7p03

05/12/20	Boys Hostel	Tube light fitting And capacitor change	LED Capacitor	01 01	Vachan Singh	302
07/12/20	PG Hostel	Fan Repair Capacitor Ch	Capacitor	01	Pragati	516
08/12/20	PG Hostel	Fan Receptor change	Receptor	01	Pragati	309
11/12/20	Library	g. ceiling fan Repair for Repairing And 1. Tube Light Repairing LED fitting	LED	01		Reading Room
11/12/20	Boys Hostel.	Repaired fan fitting	Fan	01		
11/12/20	Girls Hostel	Repaired fan fitting	Fan	01		204
11/12/20	Girls Hostel	Repaired fan fitting	Fan	01		309

11/12/20	PG Hostel	leopard fan fitting	fan 6	01	<i>[Signature]</i>	309
14/12/20	Girls Hostel	Switch point Repair			<i>[Signature]</i>	302
14/12/20	Staff Q	Ac-point spin top fitting Tube Light Change LED fan	LED	01	<i>[Signature]</i>	304
17/12/20	PG Hostel	giver point R			<i>[Signature]</i>	516
17/12/20	Girl's Hostel	Fan not working in Room NO-14			<i>[Signature]</i>	(14)

17/12/20	Boys Hostel	Fan Repair Franchise fitting	fan	01	02
17/12/20	Boys Hostel	Regulator fitting	Regulator	01	06
17/12/20	Boys Hostel	Fan Repair capacitor ch	capacitor	01	302
17/12/20	Central Mess	tube light change	tube light	01	0.00
18/12/20	Staff c	LED light fitting	LED	01	406
18/12/20	Sta	CFL Bulb fit	bulb	01	501
19/12/20	Sta	LED light fit	LED	01	107
19/12/20	Sta	glass switches	switch	01	312

21/12/20 Anatomy

Weave Box power
Point fitting
partitions n panel removal
And New
Room In 12. SS-Combin
for fitting
S. GA. 3 pin Top fitting
to weave Box

Combin Box
6 A 3 pin Top
2 core cable.

01.
08.
25 AT

Anatomy
D

21/12/20 Staff Quarters

ceiling fan repaired
1 fan removed
to be repaired
And repaired
fan fitting

Fan

01

301

21/12/20 Girls Hostel

LED Chn
302 - fatal Tubelight

LED

01

21/12/20 Girls Hostel

LED change
Regulator change

~~0309~~

~~01~~

301

21/12/20 Girls Hostel

Tube light Per
LED fitting

LED

01

GR

301

21/12/20 Girls Hostel

Reading Room 2 - lights
chn

LED

02

Library

Reading
Room

Date	Department	Type of work	use material	Q	Si-	Row
21/12/20	Library	Computer power point. New fitting SS. combain Box 2. fitting	Combein	02		Lion
21/12/20	Pediatrics Dept.	Projector fitting	Projector	1	<u>Shah</u>	
23/12/20	PG Hostel	LED fan	LED	01	<u>Shah</u>	516
23/12/20	PG Hostel	LED light chere	LED	01	Shah	716
23/12/20	PG Hostel	Holder fitting Capacitor chere 2. Regulator fitting	Regulator Capacitor Holder	02 01 01	<u>Shah</u>	504

Date	Department	Type of working	use material	Qty.	Sign	Room No
29/12/20	Boys hostel	Tubelight change	LED	01	[Signature]	206
29/12/20	Boys hostel	E. fans repair	—	—	[Signature]	407
29/12/20	Girls hostel	Main power supply repair	—	—	[Signature]	401

Date	Department	Type of working	use material	Qty	Sign	Room No.
30/12/20	Spills house	Under LED light			J.	513


42x35

308
9867575886

MGM Medical college &
UG, PG. Hostels. Electrical.
Maintenance Book.

Electrician : Nitin.pimple : 976114360

Carpenter : Bhejram More. : 9702026457

2021, 

2021. January to. may

Date	Department	Type of working	Use material	Qty	Size	Room / Area
01/01/2021						
01/01/2021	Library.	Cabin Table Electric point fitting & New SS. IGA. Combin Box fitting And wiring Connection	Combin Box Wire. Red Wire Blak. Wire Green Cassing putti Screws 35X8-	02. 15 Mt. 15 Mt. 15 Mt. 02 No 30 pic		Library front/lobby
01/01/2021	Girls Hostel	Main power supply Repairing MCB contact Lose properly fitting	No. Material.	—		409.
01/01/2021	Girls Hostel	Celling fan Repairing Capacitor change	Capacitor	01		201.
01/01/2021	Girls hostel	celing fan change old Remove And Repair fan. fitting	fan	01.		403.
01/01/2021	PG. Hostel	Wash room in 14 w. CFL. Bulb. fitting	Bulb-	01		111. PG-

Date	Department	Type of working	Use material.	Qty.	Sign	Room No.
02/01/2021	Boys Hostel	ceiling fan fitting old fan remove And Repaired fan fitting 2. fans Regulator fitting	fan Regulator	01 02	Signature	412
02/01/2021	Boys Hostel	ceiling fan change 1 Old fan remove And Repaired fan fitting fan capacitor change	fan capacitor	01 01	Signature	414
02/01/21	Boys Hostel	fan Repairing capacitor change	Capacitor	01	Signature	301
04/01/21	Boys Hostel	Repaired fan fitting	fan	01		309
04/01/21	Boys Hostel	ceiling fan Repld And fan Regulator change	fan Regulator	01 01	Signature	112

02/01/21	Bovshar	Tube Light Chng	LED Light	01	Harsh	305
04/01/21	Staff B G	LED Light Chng	LED	01	gud	202
05/01/21	PG Hostl	power point fix	power point	01	Post point	716
05/01/21	GNS host	4 fan Regulator fitting	Regulator	07	fix	310
06/01/21	Biochemst	Ups power supply Disconn And G point Main Electrical Direct con supply on Input. to out put. convert Series connection	=/	11		Biochemst Practical Room
06/01/21	Micro	New Microbiology Musium glow Board power connection fitting 2. Box power supply	2-core Cable 2mm-cable clip.	15 Mt. 12 No-		Micro Musium
06/01/21	Pathology	Internet cable Installation 70. Mt. Cat 6 cable km	Cat. 6 cable	70 Mt-		Pathology Seminar Hall

Date	Department	Type of working	Use material	Qty	SI	Room
06/01/21	Girls Hostel	Telch Light chng				302
06/01/21	Girls Hostel	Passage 1. LED Light chng	LED	01	Jale Singh Sh	Passage 5th floor
06/01/21	Pathology	Pathology New Musium Glow Box fitting wiring Connection wire xfer And. 3. pin top fitting Ail Box working Progress.	3 pin Top wire	02 20 mt		2nd floor patho of Prd Dept.
06/01/21	PG Hostel	Fan Regulator chng	Regulator	01	Sh	30 603
07/01/21	Boys Hostel	Fan Repair capacitor chng	Capacitor	01	Sh	113
08/01/21	Omics	3. Autoclave point fitting metal Bb. Box. 3. fitting 3 2 pol. 32. Amp. MCB New fitting one fan removed And fitting	PB. Box. MCB wire	03 03 15 mt.		Omics Practical Lab.

Date	Department	Type of working	Use material.	Qty	Signature	Room No
					Shu	202
08/01/21	Girls Hostel	LED Light Ch	LED	02		202
09/01/21	Pg House	Fan	Fan	1	h	115
13/01/20	Boys Hostel	Fan Repairing Capacitor change And Tulce light change	LED Capacitor	01 01	Shu Shu	113
B/01/20	Boys Hostel	Fan Repairing Capa Change	Capacitor	01	Shu	309

13/01/2021	Boys Hostel	LED Light fitting fan repairing Switch Board Proper fitting	LED	01	Narslyk	407
13/01/21	Boys Hostel	Tube lights - replace and LED light fitting	LED	01		506
14/01/21	Boys Hostel	Fan Repair			Jamy	312
16/01/21	PG Hostel	Fan change G.A. Socket Change Angular Holder New fitting - cth and fitting	bulb Holder Socket fan	01 02 01 01	Ally Lamb	606

18/01/21	Girls Hostel	Repaired fan fitting	fan	01	Plesas	514
18/01/21	Girls Host	fan fitting	fan	01		505
18/01/21	Girls hostel	Tidal fan fitting			Sacha	314
19/01/21	University	<ul style="list-style-type: none"> 2 LED lights fitting 1. Tube light set Properly fitting 5.4 ceiling fans Change Anal. 4. fans fitting 1. fan Regulator change 	<ul style="list-style-type: none"> LED fan 	<ul style="list-style-type: none"> 2 028 		University
19/01/21	Staff Q	Switch Board fitting				107
19/01/21	PH Hostel Hospital B	fan clamp chng	changing			504

20/01/21	Anatomy	one ceiling fan Installation	Fan Rod e. fan clamp.	01 01 01		Anatomy Seminar Hall
20/01/21	Girls Hostel	ceiling fan, change Regulator fitting	Fan Regulator	01 01	Handwritten signature	205
20/01/20	Girls Hostel	Fan Regulator change	Regulator	01	Handwritten signature	202
20/01/20	Boys Hostel	Fan change	Fan	01	Handwritten signature	312
21/01/20	Boys Hostel	Fan change	Fan	01	Handwritten signature	414
21/01/20	Girls Hostel	Fan fitting	Fan	01	Handwritten signature	414

27/01/21 Girl's Hostel LED light fitting

27/1/21 girls hostel Plug point Regulator C

27/01/21 Girls Hostel LED fitting

25

LED 02 *leaf*

LED 01

04/02/20	Girls Hostel	Fan Repu capacitor	Capacitor	01	Handwritten	313
4/02/21	Girls Hostel	Fan Repu Capa Change And 2. Regulator ch	Capacitor Regulator	01 02	Handwritten	306
04/02/21	Girls Hostel	Fan Regu ch	Regulator	02	Handwritten	302
05/02/21	Boys Hostel	Tube Light set Re- LED fitting	LED	01	Handwritten	511
5/02/21	Boys Hostel	LED Light	LED	01	Handwritten	506
5/02/21	Boys Hostel	Fan Repairing Capacitor Change	Capacitor	01	Handwritten	202
05/02/21	Boys Hostel	Fan Repairing capacitor ch Sun Board Re Sheet Top ch	Capacitor	01	Handwritten	111
05/02/21	Boys Hostel	Capacitor change	Capacitor	01	Handwritten	108

06/02/21

PG Hostel

Tube Light Re

Tube Light

01

414

06/02/21

PG Hostel

LED Light
for JS-2000
Light Re

LED

01

812

12/02/21

Girls Hostel

Tube Light
fitting

LED

01

Abd

508

12/02/21

Girls hostel

LED light
fitting

LED

01

Mur

511

12/02/21

Girls Hostel

LED change

LED

01

Mur

509

12/02/21

Girls hostel

LED light
fitting

LED

01

Mur

504

21/02/21	Girls Hostel	LED Light fitting	LED	01	Sum 11/2/2021	1st floor passage
12/02/21	Girls hostel	LED Light change	LED	01	Sum 11/2/2021	Ground floor passage
18/02/21	PG Hostel	LED Light fit	LED	01		601 - Pond
18/02/21	PG Hostel	LED Light fitting	LED	01	Agar	606
18/2/21	PG Hostel	Plug point repair - N socket ch And fan repair - Cap	Capacitor Socket GA.	01 01	W	613
18/02/21	PG Hostel	Fan repairing capacitor change	Capacitor	01	Kr. N. Jya	301
18/02/21	PG Hostel	LED Light fitting	LED	01	D	211
22/02/21	Boys hostel	3. LED Lights Change Reading Room	LED	03		Reading Room
22/02/21	Boys Hostel	Fan change - regulator change LED light fitting	LED Regulator fan	01 01 01		01

22/02/21	Boys Hostel	Fan Repairing Capacitor One	Capacitor	01	Hind	208
24/02/21	Boys Hostel	LED	LED	01	Boak	112
23/02/21	Boys Hostel	Fan Repairing Capacitor	Capacitor	01	Tammy	02
23/02/21	Boys Hostel	Fan Repairing Capacitor ch	Capacitor	01		114
25/2	PG Hostel	Bulb repair		01		308
	UG Hostel	Repair	Tubelight	01		313
25/2	PG Hostel	Tubelight	Tubelight	02		216
26/02/21	CR1	Accelerate point New fitting Scope Cable fitting Pool Incluse 2. m fitting 32. A. MCB				

2/3/21	Boys Hostel	Fan fitting	fan	①	513	513	513
2/3/21	Boys Hostel	LED Light fitting	LED	1	1	201	201
03/03/21	PG Hostel	CH Bulb. 40W	bulb	01		676	676
06/03/21	Girls host	Fan repair capacitor	capac	01		02	02
8/03/21	PG Hostel	LED Light fitting	LED	01		106	106
8/03/21	PG. Hostel	Greyzer point MCB fitting	MCB	16 A-	01	603	603
8/3	PG hostel	Greyzer Point MCB	MCB		01	110	110

10/03/21	PG Hostel	LED cheng	LED	01	508	508
10/03/21	PG Hostel	Earth pin Repa Earthing	/	/	608	608
10/03/21	PG host	Fan Repa capacitor ch	Capac	01	404	404
11/03/21	Girls host	Fan Repa capacitor cheng	Capac	01	09	09
11/03/2021	Girls Hostel	Tubelight repair	LED	01	113	113
11/3/21	Girls Hostel	Tubelight	LED	01	109	109
11-3-21	Girls hostel	1 floor bathroom tubelight	LED	01	1st floor	1st floor
11-3-21	Girls hostel	3 floor Passage - 2 tubelight	LED	02	3 floor	3 floor
11/03/21	PG Hostel	Fan fitting	Fan	01	507	507
11/03/21	Library	UPS shortcircuit problem UPS Backup. Droc. Bypass	/	/	Library	Library

18/03/21

PG Host

Axon fan 4

~~107~~

608

19/03/21

Library

2 x Philips panel light
New installation
10, No-
1-20w Tube LED fitting
one ceiling fan ch
of connection see

PL-light

10

LED - 2, 4

01

Library

19/03/21

Pharmacology

one fan Repairing
Capacitor change
And 1- LED fitting

Capacitor
LED

01

01

Staff Room

19/03/21

Smics

5- 6A switch
change 2- 16-
A- Shaker change

Sw - Molex
Shaker

05

03

Smics

19/03/21

Girls Host

Fan fitting (Repair)

Fan

01

~~107~~
19-3-21

107

19/03/21

Girls Host

Fan Repairing
Capacitor ch

Capac

01

~~107~~
19-3-21

01

20/03/21 Pathology
to New Lab-

24/03/21
25/03/21

New Pathology Practicul
Hall 2nd floor Microscop-
power point wiring on
Tabel. 42. (8. model 16.
App. power point switch
Shaker New fitting
45. 20 wtc LED
Light fitting main power
Supply cabinet. fit
G3. A. H pol MCB fitting
All points proper
Cassing parti fit
And other points
Preper

Cassing parti 30 No-
LED Light 45 No-
Screw 1 Paket
2.5 wire Red 1 Box
2.5 wire Black 1 Box
8 model plate 45 Nos
Sw - 704 No-
Sh - 12 No-
1.5 wire (R) 1 Box
1.5 wire (B) 1 Box
1.5 wire Green 1 Box
Insulation tape 05 No-

Pathology
New
Practical
Lab
2nd floor

26/03/21. St
to
31/03/21

(on leave
sheek leave)

01/04/21
to
14/04/21

}}

(covid positive)
corr. confinement
14 days
(on leave)

}}

}}

15/04/21 Physiology

Lecher Hall C No: 4-
Audiorisial system
Sound speaker New
fitting And All wiring
H. sound Box.

Cassiny patch 08
Speaker Box 04
Wire 30 mt.

Lecher Hall
No: 04

17/04/21 PG Hostel

Tube Light (LED set)
New fitting

LED 01

104

17/04/21 PG Hostel
Hospital
Building

4 fan Repairing
capcator ch
And 1 ceiling fan
Change

fan 01
capcator 01

420

19/04/21 Pharmacology
(Animal Hse)

2. xosif fan
Remove for Repairing
And one Tube Light
Repairing

Tube Light 01

Animal
Hse

20/04/21 Biochemists

Seminar hall 3. fan
Change old fan
Remove And
Repaired fan fitting

fan 03

Biochemists
Seminar
hall

21/04/21	Pathology Demo Room	New LED projector fitting And All wiring connection Mount stand fitting	LCD projector 01 stand 01 HDMI cable 01 VGA Cable 01	2nd 4th
----------	------------------------	---	---	------------

22/04/21	University	Net cable fitting 3rd floor to 2nd floor library wiring come C/Ho Cat 6 cable	85 mt ^{Cat6} cable 85 mt	Academic Section
----------	------------	---	-----------------------------------	---------------------

23/04/21	Anatomy	Demo room LCD projector New fitting LED projector, HDMI cable VGA cable And mount stand fitting	Mount stand 01 VGA - 15 mt 01 HDMI 15 mt 01 projector 01	Demonstr Room
----------	---------	---	---	------------------

26/04/21	Pharmacy	Practical hall 6 fan Repairing capacitor chery	capacitor 05	Ph Practical Room
----------	----------	--	--------------	-------------------------

27/04/21	Tb-Labo	one ceiling fan old removed and replaced - fan fitting	fan	01	LB Lab
27/04/21	CRL-	Zebra fish Lab 3. Tube light and timer problem solve	/ /	/ /	Zebra fish Lab
28/04/21	Girls Hostel	3rd floor passenger tube light change	LED	01	3rd floor passage
30/04/21	Lechor Hall No: 03	Cat 6 cable fitting 65 meter cable New CRL Lab - to Lechor Hall No-03 -	Cat 6 cable	05 MT	Lechor Hall No 03
03/05/21	Animal house	2. Repair Exost. from fire fitting	Exost fan	02	Animal House
04/05/21	Bairchmisy	HDMI cable change old cable removed handwired to STU New cable purchase and fitting Demo Room	HDMI	15 MT	Demonstration Room

5/05/21	Pharmacology	Dep- Mod ceiling one ceiling fan for repairing And repaired fan fitting 2. fans repairing capacitor change	fan capacitor	01 02	Pharmacol Dept.
06/05/21	Microbiology	2. Old Tube Light set Remr LED Light fitting And for 3 ceiling fans repairing capacitor change.	LED capacitor	02 03	Micro Dept.
07/05/21	Biochemistry	Department underside fan Remove and Reuse front side Room in fitting.	fan	01	Biochemis Student Room
07/05/21	Girls Hostel	1. Tube Light not work old path set Remove And New LED Light fitting one ceiling fan repairing capacitor change	LED capacitor	01 01	Room No 13

10/05/21	Anatomy Ao	Dissection hall Inter net cabling 45 Meters Cat 6 cable Jumper	Cat 6 cable 45 M	Dissection Hall
11/05/21	Pathology	VGA cable change And Departments Power point repairing Nutritional problems seen	VGA 15 M+	Patho Seminar
11/05/21	Account sectr-	Medical College Account section one wall fan remove and filter to lecture Hall No 21- And H+ Lecture L Hall In one week fan Remove and filter Account section	Wall fan 1	Account section
12/05/21	Staff Qu	2 ceiling fan repairing capacitor change	capacitor 02	Staff 208
12/05/21	Boys Hostel	2 fans repairing capacitor change	capacitor 02	212 Boys Hostel etc-

14/05/21	Canteen	one ceiling fan fitting counter side And 1 kitchen wall fan fitting	fan	01	Dining Hall counter side
15/05/21	PG Hostel	Room No 210 wash room Main circuit Basel cost circuit Pract. All New wiring Cable given point front light point And CFL, desk fan point New hinges	Wire 2.5 - R B G	15 - MH 15 - MH 15 - MH	210
15/05/21	PG. Hqs	CFL Bulb fitting	CFL Bulb	01	313 PG. Hqs
17/05/21	PG. Hostel Hospital B.	2. Fan repairing And lights repairing			508 PG Hostel
17/05/21	Baiachmisty	Demonstration Room 1. ceiling fan Give old fan for repairing And prepared fan for fitting	fan	01	

18/05/21	Dens office	VGA cable change	VGA cable	15M4	Dens office
18/05/21	university	Passer LED Light Rem - And And Academic Section Fan fitting	LED	01	Academic
19/05/21	Staffa	celling fan change - old fan Rem - And Repaired fan fitting	fan	01	403 Staff Office
19/05/21	PG Hostel	celling fan change Repaired fan fitting	fan	01	212 PG Hostel
19/05/21	Library	CCTV point 3 pin top Rem - And L.N.E. point Direct connections	//		Library
19/05/21	Canteen	Door fan cencer Di connection Rem - And 3 Direct power su on	//		Canteen Kitchen Door

Date	Department	Type of working	use material	Qty	Site	Room/Office
20/05/21	Boys Hostel	2. LED light set New fitting	LED	02		514
21/05/21	Boys hostel	Regulator fitting socket changing	Regulator socket	2 1	Jay	312
21/5/21	Boys Hostel	Socket Plug point Remove & LED light in 504		1		504
22/05/21	Medical College	Den's office front side ALL Electrical Point Remove				
24/05/21	Medical college	Den's office, medical college stall cabin to PC point power supply connection Temporary	Wire	20 KIT	-	R
25/05/21	PG Hostel	Fan fitting old fan Remove And Repair fan fitting LED fitting Switch board properly fitting	LED Fan	01 01		112

25/05/21

PG Host

gys - sus -
che
MCB &

MCB

7/6

26/05/21

Medical college

front side Account
Section Switch
Board And
Interake connection
Removal
All power point
Removal

Accounts

26/05/21

medical college

PC point connections
start Removal

25/05/21

Dens office

Main panel Neutral
Bar Connections
Short circuit
Joint to probe
cover on SW

Dens office
work Room

27/05/21

medical college
store room

old fire cube
Removal

28/05/21	Staff Canteen	Old fan removed - And repaired fan fitting - Switch Board Repa	Fan	01	104	104
28/05/21	Boys Hostel	Fan Repairing capacitor Chen	Capacitor	02	508	508
29/05/21	PG Hostel	LED Light fitting old Tube light pathi set Remove And 20 wt. LED Light	LED	01	604	604
29/05/21	Staff Canteen	1st floor passage 1. LED Light change	LED Light	01		1st floor passage
31/05/21	Library	Ups Battery change - E. Library / pc. Backup - Change / Repairing				E Library
31/05/21	Staff Canteen	old Tube light pathi set Remove And LED Light fitting	LED Light	01		306

Please start using register for the daily visit and

MGM Medical college, Kamathe
Electrical Maintenance
Book

(Electrician: 9767114360/-

(Carpenter: 9702026457/-

2021 / - 10 -

Date	Department	Type of working	Use material	Qty	Sign-	Room-
26/10/21	Omic5	2. New fan Installation Get Down fan Rod Fitting fan clamp. Fitting And connection one Had cabin fan xchange one fan Rod fan fan Demol f fitting.	fan fan Rod fan clamp.	02 02 03		Omic5 Lab-
27/10/21	Boys Hostel	Fan Repairing capacitor Change And Light fitting old pathi set Remove And LED set fitting	Capacitor LED	01 01	Uash	408
27/10/21	Boys Hostel	Switch Board Repairing G.A. shakeret change	Shakeret	01	Uash	407
27/10/21	Boys Hostel	Fan Repairing Capacitor change	Capacitor	01	Uash	210
27/10/21	Girls Hostel	Fan change old Remove And Repair fitting fan Rod Cher	fan Rod	01 01	Uash	512

29/10/21	Biochemistry	3 Fans fitting old fans Remover And repaired fan fitting	Fan	03		Dormo Room
29/10/2021	MGM Campus Food Canteen	2 fan fitting, 2 tube fitting, 1 Hot sandwich machine 3 pin top change & Refitting	3 pin top, 2 fan, 2 tube	07	Camp	Canteen/ Kitchen
29/10/21	PG Hostel	Lights change	LED light fitting CFL Bulb- Holder	01 01 01		410
29/10/21	PG Hostel	Fan Repairing capacitor change Air point Repair	capacitor	01	Pen	509
29/10/21	PG hostel	Fan Repairing capacitor change CFL Bulb change LED light change	bulb Capacitor LED	01 01 01	J. Natar	411
29/10/21	PG hostel	Fan fitting LED fitting	fan LED	01 01		616
30/10/21	Canteen	16 A. combain Box New Installation	Combain Box	01		Canteen Store

Date	Department	Type of working	Use material	Qty.	Sig.	Room/Priv
01/11/21	University	2. Fans Replaced Old fan removed And repaired fan fitting	Fan	02	AS Pat	Reception Upside ↓ IT Dept.
02/11/21	Staff canteen	Fan fitting			AS Pat	306
02/11/21	PG Hostel	Fan Repairing Capacitor change	Capacitor	01	AS Pat Dr. Prasen	315
2/11/21	PG Hostel	Tube light change	LED	1	AS Pat Dr. A. Bhattach.	204
8/11/21	4th floor Examine Hall	12 Fans Remove	Fan	12	AS Pat	4th Floor
10/11/21	3rd floor 308	Switch repair	Tube light	1	AS Pat	
10/11/21	Staff Canteen	Fan fitting old removed And repaired fan fit	Fan	01		305

11/11/21

PG Hostel

Tube Light
Repairing

~~LED~~

0/

Shanti
11/11/2021
Tubelight
repaired.
Thankyou.

571

11/11/21

Staff car

2 New fans
fitting

Nimrati

505

11/11/21

Girls hostel

Fan Repairing
Capacitor - to Chen

Capacitor

04

Nisha

111


12/11/21

PG Hostel

Fan Repair - Regulator
change
Switch change

Regular
10 Amp Switch
change

1




113

12/11/21

PG Hostel

Wire Repair



612

12/11/21

Girls hostel

Fan fitting
Room No 14. Ho fit
111 - Room in

Fan

01

111

18/11/21	Girls Hostel	Fan Repairing Capacitor chn	Capacitor	01	40g	40g
18/11/21	Girls Hostel	Fan Repairing Capacitor Chn And Light Chn	LED Capacitor	01 01	30g	30g
18/11/21	Girls Hostel	Fan Repairing Capacitor chn	Capacitor	01	30g	30g
18-11-21	—	Fan Repairing Switch Board Repairing	Capacitor	01	20g	20g
18/11/21	Girls hostel	Fan Repairing capacitor chn	Capacitor	01	20g	20g
19/11/21	Boys-hostel	Tube light Chn	Light	01	70g	70g

22/11/21	Boys Hostel	Tube Light Chen LED fit	LED	01	Phil	112
22/11/21	Boys Hostel Physiology	Fan Cheney old fan - Remu And repaired fan fitting	Fan	01	Phil 22/11/21	Physiology Chem Room
22/11/21	Pathology	Jo. Miller Cat 6 Net Cable fiber Cabling Telemetry Pathology Dept to - medical center Stone switch conceal	Cat 6 cable	50 m	John 22/11/21 (ground floor work)	Pathology John
22/11/21	Canteen	Canteen worker Room in 4m Cheney old fan (Remu) And repaired fan fitting	Fan	01	Comp	Canteen Locker Room
22/11/21	Staff Rm	Door Bell fitting	—	—	—	205

Date	Department	Type			
22/11/2021	PG Hostel	Electrician - Short circuit		207	501
23/11/21	Girls Hostel	Fan removal for repair			501 A. Ch. M.
23/11/21	Girls hostel	Fan repairing capacitor changed		412	KPH
26/11/21	PG Hostel	Fan change		711	PC
29/11/21	PG Hostel	keysee not working		413	NK.
29/11/21	PG hostel	light switch repair		202	PC
30/11/21	Boys Hostel	Fan fitting ok fan removal and repair fan fitting	Fan	01	PC 113 113
30/11/21	Boys Hostel	Fan repairing capacitor change	Capacitor	01	DB 309

30/11/21

PG Hostel

giver point
Repairing
Band Ch

3 pin Top 01
76 A socket 01

Asaf

313

30/11/21

Library

3 fan s fitting
Repairing
1. old fan Remove

Fan

03

Library
Reading
Room

01/12/21

MELU

Projector Installation
Wall mount stand
fitting projector
fitting hanging
power point fitting
N.L.E. connection
HDMI cable fitting
And VGA cable
fitting

Projector 01
Mount stand. 01
VGA cable 15 MT
HDMI 15 MT
power wire 24 MT
Screw 5x8 = 10 nos
SS combain Box - 01 - No.
1. model Box with plate
01
Cable Tie. 10 NO

MELU

nkay

03/12/21

MELU

All - New Paints Change
And magerment.

4/12/21

Pathalany

LCO projector
fitting.

Projector

01

in AMT
demonstrator
John

Demo
Room

Date	Department	Type of working	Use material	Qty	Sign	Room / Any
06/12/21	Pathology	New fan Installation And LED Light fitting	fan fan D. Rod Ruber clamp. Cap. Wire LED light.	01 01 01 02 No 2 meters 01-	Jain	Pathology Department 2nd floor
06/12/21	Boys Hostel	fan Repairing capacitor Cher	Capacitor	01	Jain	306
06/12/21	Boys Hostel	fan fitting Repair fan fitting And old fan fix	fan	01	Jain	404
06/12/21	Girls Hostel	one fan Remove And fitting	fan	01		04

Date	Department	Type of working	Use material	Qty	Size	Room
07/12/21 to 11/12/21	MEU Medical Education Unit	New fan installation Consumption grapes 48" Inch 3 fans fitting Anchor fastener fitting 3 pins fan Down Rod fitting 4 FH 3 Nos 6 LED lights fitting plug point fitting 18 model box with plate fitting in points 12 lights point 3 fan Regulator fitting 6 model 2 Box with plate fitting Main power point Wiring Net wiring And cabling ping- Cat 6 cable point Installation 4 points 304 meters cabling MEU Department to 1st floor physiology Main Server Box Attachment Projector Point Net connection Cat 6 Cable	1.5 wire Red 1.5 Black 1.5 Green fan Hoge 2.401 Anchor fastener M. screw fan Insulation Tape 6 model Box Box plate 6 Cat 6 cable Dipe pre Casting part LED light Scr Creep Cable Tye	50MT 50MT 50MT 03 No 06 No 07 No 03 08 pin 08 No 03 No 305 MT 12 No 15 No 06 21 pack 4 pack 1 pack		



afat

Date	Department	Qty	Use	Material	Qty	SR	Room
18/12/21	S.B.S	2	Fans Repairing	Capacitor	02		SBS Class Room
18/12/21	Boys hostel	1	Fan Repairing	Fan	01		303
18/12/21	PG Hostel	1	Fan Repairing	Capa -	01		215
20/12/21	Medical College office	6	Power point fitting	6 model Box	02	<u>New office</u>	
		2	Power point	6 model plate	02		
		1	Insta	6 Amp switch	04		
		2	Box fitting	6 Amp socket	04		
			Cassing path	Screw 19x6	40 p/s		
		6	Nos 16A-SS	Cassing path	06		
			Com bin Box	Com bin Box	01		
20/12/21	PG Hostel	1	Wash Room Light	Bulb- LED	01		503
			Change				

Date	Department	Type of works	Use material	Qty	Sig	Room
21/12/21	Pharmacology	Clerk Room ins ceiling fan old fan remove for repairing And repair fan fitting	Fan	01	Bhusari	Clerk Room
21/12/21	PG Hostel 515.	Switch changed.	16. MCB.	01	Ju	515.
21/12/21	PG Hostel 612	Switch changed			Ju	612
22/12/21	Pharmacology	HDMI cable Installation 15. Miter	HDMI	15 mt.	Bhusari	Pharm Demo Recro
23/12/21	Staff Quarters	light changed	LED light.	1	Nanjani	304.
23/12/21	Pharmacology	Out door front side main MCB. CDB Box properly fitting covered fitting	cable ty	05 mt	Bhusari	2nd floor
23/12/21	Boys Hostel	old LED fan And New fitting	LED	01	Dr. V. K. J.	402

Date	Department	Type of work	Use material	Qty	Site	Room No
23/12/21	PG Hostel	Fan Repairing Capacitor ch	Capacitor	01		502 502 Fan
23/12/21	PG Hostel	Switch Board Re 6 Amp Socket Repairing	—			Appt 702
23/12/21	PG Hostel	Fan Repairing capacitor ch	Capacitor	01	Devda	601
24/12/21	PG Hostel	LED light fitting 3. LED fitting Holder fitting	Holder Bulb LED	01 03 02		101 101 26.12.21
24/12/21	Canteen Mess	PG Hostel Building Bsmnt Mess 2. Fans Repairing 4 Capacitor Change 1. Switch Board Repairing And	Fan Capacitor	04	And	<u>Mess</u>

Date	Department	Type of working	Use material	Qty	Gier	Room
27/12/24	Canteen	Canteen Kitchen bleed fuel chimney Lights glass fitting for glass And one (1) 36 watt LED Panel old Remove And New LED panel set fitting Properly All loose wire fitting	LED - 01	01	C. Shop Store keeping	Canteen Kitchen
28/12/24	P.G. Hostel	7th floor - 703. Rooms In All main supply off MCB tripper on				103
28/12/24	Hospital 6 th floor	Skill Lab Extra pc. Computer Power point fitting passing patch fit 6 modular Box with plate fit 6 Amp shield 6 Amp SW fit 20 Miter 20	6 modular Box plate 6 Amp SW Shaker Cassing patch Wire Reel. Black gr Scr 19x6	01 01 02 02 02 20mt 12 DIS	Saha Sir	Skill Lab

Date	Department	Type of Working	use material	Qty	Sig-	Room/Pr
29/12/21	Pathology	2nd floor Management store Rooms All old wiring Pencil 10-55 old combain Box with old casing Batt Points free		Removal of University electric wires old connector in new H room		29/12/21
30/12/21	Canteen	Batter Grinder Machine Repairing for Nut Bolt Preparation	Su	01	C - Sp	Kitchen
31/12/21	Beiochemstry	Water Heater Bath 3 pin Top Charge	3 pin Top			Bord

Date	Department	Type of working	Use Material	Qty	Site	Room
01/01/2022	Exame Hall	All Lights And fans Check Exame Hall 4th floor And All Electrical points Check Jumper Jumper GSM Jumper Point change				4th floor Exame Hall

03/01/2022	Staff Canteen	Wash Room bulb Not working old Bulb removed and Glowth LED Bulb fitting	LED Bulb	02		501
------------	---------------	---	----------	----	--	-----

03/01/2022	PG Hostel	Wash room bulb change	bulb - glowth	01		413
------------	-----------	-----------------------	---------------	----	--	-----

03/01/2022	Canteen	Dining stall Banbery Point Repair And 3 pin Top Repairing Properly Crancher Mash Ru				4th Canteen Dining Hall
------------	---------	---	--	--	--	----------------------------------

Date	Department	Type of working	use material	Qty	Sign	Room
04/01/22	M.E.U.	One old tube light set removed And 2. 36 watt 2x2 PL light fitting	PL panel lights	02	Mas	IQSC 1st floor
04/01/22	Anatomy	Departmental B.B. Box Preparing wiring And MCB Tapes on				1st floor
4/1/22	Girls Hostel	Old tube light removed LED fitting done.	Tube light	01		room no 7 Ground floor
04/01/22	Girls Hostel	old tube light set removed And LED lights fitting	LED	01		302
05/01/22	Anatomy	New AC point fitting Main structure for 2 way PB Inclusion Box fitting 65 meter wiring N.L.	Cassing path Wire Red Wire Black Wire Green PVC pipe Inclusion MCB 16 AMP Insulation tape	01 01 Box 01 Box 01 Box 06 No 01 02		Anatomy Dissection hall

06/01/22	PG Hostel	LED Lights Cheras Holder fitting old tube set Rem	LED	01	DB	308
----------	-----------	--	-----	----	---------------	-----

06/01/22	PG Hostel	LED Lights fitting	LED	01	DB	101
----------	-----------	--------------------	-----	----	----	-----

10/01/22	S.B.5	5 Ceiling fans Repairing Capacitor Choke 2. Fans Remove for Repairing And 1. New fan Installation 2. Xset fan remove And fitting 3. Lights old lights remove And 3. New LED lights fitting 6. Amp. Legrand 1. Switch Choke	LED Capacitor Switch Xset fan	03 05 01 01	May 12	S.B.5. Class Room
----------	-------	---	--	----------------------	--------	-------------------------

10/01/22	Dins cktc	New Xset fan fitting And power supply connection				Wash Room
----------	-----------	--	--	--	--	--------------

29/06/2021	Girls Hostel	Fan Repair.					
28/06/21	Girls Hostel (302)	Fan Repair					
29/6/21	PG Hostel	Bulb & Geyser Repair					
29/6/21	PG Hostel (404)	2 Locket. Change & 2 Tubelights Changed					
01/07/2021	Pharmacology	2 Fans Repairing Capacitor Change 1. old Tubelight patti set remove And LED set fit	Capacitor LED	02 01			Pharm Staff Room
01/07/2021	Microbiology	2. old Tubelight set remove And And LED light fitting 16 A. power point. Repairing	LED	02			Micro Dep--
01/07/2021	Medical college	SBS. CRL Dept. 2 PL LED Light fitting 6 model power Point. New Instalment	6 model Box 16'A. socket Switch plate	01 02 02 01			CRL Dept

Handwritten signature
Jain

Handwritten signature
Mans

Handwritten signature
Jain

01/07/21	Girls Hostel	3rd floor water heater Earthing problem Earthing wire Disconnected properly wire fitting	←			Exenses 11/7/2021	Girls 3rd floor
01/07/21	Boys Host	Fan Repairing Capacitor change	Capacitor	01		YPL	408
01/07/21	Boys Hostel	Fan Repairing capacitor ch	Capacitor	01		YPL	409
01/07/21	Boys Hostel	Repair fan fitting old fan rem	fan	01		YPL	107
01/07/21	P.L. Host	Fan wiring cable checked	Equip	01		YPL	116

06/07/21	Boys Hostel	MCB Tripper on				301
09/07/21	Boys Hostel	Light fitting	LED	01	Harelyd	407
09/07/21	PG hostel	CFI bulb	Bulb	01	Harelyd	414
09/07/21	PG hostel	Fan Repair	Fan Capacitor	01		514
11/07/21	PG hostel	Fan Repair		01		312
10/07/21	Canteen	Focus lamp Wire Connection MCB Tripper on Wall fan connection Guptay Panel				Canteen Kichu



Date	Department	Type of working	Use Material	Qty	Site	Room/Aor
12/07/21	SBS	<p>UPS connection & power point</p> <p>Hod. cabins - spy guard properly wall up fitting</p> <p>6. Fans Capacitors change one ceiling fan Repairs</p> <p>2. ceiling fan Remove for repairing</p> <p>1. 2x2 squar LED Light fitting</p> <p>And - 4 4ft row LED light fitting</p>	<p>5sqw LED</p> <p>4 4ft LED</p> <p>fan capacitor</p> <p>wire 2.5 Red</p> <p>2.5 Black</p> <p>1.5 Green</p>	<p>01</p> <p>02</p> <p>06</p> <p>10 M</p> <p>10 M</p> <p>10 M</p>		<p>SBS -</p> <p>Stair</p> <p>Roof</p> <p>And</p> <p>Callss room</p>
13/7/21	PG Hostel Room 412	Ceiling fan replaced.	Fan	01	camp	4/2
14/07/21	Anatomy	<p>3 LED light fitting</p> <p>1. LCD protector fitting</p>	LED	05		Anatomy Dept

Date	Department	Type of work	Used Material	Qty	Sl. No.	Room
15/7/21	Pathology	Change of Tubelight	Tubelight	01	Gay	909
15/07/21	PG Hostel	Switch Board chng 3 pin top chng 16 A Shoket 16 A Sw Chng	16 A Shoket 16 A Sw 3 pin top	01 01	Aslof	313
16/07/21 17/07/21	Anatomy	Histology Celling fan Installation 13 fans	Fan	13		Histology
19/07/21	Biochemistry	2 Replaced to MCB 16 Amp MCB Pen And 32 Amp MCB fitting	MCB 32 A	01		Practical Hall
20/07/21	Call Lab.	2. ceiling fan fitting 3. camera wiring Net Cabling - 30 mt CCTV - Cabling 150 mt				Call Lab
23/07/21	SBS	LED light chng New fitting old part set removed	LED	01		SBS Account section

26/07/21	staff	one ceiling fan repaired And fan capacitor change	Capac	01		
27/07/21	PG Hostel	LED light fitting old set	LED	01		614
27/07/21	PG hostel	LED Light fit	LED	01	Verma	565
28/07/21	UG hostel	LED light	LED	01	Sand	205
28/07/21	PG Hostel	LED light Change	LED	01	Sur	305 303
29/07/21	Anatomy	5 fans Installation And 2x2 LED light Installation	fans LED	05 04		Anatomy
30/07/21	PG hostel	fan Repairing capac - change	Capac	01		516

Date	Department	Type of work	Use material	Qty	SI-	Room/Area
30/07/21	Staff Quarters	SS combain Box fitting new washing Machine point Refrigerator point Attention New Wiring	SS combain Box	01		102-
31/07/21	Medical college Lecher Hall No 24	Physiology Lech- Hall Babu side 1 wall fan fitting	wall fan	01		Lecher Hall No 01
31/07/21 02	Girls Hostel	TV Room 20 fan Remove fan for to room 08	fan	01		08
31/07/21	Girls hostel	fan fitting Repaired	fan	01		202
31/07/21	Girls Hostel	fan fitting Repaired	fan	01		204
31/07/21	pg Hostel	Light And fan change fan capacitor change fan Regulator Wiring. Remove	LED fan (old)	01 01		703 -

02/08/21	ps m-	one ceiling fan Repairing capacitor change	capacitor	01	staff Room
02/08/21	University	small Spot Light fitting for Dem 2. Light Installation	Spot Light	02	Univer
02/08/21	2nd floor Wash Room	2 Wash Room Light Repairing And Make All wash Room passage MCB Tripper on	X	X	2nd floor wash
02/08/21	Boys Hostel	301 Room In no- In Electricity Single pole to -And MCB change	MCB 16 A	01	301
02/08/21	Boys Hostel	fan Repairing capacitor change	capacitor	01	112
02/08/21	Boys Host	old path set Rem And New LED Light fitting	LED	01	214
02/08/21	Canteen	BanBany Point Rem old Calceke Rem new Calceke Distillation spin fan	Calceke 3 ^{2.5} Cor 16 A 3 pin Top	7: mt 01	Canteen

02/08/24	H-t-p Plant	Stored circuit Probel to model Daisy Box from Kinn-casting and Propriety tapes			570
02/08/24	PG. Hostel	Fan change (old fan removed)	Fan	01	703
03/08/21	ST P. Plant	power point check			
03/08/21	Lecher hall No. 03	one New ceiling fan installed	Fan (New)	01	Lecher Hall No 03
03/08/21	SBS. to omic	Net cabling 35 Meter Cable		work 03/08/21	SBS to omic
04/08/21	Medical college Ground floor	4 sqm wire wiring for New main power Supply Temporary Gents toilet to Water Collected Priya 1. Supply connection And Lecher toilet to partitioning Dept - 2 main power supply come	4.5sqm wire Rd Blak 2.5 Green Cable Tray	40 mtr 40 mtr 40 mtr 20 ps -	

04/08/21	Girls Hostel	Fan Repairing cap ch	Capacitor	01	<u>Bm</u>	410
04/08/21	Girls Hostel	Fan Repair Capac chers	Capacitor	02	<u>Kringle</u>	404
04/08/21	Girls Hostel	Fan Repairing Fan switch wire Chers	✓		<u>Geo</u>	204
04/08/21	Girls Hostel	Fan Repairing Capac chers	Capacitor	01	<u>Nalus</u>	206
			capictov	01 01	<u>km</u>	107
04/08/21	PG Hostel	Prepared fan fitting And old fan Rema	fan	01	<u>Ashy</u>	211
05/08/21	Medical College Ground floor	Ground floor wiring Connections	—	—		Patho Dept
05/08/21	Biochemistry	one ceiling fan fitting Repaired fan. old Ben And G. model 2. Surta Box with plate fitting Power fan power all	Fan Surfact Box Plate Shaker Sur wire R.Y.B	01 02 02 04 04 03		Balch Dept

Date	Department	Type of working	use Material	Qty	Sic	Room
05/08/21	STP plant	power point connection check graphy solution fitting earth ch				STR
05/08/21	PG Hostel Hospital B.	LED light fitting fan Repairing	LED	02	R	921
05/08/21	Boys hostel	Repair fan fitting old fan	Fan	01	Sp.	105
05/08/21	Boys Hostel	Fan Repairing capacitor check	Capacitor	01	Amounts	206
05/08/21	Boys Hostel	Ceiling fan Repairing capacitor check	capacitor	01	Menu	306
05/08/21	Boys Hostel	MCB connection check			DB	309
05/08/21	Boys hostel	Fan Repairing Capacitor check	Capacitor	01	Plough	407

05/08/21	PG Hostel	front side Emergency LED Light Properly fitting. ✓	✓			PG Hostel Jm
06/08/21	Girls Hostel	Sw Board Rep	✓			209
6/08/21	Girls hostel	^{new} Tubelight X 2 fixed in room	✓	⊗	Pran	213
6/08/21	Girls Hostel-201	Switch repair x fan repair	✓	⊗		
6/8/21	Girls Hostel-207	Switch fan repair	✓	⊗		
6/8/21	Girls Hostel-207	fan repair				
6/8/21	Girls Hostel-209	Tubelight change				
06/08/21	PG Hostel	Switch Board Preparation - loose contact - properly fitting	✓	✓	Pran	308
07/08/21	Stall Carbay	Door Bell fitting	✓			102
07/08/21	Stall	Green switch chng			Rangan	304

Date	Department	Type of working	use material	Qty	size	Room No
09/08/21	Medical college	Gents Washroom main Light Connection All power supply on	wire - Red Black Green	07 07 07		Ground floor Wash room
				21	MF	
09/08/21	Medical college	Ladies Wash Room All Board camera All points on St New Switch circuit	wire - Red Black PVC pipe	10 mtr 10 mtr 02 mtr		Ladies Wash Room Ground floor
				Total	30 MF	
09/08/21	PG Hostel	LED Light set Charger And fan Regulator Charger	LED	01		4/6
10/08/21	Tb. Lab.	power point fitting New 6 model Box with plate & switch socket fitting 1. Casing capping part fitting cat-6 cabling 35 Meters	6 model Box with plate switch Socket part - Cat 6 cabling	01 02 01 01 35 mtr		Tb. Lab Medical College Branch

10/08/21	Medical College Intram Garden	Front side garden Weather Fountain - Power point change 3 pol. 32 Amp - (2. No. MCB change 1. 16 Amp combain Box fitting)	MCB 3 pol - 32 Amp combain Box	02 01		Garden
10/08/21	Anatomy	Main MCB problems 25 Amp New MCB fitting	MCB - 25 A	01		Anatomy repl
11/8/21	Girls Hostel	Fan has been changed		207	✓	JK
11/8/21	Girls Hostel	Fan replaced		209		Fan
12/08/21	Staff canteen	one ceiling fan change short circuit problems	Fan	01	✓	301
12/08/21	Call Lab	steech Boxel fitting				Call Lab
13/08/21	Anatomy	one tube light Repairing Change - Roof	Tube Roof	01		Mod cellin

Date	Department	Type of working	use material	Qty	Slor	Room
14/08/24	Girls Hostel	one ceiling fan change old fan And repaired fan fittings	fan	01		09
14/08/24	PG Hostel	one Teluk. point wire 2-pin fitting	2 pin	01		514
16/08/24	Call Lab-	LCD projector New installation power point connection Mount stand fitting VGA cable fitting HD MI cable fitting	combin Box Cassing packi HDMI VGA - Wire - Red Blue Green	01 01 15 ft. 15 mft 05/ft 07 - 07 - ft.		Call Lab
17/08/24	Call Lab	one ceiling fan Repairing 2. Lights Repairing one sw Not working 0 A Legrand switch Replaced And 2 x 2. 36 - let LED light 4 no. set install	0 A. switch (old) LED	01 04		Call Lab

Date	Department	Type of work	Use material	Qty	Sl. No.	Recd
18/08/21	University	Dr. Nitin Kablam sir Cabin Ac Not working 3 model plate Cherage old plate Premier Anal Nu's Plate fitting 16 Amp switch And 16 Am switch 3 model Nu part fitting	3 model plate 16 A. switch 16 A. switch	01 01 01		Dr. Nitin Kablam sir Cabin

18/08/21	CRL	Zebra fish Lab MCB Cherage 16 A old MCB Remu Anal 25 A. MCB fitting	MCB 25 p-	01		CRL - Zebra fish Lab
----------	-----	--	-----------	----	--	----------------------------

19/08/21	Animal house	old wooden Board Removal Anal New Logrand Board fit paw paint All wire properly fitting C/Tx wire part fitting one Tubel LE \$ set Hand to properly fitting	3 model plate 6 cam su Burfa - Box	01 06 01		Animal house
----------	--------------	--	--	----------------	--	-----------------

2

19/08/24

Girls Hostel

ceiling fan
Change old
rem. And Replaced
fan fitting

fan

01

202

20/08/24

MIEU

2. 5w LED light
Change

LED lights

02 -

MIEU

20/8/24

Anatomy

New Dissection
Hook Neg
12" Arrest fan
Insul And
Connection

hi fans

02

Anatomy
Dissection
hall

21/08/24

University

MCR Taper
on

Main
Front
Passage

21/08/24

Medical College

Replaced Hook No 3
All Subby M43
at on on
Tape on

Lecture
hall
03





21/08/24

T6 Lab

Wash Room
At the corner

T6
Lab

Date	Department	Task of work	Use material	Qty	Size	Price
21/08/21	CRL	PC point combain Box fitting And wiring	Combin Box W - 2 ft	1 03 r		CRL
23/8/21	Animal House	Com-point Not working 1. Switch Change	Swit - GA -	01		Animal House
23/08/21	Anatomy	B. Axost fem fitting old fem New fem ft - other old fem replacement	Fans	03		Dissection Hall old
23/08/21	Medical College	Moultree Barometric Meashin Stand fitting	Sw -	03		Medi Crown Pia
23/08/21	Microbiology	Demo Room Switc Board Not work Cut out fuse Demo Distr - some course Panel - Anal Switc Board power on				Micro Demo Room

Date	Department	TYPE of working	Use material	Qty	Sign	Room/Arity
23/08/21	PG Hostel	givega point Re sw Change Repled to Switch	MCB 16	01		201
23/08/21	PG Hostel	2. GA. switch Change	Switch	02		403
23/08/21	Girls Hostel	old tube light pathi set Rema And LED light fitting	LED	01		06
23/08/21	Girls Hostel	one old tube light pathi set Rema And LED fitting	LED	01	D-ch My	50'
23/08/21	Girls Hostel	old tubes set R LED fitting	LED	01		212
23/08/21	Medical College	Mentree Baicm Masin Instal adu				

Date	Dept	Type of work	Material	Qty	Si-	Receiv
------	------	--------------	----------	-----	-----	--------

24/08/21	Staff Club	3. old Tube Light Parti set Remove And LED set fitting 3. Bulb fitting And All power point Connection Check	LED	03	03	205
----------	------------	--	-----	----	---------------	-----

24/08/21	Staff a	Ac point Extension 2. meta wire Xtra fitting And 3 pin Top fitting 1. Cassing capping parti fitting 16 A. SS. combin Box fitting Door Bell fitting fan capacitor change	Wire B-4, B combin Box Cassing parti capacitor	15 MF 01 01 01		104
----------	---------	---	---	-------------------------	--	-----

24/08/21	Staff a	Wall fan fitting			104	104
----------	---------	------------------	--	--	----------------	-----

24/08/21	C.R.L.	3. pin Top fitting retregulator point- Old pin Room And Am fitting	3 Pin Top 6A.	01	/	CRL Kestubal Anage
----------	--------	---	---------------	----	---	--------------------------

Date	Department	Type of working	Use material	Qty.	Size	Room / Area
25/08/21	Anatomy	Musium Demo Hall 7. ceiling fans fitting fan, Red, fan fitting Anek connection 8. 2x2 PL Light fitting. New inster LCD Projector Properly fitting to HO ME cable prope fitting	fan LED Light	07-	08-	Anatomy Demo
(Leave)						
30/08/21	Canteen	one wall fan fitting one ceiling fan fitting Air below Carleton power supply check	fan	01		Canteen
31/08/21	4th floor Exame. Hall.	18 model. Switch Box Remove 12 model Power Point switch Box. Remove 2. for some in box Rem				4th floor Exame Hall

MGM

[MGM Medical College]
Kamothe

Electrical Maintenance
Book.

Elec. Nitin Pimple: 9767114360

Carpenter. Bhawan More: 9702026757.

Mplw. Prakash Gupta: 8424970089.

2021. May. to

Shukla

Date	Department	Type of working	Use Material	Qty	Sign	Room or A-
01/06/21	Audivisual Dept.	Lectur Hall No. 3. in LCD projector Remove Handout to Audivisual. Department And Replea Lectur Hall No. 02. LCD projector	Projector	01		Lectur Hall No. 3
01/06/21	University	2. 2x2 LED panel Light Change	LED	02		Store
02/06/21	PG Hostel	Fan fitting Area	Fan	01	Prasanna	314
03/06/21	2nd floor	CCTV camera Cabling Remove for 250 meters -				2nd floor
03/06/21	PG Hostel	Celling fan change	Fan	01		416

Date Department Type of working Use material Qty. Sign Room/ Area

04/06/21 PG Hostel Hospital Bi- LED Light Chm
old pati set Remu
And LED fitting LED 01 ~~Unit~~ 420

8/6/21 PG Hostel Fan Fan 01 ~~Unit~~ 315

6/6/21 PG Hostel Fan Capacitor 01 ~~Unit~~ 308

8/6/21 PG Hostel Fan capacitor 01 ~~Unit~~ 309

10/06/21 Staff a Pichen wall fan fitting 10 ~~Unit~~ 106

11/06/21 Medical college Medical college Dens office all Electrical Point- Remu- Net cable Remu- 01 ~~Unit~~ 106

12/06/21 Micro Demu Computer power point fitting 6 pc point And 0 cap 6 Net cable fu 06 ~~Unit~~ 106

12/06/21 Micro Demu Computer power point fitting 6 pc point And 0 cap 6 Net cable fu 06 ~~Unit~~ 106

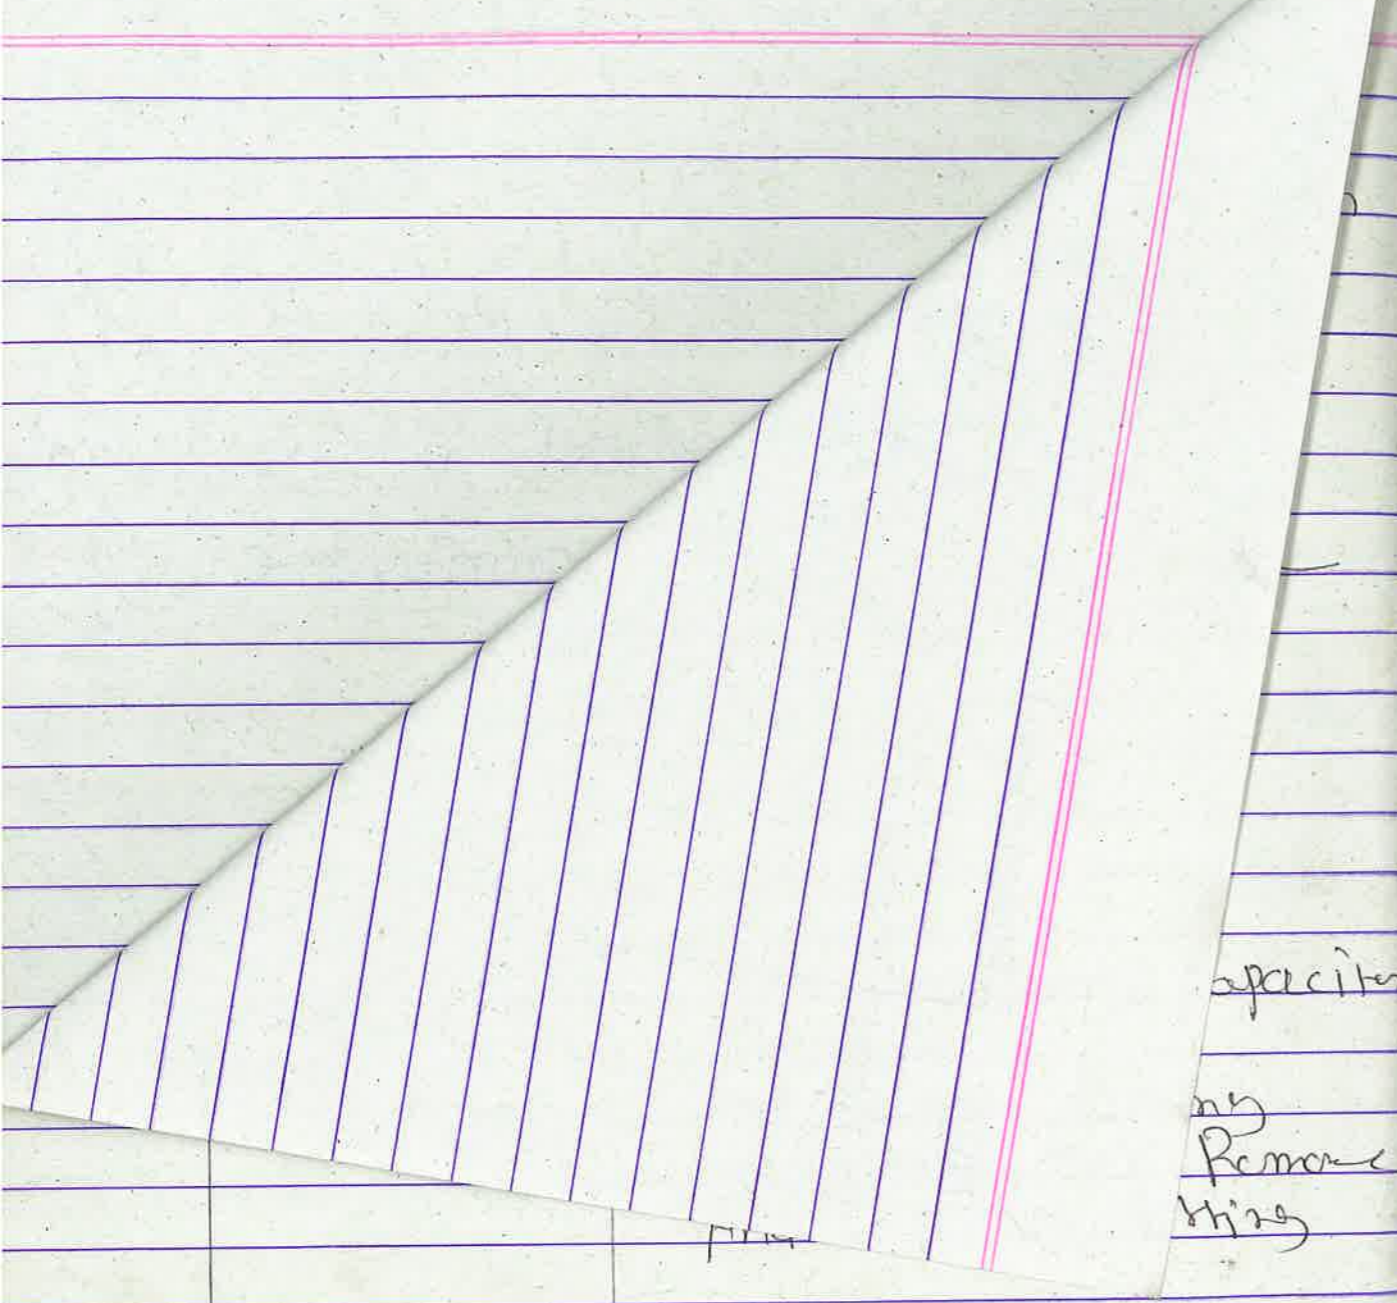
Date	Department	Type of working	use material	Qty	Site	Room No
16/06/21	Patho Demo	LED projector Remove And patho old Amesium 2. Computer point fitting				Patho museum
16/06/21	University	one ceiling fan Replaced	fan			Stone
17/06/21	PG. Hostel	Switch Board Repairing Socket change 3. Sockets.	G.A. shaker	03.		200
17/06/21	PG. Hostel	Main Board Repairing Socket change				
17/06/21	Medical college	Dem office LCD projector HDMI Cable fitting	HDMI	15 MT		Dem office Medical Room
18/06/21	Medical college	Starcoz Down side All old Electrical 20 points Remove And fire Box with				

Date	Department	Work done	Material used	Qty.	SI No.	Room
18/06/21	Boys Hostel	2. Fans changed old fan removed And repaired fan fitting	fan	02		307
19/06/21	Girls hostel	Tube light fitting old Patti set removed And New 20w LED light fitting	LED	01		302
19/06/21	Girls Hostel	Stand fan Installation		1		20G
19/06/21	Girls Hostel	Ground floor ceiling fan 1. LED light New fitting	LED	01		Ground floor within
19/06/21	Pg Hostel	main MCB changed And give supply change	MCB	01		112
21/06/21	medical cater	medical cater work room fan passes LED light change	LED	02		Ground floor Passer

Date	Department	Type of working	Use material	Qty	Size	Room no
21/06/21	Basochme	Structure mesh powers supply checking				Bedch Prob Hall
22/06/21	Medical coding	Account section one with fan removal And Micro demo Room in fitting	Local fan	01		Micro Demo
22/06/21	SBS	1. 36 wt PL. 2x2 LED Panel. Light 1 Cheng				SBS control
23/06/21	PG Hostel	Old tube light patch set removal And LED light fitting	LED	01	JY	204
23/06/21	PG Hostel	Fan fitting	Fan	01	JY	112
24/06/21	PG Hostel	LED light fittings 20wt	LED	01	JY	403
24/06/21	PG Hostel	Repaired fan fan	Fan	01	JY	203

	Department	Type of Working	Use Material	Qty	Site	Room or A-
121	Audivisual Dept.	Lector Hall No. 3. in LCD projector Remove Handout to Audivisual. Department And Replea Lector Hall No. 02. LCD Projector	Projector	01		Lector Hall No. 3 -
5/21	University	2. 2x2 LED panel Light Change	LED	02		Store
6/21	PG Hostel	Fan fitting Pneu	Fan	01	Prasanna Nagar	314
121	2nd Floor	CCTV Camera Cabling Remove for 250 meters -				2nd Floor
21	PG Hostel	Ceiling Fan Change	Fan	01		416.

Date	Department	Type of working	Use Material	Qty	Store	Room or A-
06/21	Audivisual Dept.	Lectur Hall No. 3. in LCD projector	Projector	01		Lectur Hall No. 3 -
		Remove Handout to Audivisual Department And Replea Lectur Hall No. 02. LCD Projector				
06/21	University	2. 2x2 LED panel Light Change	LED	02		Store
06/21	PG Hostel	Fan fitting Pru	Fan	01	Prasanna Nagar	314
6/21	2nd floor	CCTV camera Cabling Remove for 250 meters -				2nd floor
6/21	PG Hostel	Celling fan change	fan	01		416



Use material.	Qty	Sign-	Room-
fan	02		Omlet
fan body	02		Lab-
fan elem.	03		

capacitor	Capacitor	01	<u>Yash</u>	408
	LED	01		

ny
Remove
thing

7/10/21 Boys Hostel Switch Board Repairing
G.A. Shakti Chery

Shoket	01	<u>Pratik</u>	407
--------	----	---------------	-----

7/10/21 Boys Hostel fan Repairing
Capacitor change

Capacitor	01	<u>Pratik</u>	210
-----------	----	---------------	-----

7/10/21 Girls Hostel fan chery old
Remove And Repair

fan	01	<u>Pratik</u>	512
Body	01		

29/10/21	Biochemistry	3 Fans fitting old fans Remover And repaired fan fitting	Fan	03		Dormo Room
29/10/2021	MGM Campus Food Canteen	2 fan fitting, 2 tube fitting, 1 No. Sanderlech machine 3 pin top change & Refitting	3 pin top, 2 Fan 2 tube	07	C. Sp	Canteen/ Kitchen
29/10/21	PG-Hostel	Lights change	LED Light fitting CFL Bulb- Holder	01 01 01		410
29/10/21	PG-Hostel	Fan Repairing capacitor change Air point Repair	Capacitor	01		509
29/10/21	PG hostel	Fan Repairing capacitor change CFL Bulb change LED light change	bulb- Capacitor LED	01 01 01	J. Man	411
29/10/21	PG Hostel	Fan fitting LED fitting	fan LED	01 01		416

Date	Department	Type of working	Use material	Qty.	Sicr.	Room / Area
11/21	University	2. Fans Replaced Old fan Remove And repaired fan fitting	Fan	02	<u>25 Pak</u>	Reception Upside IT Dept.
2/11/21	Staff centers	Fan fitting			<u>306</u>	306
2/11/21	PG Hostel	Fan Repairing Capacitor change	Capacitor	01	<u>Dr. Prasen</u>	315
2/11/21	PG Hostel	Tube light change	LED	1	<u>Mr. A. Bhattach</u>	204
11/21	4th floor Examine Hall	12 Fans Remove	Fan	12	<u>Prasen</u>	4th Floor
11/21	3rd floor 308	Switch repair	Tubelight	1	<u>Prasen</u>	
11/21	Staff center	Fan fitting old Repairing And	Fan	01		305

1/11/21	PG Hostel	Tube Light Repairing	LED	0/	Shanti 11/11/2021 Tubelight repaired. Thank you.	571
1/11/21	Staff Quarters	2 New fans fitting			Nimkati	505
1/11/21	Girls Hostel	Fan Repairing Capacitor to Chen	Capacitor	04	Nisha	119
1/11/21	PG Hostel	Fan Repair - Regulator change Switch change	Regular 16 Amp Switch change	1	[Signature]	113
2/11/21	PG Hostel	Wire Repair			[Signature]	612
2/11/21	Girls Hostel	Fan fitting Dennis Day Room No 14. No fit 111 - Room in	Fan	01		111


date	Department	Type of working	use material	Qty	size	Remarks
3/14/21	Cult Lab - 2nd	New AC installation Power point fitting 25 mm PVC pipe And 2.5 wire 25 Amp MCB fitting	Incluse DP Box MCB 25 Amp Wire R Y P Cable Type scaler PVC pipe	01 02 05 ML 05 ML 05 ML 05 NO 05 - 01 NO	Judy	2nd 1st
3/14/21	PG Hostel	MCB Change Old MCB Ghore New fitting	MCB	25 Amp		40g
3/14/21	Boys hostel	- old fan Repair And repaired fan fitting	fan	01	4 1/2 ft	113
3/11/21	Boys hos	power point repair cable Box R	✓		MA	101
1.11.21	PG hostel	fan fitting repaired fan fitting old fan Repair	fan	01	fan	612


Aurangabad Campus
Electrician Maintainace Work


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 29/03/2021 to 04/04/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	30.03.2021	03.54 pm	04.15 pm		2323	Lift-06 Cilling fan not working	Time Office			Work in progress
2	30.03.2021	10.45 am	02.30 pm		3083	Switch Board not working	OT Complex	30.03.2021	02.45 pm	
3	30.03.2021	10.32 am	10.55 am		145	AC & LED Light not working	Radiology Dept	31.03.2021	02.30 pm	AC work 04.04.2021 completed.
4	30.03.2021	10.35 am	11.05 am		2326	LED Light not working	Supt.Office	30.03.2021	11.35 am	
5	30.03.2021	11.40 am	11.55 am		159	AC not working	SICU	30.03.2021	12.20 pm	
6	30.03.2021	04.25 pm	05.00 pm		2954	Wall fan not working	Old Deluxe	03.04.2021	12.45 pm	
7	30.03.2021	04.25 pm	05.20 p		2955	LED Light not working	Old Deluxe	30.03.2021	06.00 pm	
8	30.03.2021	04.00 pm	04.15 pm		626	OT Bulb not working	CATH-LAB	31.03.2021	01.20 pm	
9	30.03.2021	04.25 pm	05.00 pm		2956	Cilling Fan not working	Old Deluxe	30.03.2021	06.10 pm	
10	31.03.2021	10.10 am	10.25 am		1647	Extention board not working	CVTS	31.03.2021	10.55 am	
11	31.03.2021	10.55 am	11.15 am		2947	LED Light not working	Hemotology ICU	31.03.2021	03.30 pm	
12	31.03.2021	10.10 am	11.05 am		2505	LED Tubelight not working	CSSD	31.03.2021	11.45 am	
13	31.03.2021	03.55 pm	04.15 pm		4259	AC not working	IT Department	01.04.2021	02.30 pm	
14	31.03.2021	07.45 am	09.15 am		2327	Lift No-05 not working	Time Office	31.03.2021	11.20 am	
15	31.03.2021	10.20 am	11.00 am		627	LED Light not working	CATH-LAB	31.03.2021	11.15 am	
16	31.03.2021	10.25 am	11.20 am		3719	Extention board not working	MICU	31.03.2021	11.20 am	
17	01.04.2021	09.45 am	09.55 am		2541	Switch Board not working	NICU	01.04.2021	10.05 am	
18	01.04.2021	10.25 am	11.05 am		886	Cilling Fan not working	Central Lab.	02.04.2021	12.45 pm	
19	01.04.2021	10.45 am	11.55 am		3087	LED Tubelight not working	OT Complex	01.04.2021	12.10 pm	
20	02.04.2021	11.16 am	11.20 am		1655	LED Tubelight not working	Surjery OPD	02.04.2021	11.20 am	
21	02.04.2021	11.50 am	11.58 am		3731	Electrical problame	MICU	02.04.2021	11.58 am	
22	03.04.2021	09.45 am	11.55 am		1411	Switch Board not working	OBGY ICU	03.04.2021	01.10 pm	
23	03.04.2021	01.15 pm	02.25 pm		544	Cilling Fan not working	FMW	03.04.2021	03.10 pm	
24	03.04.2021	10.20 am	10.20 am		2946	Cilling Fan not working	ENT Ward	04.04.2021	10.20 am	
25	03.04.2021	06.00 pm	06.25 pm		2958	Wall fan not working	Old Deluxe	03.04.2021	06.25 pm	
26	03.04.2021	10.20 am	10.26 am		1982	Switch Board not working	EMS ICU	03.04.2021	10.26 am	
27	04.04.2021	03.13 pm	04.00 pm		2335	Lift No-06 Not working	Time Office	04.04.2021	04.15 pm	
Pending work										
1	09.03.2021	10.35 am	11.15 am	00.40 Hr	297	Lift-02 Fan not working	Time Office			Work in progress
2	09.03.2021	10.30 am	10.45 am	00.15 Hr	63	Water coolar not working	School Physiotherapy			Work in progress
3	10.03.2021	10.45 am	11.05 am	00.20 Hr	1213	AC Not working	Casulty			Work in progress
4	13.03.2021	12.28 pm	02.40 pm	00.30 Hr	26	Water coolar not working	Central Laibrary	02.04.2021	11.20 am	
5	17.03.2021	12.47 pm	02.40 pm	02.12 Hr	1259	Compressor Motor not working	Biomedical Dept.			Work in progress
6	16.03.2021	04.30 pm	04.45 pm	00.15 Hr	260	Water coolar not working	Physiotherapy			Work in progress
7	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress

Total Complaint	34
Pending Complaint	7
Complete Complaint	27
Complaint Precentrage	79%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 22/03/2021 to 28/03/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	22.03.2021	10.55 am	11.10 am	00.15 Hr	1391	LED Tubelight not working	Pead.OPD	22.03.2021	11.17 am	
2	22.03.2021	03.35 pm	04.15 pm	00.40 Hr	540	LED Tubelight not working	FMW	24.03.2021	05.00 pm	
3	22.03.2021	12.30 pm	12.42 pm	00.12 Hr	847	Switch Board not working	MJPJAY ward	24.03.2021	03.00 pm	
4	22.03.2021	03.20 pm	04.10 pm	00.50 Hr	867	Extention Board requirement-02	Anatomy	23.03.2021	03.45 pm	
5	22.03.2021	10.01 am	10.45 am	00.44 Hr	1644	15watt LED panel not working	CVTS	24.03.2021	01.55 pm	
6	23.03.2021	02.35 pm	03.10 pm	00.35 Hr	2826	Cilling Fan & LED Tubelight not working	Pead.ward	24.03.2021	04.05 pm	
7	23.03.2021	10.22 am	11.20 am	00.58 Hr	1644	15watt LED panel not working	Blood bank	24.03.2021	01.30 pm	
8	23.03.2021	12.35 pm	12.55 pm	00.20 Hr	820	Cat-6 Cable Requirement	IVF Dept.	24.03.2021	10.55 pm	
9	23.03.2021	10.45 am	11.10 am	00.25 Hr	3083	Switch Board not working	OT Complex	26.03.2021	04.00 pm	
10	24.03.2021	12.05 pm	12.35 pm	00.30 Hr	842	15watt LED panel not working	MCRI OPD	24.03.2021	01.10 pm	
11	24.03.2021	12.25 pm	01.05 pm	00.40 Hr	1108	LED Light not working	5th floor deluxe	26.03.2021	01.15 pm	
12	24.03.2021	10.40 am	11.05 am	00.25 Hr	2502	LED Tubelight not working	CSSD	26.03.2021	12.10 pm	
13	24.03.2021	01.15 pm	01.18 pm	00.03 Hr	3519	Electrical problame	Cardac OT	24.03.2021	01.26 pm	
14	25.03.2021	10.00 am	10.20 am	00.20 Hr	2321	Cat-6 Cable Requirement	Time Office	25.03.2021	04.10 pm	
15	25.03.2021	02.40 pm	03.10 pm	00.30 Hr	690	Switch Board not working	Linen Dept.	25.03.2021	03.25 pm	
16	25.03.2021	10.30 am	10.55 am	00.25 Hr	2219	Gizer not working	Ex.Deluxe	25.03.2021	02.47 pm	
17	25.03.2021	12.10 pm	02.30 pm	02.20 Hr	538	LED Tubelight not working	FMW	25.03.2021	05.00 pm	
18	25.03.2021	07.50 pm	08.03 pm	00.13 Hr	2324	Lift No-01 not working	Time Office	26.03.2021	01.00 pm	
19	26.03.2021	10.54 am	11.07 am	00.13 Hr	2503	LED Light not working	CSSD	26.03.2021	03.20 pm	
20	26.03.2021	11.15 am	01.00 pm	00.45 Hr	4030	Cilling Fan not working	OBGY OPD	26.03.2021	04.00 pm	
21	26.03.2021	11.15 am	12.45 pm	01.30 Hr	4031	LED Tubelight not working	OBGY OPD	26.03.2021	04.10 pm	
22	26.03.2021	12.10 pm	02.22 pm	02.12 Hr	542	Switch Board not working	FMW	26.03.2021	03.30 pm	
23	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress
24	27.03.2021	11.55 am	12.17 pm	00.22 Hr	3225	Cilling Fan & LED Tubelight not working	Pead.ward	27.03.2021	12.45 pm	
25	27.03.2021	11.00 am	02.10 pm	03.10 Hr	1935	Cilling Fan not working	Pharmacology	27.03.2021	02.35 pm	
26	27.03.2021	02.10 pm	03.35 pm	01.15 Hr	2942	Cilling Fan not working	Hemotology Dept.	27.03.2021	04.00 pm	
27	27.03.2021	05.00 pm	05.15 pm	00.15 Hr	692	Iron(press) not working	Linen Dept.	27.03.2021	05.15 pm	
28	27.03.2021	10.30 am	10.45 am	00.15 Hr	2493	Cilling Fan not working	Pead.ward	28.03.2021	04.00 pm	
29	27.03.2021	03.45 pm	03.55 pm	00.10 Hr	1974	AC not working	EMS ICU	27.03.2021	04.15 pm	
Pending work										
1	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.	23.03.2021	12.35 pm	
2	09.03.2021	10.35 am	11.15 am	00.40 Hr	297	Lift-02 Fan not working	Time Office			Work in progress
3	09.03.2021	10.30 am	10.45 am	00.15 Hr	63	Water coolar not working	School Physiotherapy			Work in progress
4	10.03.2021	10.45 am	11.05 am	00.20 Hr	1213	AC Not working	Casulty			Work in progress
5	13.03.2021	12.28 pm	02.40 pm	00.30 Hr	26	Water coolar not working	Central Laibrary			Work in progress
6	17.03.2021	12.47 pm	02.40 pm	02.12 Hr	1259	Compressor Motor not working	Biomedical Dept.			Work in progress
7	16.03.2021	04.30 pm	04.45 pm	00.15 Hr	260	Water coolar not working	Physiotherapy			Work in progress

Total Complaint	36
Pending Complaint	7
Complete Complaint	29
Complaint Precentage	81%


M. A. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 15/03/2021 to 21/03/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	15.03.2021	02.35 pm	02.55 pm		831	LED Tubelight not working	MCRI OPD	15.03.2021	03.10 pm	
2	15.03.2021	11.00 am	11.10 am		2303	Telephone cable laying work.	Time Office	15.03.2021	11.35 am	
3	15.03.2021	10.05 am	10.10 am		688	Iron(press) not working	Linen Dept.	15.03.2021	02.40 pm	
4	15.03.2021	12.35 pm	12.55 pm		1204	Wall fan not working	OBGY Ward	15.03.2021	02.35 pm	
5	15.03.2021	10.21 am	12.10 pm		1203	LED Tubelight not working	OBGY Ward	15.03.2021	03.45 pm	
6	16.03.2021	11.02 am	12.55 pm		3076	LED light not working	OT Complex	16.03.2021	02.10 pm	
7	16.03.2021	06.45 pm	06.55 pm		2307	Lift No-06 Not working	Time Office	16.03.2021	07.45 pm	
8	16.03.2021	03.37 pm	04.10 pm		4258	AC Not working	IT Department	17.03.2021	11.10 am	
9	16.03.2021	12.30 pm	02.10 pm		2304	Lift No-06 Not working	Time Office	16.03.2021	03.15 pm	
10	16.03.2021	04.30 pm	04.45 pm		260	Water coolar not working	Physiotherapy			Work in progress
11	16.03.2021	11.00 am	11.35 am		2305	Cilling Fan not working	Time Office	20.03.2021	12.30 pm	
12	17.03.2021	09.15 am	09.20 am		1747	LED Tubelight not working	M.Ortho ward	17.03.2021	09.32 am	
13	17.03.2021	10.43 am	10.43 am		2303	Wall fan not working	Time Office	17.03.2021	11.17 am	
14	17.03.2021	09.31 am	09.40 am		145	LED Tubelight not working	F.Ortho ward	17.03.2021	10.00 am	
15	17.03.2021	10.20 am	11.15 am		533	LED Tubelight not working	FMW	17.03.2021	11.55 am	
16	17.03.2021	11.38 am	11.57 am		2531	LED Tubelight not working	NICU	20.03.2021	02.30 pm	
17	17.03.2021	12.47 pm	02.40 pm		1259	Compressor Motor not working	Biomedical Dept.			Work in progress
18	17.03.2021	07.20 am	09.00 am		2310	Lift No-06 Not working	Time Office	17.03.2021	04.00 pm	
19	18.03.2021	10.35 am	10.55 am		535	X-Ray Box not working	FMW	20.03.2021	12.55 pm	
20	18.03.2021	11.03 am	04.00 pm		2313	LED Tubelight not working	Dy.Registar Office	20.03.2021	03.07 pm	
21	18.03.2021	12.35 pm	12.55 pm		146	Exhouast Fan not working	Covid Ortho ward	20.03.2021	10.05 am	
22	18.03.2021	11.25 am	01.20 pm		3706	LED Tubelight not working	MICU	20.03.2021	02.30 pm	
23	18.03.2021	11.00 am	02.55 pm		286	Cilling Fan & LED Tubelight not working	Physilogy	20.03.2021	12.40 pm	
24	18.03.2021	11.30 am	04.00 pm		2314	AC Not working	Dy.Registar Office	20.03.2021	11.31 am	
25	18.03.2021	10.05 am	12.00 pm		2501	PL Tube not working	CSSD	20.03.2021	12.49 pm	
26	19.03.2021	10.40 am	10.55 am		689	Iron(press) not working	Linen Dept.	09.03.2021	03.45 pm	
27	19.03.2021	10.14 am	12.10 pm		3081	LED Tubelight not working	OT Complex	20.03.2021	01.20 pm	
28	20.03.2021	10.49 am	11.28 am		2601	LED Light not working	Physilogy	20.03.2021	11.38 am	
29	20.03.2021	10.25 am	02.35 pm		1274	Electrical problame	Anasthesia Dept.	20.03.2021	02.42 pm	
30	20.03.2021	11.28 am	11.45 am		215	Cilling Fan & LED Tubelight not working	SS OPD	21.03.2021	11.00 am	
31	20.03.2021	11.40 am	12.10 pm		586	Cilling Fan not working	PSM Dept.	20.03.2021	12.55 pm	
32	20.03.2021	11.07 am	12.10 pm		538	LED Tubelight not working	FMW	21.03.2021	04.05 pm	
33	21.03.2021	11.35 am	12.20 pm		2941	Cilling Fan & LED Tubelight not working	Hemotology Dept.	21.03.2021	01.10 pm	
34	21.03.2021	12.00 pm	12.15 pm		2318	Lift No-06 Not working	Time Office	21.03.2021	02.45 pm	
35	21.03.2021	10.15 am	11.10 am		2317	Lift no-02 Not working	Time Office	21.03.2021	03.10 pm	
Pending work										
1	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.			Work in progress
2	09.03.2021	10.35 am	11.15 am		297	Lift-02 not working	Time Office			Work in progress
3	09.03.2021	10.30 am	10.45 am		63	Water coolar not working	School Phytherapy			Work in progress
4	10.03.2021	10.45 am	11.05 am		1213	AC Not working	Casulty			Work in progress

5	13.03.2021	03.45 pm	04.15 pm		2302	Lift No-06 Not working	Time Office	16.03.2021	02.10 pm	
6	13.03.2021	12.28 pm	02.40 pm		26	Water coolar not working	Central Laibrary			Work in progress

Total Complaint	41
Pending Complaint	7
Complete Complaint	34
Complaint Precentage	83%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 09/03/2021 to 14/03/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	09.03.2021	11.10 am	02.10 pm		3060	LED Tubelight not working	OT Complex	09.03.2021	04.30 pm	
2	09.03.2021	10.35 am	11.15 am		297	Lift-02 not working	Time Office			Work in progress
3	09.03.2021	10.30 am	10.45 am		63	Water coolar not working	School Phytherapy			Work in progress
4	09.03.2021	10.46 am	10.55 am		584	Switch Board not working	PSM Dept.	09.03.2021	11.30 am	
5	09.03.2021	01.35 pm	02.10 pm		2236	Switch Board not working	Nephrology ward	09.03.2021	02.15 pm	
6	09.03.2021	10.23 am	10.45 am		393	Switch Board not working	MICU	09.03.2021	03.00 pm	
7	09.03.2021	12.30 pm	12.45 pm		3934	Gizer not working	ENT Opthal	09.03.2021	03.10 pm	
8	09.03.2021	11.20 am	12.10 pm		2699	LED Tubelight not working	CSSD	09.03.2021	04.30 pm	
9	09.03.2021	11.51 am	12.15 pm		1963	Refregator not working	EMS ICU	09.03.2021	12.47 pm	
10	09.03.2021	06.00 pm	06.20 pm		1640	AC Not working	Blood bank	10.03.2021	09.48 am	
11	09.03.2021	12.10 pm	02.30 pm		3934	Gizer not working	ENT+Opthal	10.03.2021	11.55 am	
12	10.03.2021	10.45 am	11.05 am		1213	AC Not working	Casulty			Work in progress
13	10.03.2021	11.01 am	03.15 pm		299	LED Light not working	Time Office	11.03.2021	04.10 pm	
14	10.03.2021	01.20 pm	01.40 pm		213	Cilling Fan not working	RTPCR	10.03.2021	03.00 pm	
15	11.03.2021	10.55 am	11.10 am		1199	Switch Board not working	OBGY Ward	11.03.2021	11.55 am	
16	11.03.2021	11.25 am	11.31 am		2214	LED Light not working	Ex.Deluxe	11.03.2021	04.10 pm	
17	11.03.2021	04.45 pm	04.55 pm		613	AC Not working	SICU	12.03.2021	09.45 am	
18	12.03.2021	02.14 pm	02.40 pm		625	CFL Bulb not working	CATH-LAB	12.03.2021	02.40 pm	
19	12.03.2021	10.58 am	04.45 pm		152	Switch Board not working	RGJY ICU	13.03.2021	12.22 pm	
20	12.03.2021	10.22 am	11.10 am		2240	Electrical problame	STP/ETP	12.03.2021	11.55 am	
21	13.03.2021	10.30 am	10.45 am		3123	Exhouast Fan not working	New Deluxe	13.03.2021	11.15 am	
22	13.03.2021	03.45 pm	04.15 pm		2302	Lift No-06 Not working	Time Office			Work in progress
23	13.03.2021	12.28 pm	02.40 pm		26	Water coolar not working	Central Laibrary			Work in progress
24	14.03.2021	11.30 am	11.55 am		1889	LED Light not working	Urology Dept.	14.03.2021	02.10 pm	
25	14.03.2021	10.00 am	10.15 am		3478	Cilling Fan Checking	MMW	14.03.2021	02.30 pm	
26	14.03.2021	10.00 am	10.15 am		531	Cilling Fan Checking	FMW	14.03.2021	02.45 pm	
Pending work										
	08.02.2021	12.00 pm	12.30 pm	00.30 Hr	267	IHP Motor not working	Time Office	13.03.2021	12.20 pm	
	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.			Work in progress

Total Complaint	28
Pending Complaint	6
Complete Complaint	22
Complaint Precentage	79%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 22/02/2021 to 28/02/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	22.02.2021	11.00 am	11.15 am		2412	Switch Board not working	Kt ICU	22.02.2021	11.25 am	
2	22.02.2021	12.00 pm	12.15 pm		1784	LED Tubelight not working	Central store	22.02.2021	03.10 pm	
3	22.02.2021	04.15 pm	04.30 pm		1636	Gizer not working	CCU	23.02.2021	02.42 pm	
4	23.02.2021	04.31 pm	04.25 pm		810	Switch Board not working	2D Eco Dept.	23.02.2021	04.44 pm	
5	23.02.2021	01.00 pm	01.15 pm		3046	Cilling Fan not working	OT Complex	24.02.2021	02.30 pm	
6	24.02.2021	10.05 am	10.15 am		211	LED Tubelight not working	SS OPD	24.02.2021	10.30 pm	
7	24.02.2021	11.10 am	12.30 pm		2939	Gizer not working	Hemotology Dept.	24.02.2021	12.37 pm	
8	24.12.2021	01.12 pm	02.30 pm		125	LED light not working	Radiology Dept	25.02.2021	04.20 pm	
9	24.12.2021	12.17 pm	12.45 pm		1229	Air Conditioner not working	MET Cell	24.02.2021	02.45 pm	
10	24.02.2021	11.15 am	11.40 am		613	AC Vent not working	SICU			Work in progress
11	24.02.2021	09.30 am	10.45 am		21	LED Tubelight not working	Central Laibrary	24.02.2021	02.50 pm	
12	24.02.2021	04.05 pm	04.15 pm		817	LED Tubelight not working	MCRI OPD	24.02.2021	04.30 pm	
13	25.02.2021	02.35 pm	02.55 pm		1851	Electrical problame	Super Deluxe	25.02.2021	03.00 pm	
14	25.02.2021	09.20 am	09.40 am		22	Electrical problame	Central Laibrary	25.02.2021	11.30 am	
15	25.02.2021	12.14 am	12.20 pm		1638	Electrical problame	Blood bank	25.02.2021	01.20 pm	
16	25.01.2021	11.19 am	12.15 pm		2218	LED light not working	EICU	25.02.2021	02.55 pm	
17	26.02.2021	09.25 am	10.00 am		1641	X-Ray Box not working	Surjery OPD	26.02.2021	10.45 am	
18	26.02.2021	11.00 am	11.20 am		133	LED Tubelight not working	F.Ortho ward	26.02.2021	11.55 am	
19	26.02.2021	03.45 pm	04.10 pm		1639	Refregator not working	Blood bank	27.02.2021	11.35 am	
20	26.02.2021	01.40 pm	02.00 pm		2202	LED light not working	Ex.Deluxe	26.02.2021	02.30 pm	
21	26.02.2021	01.35 pm	02.10 pm		2203	Gizer not working	Ex.Deluxe	26.02.2021	02.40 pm	
22	27.02.2021	09.25 am	10.00 am		289	Extention board not working	PSM Dept.	27.02.2021	10.45 am	
23	27.02.2021	09.55 am	12.15 pm		3053	Switch Board not working	OT Complex	27.02.2021	02.10 pm	
24	27.02.2021	03.27 pm	03.55 pm		2949	Cilling Fan not working	Old Deluxe	27.02.2021	04.15 pm	
25	27.02.2021	03.27 pm	04.15 pm		2948	LED light not working	Old Deluxe	27.02.2021	05.00 pm	
26	27.02.2021	02.30 pm	02.55 pm		621	LED light not working	CATH-LAB	01.03.2021	11.30 am	
27	27.02.2021	09.30 am	09.45 am		291	Water filter not working	Time Office	27.02.2021	12.10 pm	
28	27.02.2021	11.35 am	11.55 am		292	Electrical problame	Time Office	27.02.2020	11.55 am	
29	28.02.2021	09.15 am	10.10 am		letter	Electrical problame	CVTS	28.02.2021	10.45 am	
Pending work										
1	08.02.2021	12.00 pm	12.30 pm	00.30 Hr	267	IHP Motor not working	Time Office			Work in progress
2	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.			Work in progress
3	13.02.2021	11.57 am	12.08 pm	00.11 Hr	1636	AC Not Working	Blood bank			Work in progress

Total Complaint	32
Pending Complaint	4
Complete Complaint	28
Complaint Precentage	88%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 01/03/2021 to 07/03/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	13.02.2021	11.57 am	12.08 pm	00.11 Hr	1636	AC Not Working	Blood bank	02.03.2021	10.40 am	
2	24.02.2021	11.15 am	11.40 am	00.25 Hr	613	AC Vent not working	SICU	01.03.2021	02.20 pm	
3	01.03.2021	10.20 am	10.40 am	00.20 Hr	148	LED Bulb not working	RGJY ICU	01.03.2021	11.05 am	
4	01.03.2021	03.30 pm	03.45 pm	00.15 Hr	290	Lift not working-05	Time Office	01.03.2021	04.15 pm	
5	02.03.2021	12.40 pm	03.00 pm	02.20 Hr	1639	LED Light not working 15watt	CCU	02.03.2021	03.40 pm	
6	02.03.2021	12.41 pm	12.41 pm	00.00 Hr	3120	X-Ray Box not working	New Deluxe	03.03.2021	02.47 pm	
7	03.03.2021	03.28 pm	04.10 pm	00.42 Hr	1934	AC not working	Pharmacology	04.03.2021	10.35 am	
8	03.03.2021	10.05 am	10.35 am	00.30 Hr	289	Lift not working-05	Time Office	03.03.2021	02.10 pm	
9	03.03.2021	10.00 am	11.05 am	01.05 Hr	718	Wire laying work	Microbiology	03.03.2021	11.30 am	
10	04.03.2021	12.00 pm	12.30 pm	00.30 Hr	293	LED Light not working 15watt	Time Office	04.03.2021	12.45 pm	
11	05.03.2021	09.50 am	09.55 am	00.05 Hr	1880	LED Bulb not working	Plastik Dept.	05.03.2021	04.10 pm	
12	05.03.2021	02.15 pm	04.10 pm	01.55 Hr	294	Lift not working-02	Time Office	06.03.2021	09.30 am	
13	05.03.2021	10.55 am	11.00 am	00.05 Hr	3933	LED Light not working 15watt	Covid opd	05.03.2021	11.05 am	
14	06.03.2021	10.15 am	11.25 am	01.10 Hr	295	LED light & cilling Fan not working	Time Office	08.03.2021	02.40 pm	
15	06.03.2021	10.45 am	11.30 am	00.45 Hr	2197	Switch Board not working	OBGY ICU	08.03.2021	03.50 pm	
16	06.03.2021	03.00 pm	03.15 pm	00.15 Hr	1208	Switch Board not working	Casulty	08.03.2021	02.15 pm	
17	06.03.2021	04.35 pm	04.55 pm	00.20 Hr	2112	LED Tubelight not working	OPD Complex	08.03.2021	03.15 pm	
18	06.03.2021	12.15 pm	02.05 pm	01.50 Hr	1207	X-Ray Box not working	Casulty	06.03.2021	02.45 pm	
19	06.03.2021	04.08 pm	04.20 pm	00.12 Hr	2406	Switch Board not working	Reacarch lab	06.03.2021	04.20 pm	
20	08.03.2021	10.00 am	10.45 am	00.45 Hr	827	LED Tubelight not working	MCRI OPD	08.03.2021	11.06 am	
21	08.03.2021	09.05 am	10.15 am	01.10 Hr	1212	LED Light not working 15watt	Casulty	08.03.2021	02.43 am	
22	08.03.2021	03.25 pm	04.10 pm	00.45 Hr	439	Earthing Problame	Ortho OPD	08.03.2021	04.10 pm	
Pending work										
1	08.02.2021	12.00 pm	12.30 pm	00.30 Hr	267	IHP Motor not working	Time Office			Work in progress
2	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.			Work in progress

Total Complaint	24
Pending Complaint	2
Complete Complaint	22
Complaint Precentage	92%


M. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad


Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 15/02/2021 to 21/02/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	15.02.2021	12.10 pm	02.40 pm	02.30 Hr	728	Refregator not working	Central Lab.	20.02.2021	12.15 pm	
2	15.02.2021	10.45 am	11.15 am	00.30 Hr	3031	AC Clining Work	OT Complex	15.02.2021	04.55 pm	
3	15.02.2021	04.00 pm	05.05 pm	01.05 Hr	102	Switch Board not working	Inst.of Physiotherapy	17.02.2021	04.20 pm	
4	15.02.2021	10.20 am	10.45 am	00.25 Hr	277	Lift not working-02	Time Office	21.02.2021	04.00 pm	
5	16.02.2021	11.10 am	11.15 am	00.05 Hr	808	Electrical problame	MCRI OPD-10	16.02.2021	11.15 am	
6	16.02.2021	12.30 pm	12.30 pm	00.00 Hr	1738	Tharmameter not working	Male Ortho ward	16.02.2021	12.30 pm	
7	16.02.2021	10.25 am	11.15 am	00.50 Hr	1468	Exhouast Fan not working	MJPJAY ward	16.02.2021	02.40 pm	
8	16.02.2021	12.50 pm	04.10 pm	03.20 Hr	2192	AC Remote not working	OBGY ICU	17.02.2021	02.50 pm	
9	16.02.2021	09.45 am	10.20 am	00.35 Hr	3931	LED Bulb not working	ENT Countar	16.02.2021	10.25 am	
10	16.02.2021	11.25 am	12.45 pm	01.20 Hr	809	Exention Board not working	MCRI OPD-10	16.02.2021	02.05 pm	
11	16.02.2021	10.58 am	11.45 am	00.47 Hr	2692	Switch Board not working	CSSD	16.02.2021	02.00 pm	
12	16.02.2021	10.45 am	03.00 pm	04.15 Hr	3035	LED Tubelight not working	OT Complex	16.02.2021	03.30 pm	
13	16.02.2021	10.40 am	12.10 pm	01.30 Hr	3467	Switch Board not working	MMW	16.02.2021	01.00 pm	
14	17.02.2021	12.20 pm	01.00 pm	00.40 Hr	2196	Switch Board not working	Executive Deluxe	17.02.2021	01.30 pm	
15	17.02.2021	03.45 pm	03.45 pm	00.00 Hr	1634	Cilling Fan & LED Tubelight not working	CCU	20.02.2021	03.29 pm	
16	17.02.2021	02.15 pm	02.15 pm	00.00 Hr	61	New Switch board fitting	SOP	17.02.2021	02.15 pm	
17	18.02.2021	02.55 pm	03.15 pm	00.20 Hr	3513	Switch Board not working	Cardac OT	18.02.2021	05.35 pm	
18	18.02.2021	10.30 am	11.55 am	01.25 Hr	3039	LED Bulb not working	OT Complex	20.02.2021	02.05 pm	
19	20.02.2021	09.15 am	10.20 am	01.05 Hr	1652	LED Tubelight not working	Surjery OPD	20.02.2021	10.55 pm	
20	20.02.2021	11.35 am	11.55 am	00.20 Hr	1843	LED light not working	Super Deluxe	20.02.2021	12.45 pm	
21	20.02.2021	12.45 pm	02.05 pm	01.20 Hr	1532	LED Bulb not working	Matron Office	20.02.2021	02.55 pm	
22	20.02.2021	12.53 pm	02.05 pm	01.12 Hr	809	LED light not working	2D Eco Dept.	21.02.2021	03.20 pm	
23	20.02.2021	04.45 pm	05.00 pm	00.15 Hr	132	Pedstrol Fan not working	Female Ortho Ward	21.02.2021	04.45 pm	
Pending work										
1	23.01.2021	12.08 pm	12.45 pm	00.37 Hr	1632	Deep Fridge not working	Blood bank	16.02.2021	12.55 pm	
2	05.02.2021	02.18 pm	04.10 pm	01.52 Hr	2186	Refregetor not working	Ex.Deluxe	16.02.2021	04.00 pm	
3	08.02.2021	12.00 pm	12.30 pm	00.30 Hr	267	IHP Motor not working	Time Office			Work in progress
4	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical Dept.			Work in progress
5	13.02.2021	11.57 am	12.08 pm	00.11 Hr	1636	AC Not Working	Blood bank			Work in progress

Total Complaint	28
Pending Complaint	3
Complete Complaint	25
Complaint Precentage	89%


Mr. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 08/02/2021 to 14/02/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	08.02.2021	02.24 pm	03.00 pm	00.36 Hr	2815	LED Tubelight not working	Pead.ward	08.02.2021	03.30 pm	
2	08.02.2021	12.00 pm	12.30 pm	00.30 Hr	267	1HP Motor not working	Time Office			Work in progress
3	08.02.2021	11.15 am	12.00 pm	00.45 Hr	3465	Switch Board not working	MMW	09.02.2021	12.35 pm	
4	08.02.2021	10.34 am	11.00 am	00.26 Hr	1255	Central Air system not working	Biomedical-Dept.			Work in progress
5	08.02.2021	04.30 pm	04.45 pm	00.15 Hr	1833	X-Ray Box not working	Super Deluxe	10.02.2021	12.45 pm	
6	08.02.2021	09.00 am	09.30 am	00.30 Hr	3015	AC not working	OT Complex	08.02.2021	09.45 am	
7	08.02.2021	11.38 am	12.15 pm	00.37 Hr	1734	Fridge not working	Ortho Male Ward	08.02.2021	04.20 pm	
8	08.02.2021	02.30 pm	03.00 pm	00.30 Hr	616	LED light not working	CATH-LAB	10.02.2021	12.45 pm	
9	08.02.2021	11.50 am	12.00 pm	00.10 Hr	2410	Thrmometer not working	Kt ICU	08.02.2021	12.10 pm	
10	09.02.2021	12.15 pm	12.35 pm	00.20 Hr	1533	X-Ray Box not working	Medicin OPD	09.02.2021	01.00 pm	
11	09.02.2021	10.45 am	11.05 am	00.20 Hr	Elect.work	AHU Motor serviing work	CATH-LAB	09.02.2021	04.00 pm	
12	09.02.2021	02.30 pm	03.30 pm	01.00 Hr	1783	LED Tubelight not working	Central store	09.02.2021	03.40 pm	
13	09.02.2021	11.10 am	12.35 pm	01.25 Hr	1635	LED light not working	Blood bank	09.02.2021	03.00 pm	
14	09.02.2021	09.15 am	10.30 am	01.15 Hr	2210	LED Bulb not working	EICU	09.02.2021	10.45 am	
15	09.02.2021	12.20 pm	02.10 pm	01.50 Hr	618	AC Not working (Post.Opp.)	CATH-LAB	10.02.2021	02.00 pm	
16	09.02.2021	10.10 am	10.45 am	00.35 Hr	269	Water filter not working	7th Floor ICU	09.02.2021	11.55 am	
17	09.02.2021	02.33 pm	03.10 pm	00.37 Hr	3111	Switch Board not working	5th floor deluxe	09.02.2021	03.15 pm	
18	09.02.2021	10.45 am	12.10 pm	00.25 Hr	270	Water filter not working	6th Floor	09.02.2021	12.55 pm	
19	09.02.2021	09.30 am	11.20 am	01.50 Hr	268	Water filter not working	6th Floor	09.02.2021	12.55 pm	
20	10.02.2021	09.30 am	09.40 am	00.10 Hr	3020	LED Tubelight not working	OT Complex	10.02.2021	10.30 am	
21	10.02.2021	11.15 am	12.50 pm	01.35 Hr	801	Water filter not working	MCRI OPD	10.02.2021	02.30 pm	
22	10.02.2021	09.00 am	09.30 am	00.30 Hr	Elect.work	5HP Motor Instal	AC Plant	10.02.2021	04.45 pm	
23	11.02.2021	11.30 am	12.15 pm	00.45 Hr	272	Lift not working-06	Time Office	11.02.2021*	01.00 pm	
24	11.02.2021	12.25 pm	12.55 pm	00.30 Hr	19	Water filter not working	Central Laibrary	11.02.2021	04.10 pm	
25	11.02.2021	03.50 pm	04.00 pm	00.10 Hr	2163	Cilling Fan not working	Ex.Deluxe	11.02.2021	04.10 pm	
26	11.02.2021	03.51 pm	04.20 pm	00.29 Hr	4257	AC Not working	IT Department	12.02.2021	10.45 am	
27	11.02.2021	01.20 pm	02.20 pm	01.00 Hr	580	Water filter not working	FMT Dept.	11.02.2021	03.00 pm	
28	12.02.2021	02.15 pm	03.40 pm	01.25 Hr	2701	Thrmometer not working	Day-Care Unit	13.02.2021	01.50 pm	
29	12.02.2021	10.30 am	11.00 am	00.30 Hr	288	LED Tubelight not working	PSM Dept.	12.02.2021	11.54 am	
30	12.02.2021	11.50 am	12.15 pm	00.25 Hr	274	Switch Board not working	Time Office	12.02.2021	01.30 pm	
31	12.02.2021	10.20 am	11.55 am	01.35 Hr	438	Cilling Fan not working	Ortho OPD	15.02.2021	03.40 pm	
32	12.02.2021	12.15 pm	04.30 pm	04.15 Hr	1800	Exouast fan not working	Labour Room	15.02.2021	11.20 am	
33	12.02.2021	12.10 pm	12.30 pm	00.20 Hr	1101	LED Bulb not working	Labour Room	12.02.2021	01.00 pm	
34	12.02.2021	10.07 am	11.22 am	01.15 Hr	1464	Cilling Fan not working	MJPJAY ward	12.02.2021	11.55 am	
35	12.02.2021	11.20 am	02.20 pm	03.00 Hr	1736	LED Tubelight not working	Male Ortho ward	12.02.2021	03.30 pm	
36	13.02.2021	09.50 am	10.15 am	00.25 Hr	1857	Switch Board not working	Urology Dept.	13.02.2021	11.25 am	
37	13.02.2021	11.57 am	12.08 pm	00.11 Hr	1636	AC Not Working	Blood bank			Work in progress
38	13.02.2021	10.10 am	12.20 pm	02.10 Hr	1952	LED Tubelight not working	EMS ICU	13.02.2021	02.00 pm	

39	14.02.2021	02.20 pm	03.10 pm	00.50 Hr	675	Cilling Fan not working	FSW	14.02.2021	04.20 pm	
40	14.02.2021	03.45 pm	04.55 pm	01.10 Hr	276	Lift not Working-05	Time Office	14.02.2021	04.55 pm	
Pending work										
1	23.01.2021	12.08 pm	12.45 pm	00.37 Hr	1632	Deep Fridge not working	Blood bank			Work in progress
2	05.02.2021	02.18 pm	04.10 pm	01.52 Hr	2186	Refregetor not working	Ex.Deluxe			Work in progress

Total Complaint	42
Pending Complaint	5
Complete Complaint	37
Complaint Precentage	88%


M. S. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 01/02/2021 to 07/02/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	01.02.2021	09.45 am	10.00 am	00.15 Hr	3461	LED Tubelight not working	MMW	01.02.2021	10.20 am	
2	02.02.2021	10.00 am	11.30 am	01.30 Hr	1088	LED Tubelight not working	Casulty	02.02.2021	03.05 pm	
3	02.02.2021	11.20 am	11.20 am	00.00 Hr	3892	LED light not working	SICU	03.02.2021	11.20 am	
4	03.02.2021	10.15 am	10.30 am	00.15 Hr	1254	LED Tubelight not working	Central comp.Room	03.02.2021	11.00 am	
5	03.02.2021	11.27 am	12.15 pm	00.48 Hr	3505	LED Tubelight not working	Record Section	03.02.2021	12.37 pm	
6	03.02.2021	11.31 am	01.40 pm	02.09 Hr	1281	Switch Board not working	Dialysis	03.02.2021	02.15 pm	
7	03.02.2021	10.55 am	11.00 am	00.05 Hr	1814	Wall fan not working	Covid-19 OPD	06.02.2021	10.15 am	
8	03.02.2021	11.00 am	11.30 am	00.30 Hr	3001	LED Tubelight not working	OT Complex	03.02.2021	03.50 pm	
9	03.02.2021	11.21 am	12.35 pm	01.14 Hr	3002	LED Tubelight not working	OT Complex	03.02.2021	03.50 pm	
10	03.02.2021	12.49 pm	02.35 pm	01.45 Hr	2184	LED light not working	OBGY ICU	03.02.2021	04.10 pm	
11	03.02.2021	05.45 pm	05.50 pm	00.05 Hr	34	Fan Regulator not working	Endoscopy	03.02.2021	05.50 pm	
12	04.02.2021	02.45 pm	03.00 pm	00.15 Hr	2940	LED light not working	Old Deluxe	03.02.2021	03.40 pm	
13	05.02.2021	10.15 am	10.55 am	00.40 Hr	1817	LED Tubelight not working	Covid-19 OPD	05.02.2021	11.15 am	
14	05.02.2021	02.18 pm	04.10 pm	01.52 Hr	2186	Refrigeior not working	Ex.Deluxe			Work in progress
15	05.02.2021	10.18 am	10.30 am	00.12 Hr	1816	LED Tubelight not working	Psy.OPD	05.02.2021	10.30 am	
16	05.02.2021	10.20 am	10.55 am	00.35 Hr	2234	Switch Board not working	Nephrology ward	05.02.2021	11.30 am	
17	05.02.2021	11.50 am	12.03 pm	00.13 Hr	261	Switch Board not working	Nephrology dept.	05.02.2021	12.03 pm	
18	05.02.2021	11.03 am	12.45 am	01.42 Hr	2233	Switch Board not working	Nephrology ward	05.02.2021	03.15 pm	
19	06.02.2021	12.30 pm	12.30 pm	00.00 Hr	3109	X-Ray Box not working	Deluxe 5th floor	06.02.2021	12.30 pm	
20	06.02.2021	10.20 am	11.00 am	00.40 Hr	256	Water filter not working	Phytherapy OPD	06.02.2021	02.00 pm	
21	06.02.2021	12.29 pm	12.55 pm	00.26 Hr	1855	Cilling Fan not working	Urology Dept.	06.02.2021	03.10 pm	
22	06.02.2021	02.45 pm	03.10 pm	00.25 Hr	265	Lift no-02 Not working	Time Office	06.02.2021	02.45 pm	
Pending work										
1	23.01.2021	12.08 pm	12.45 pm	00.37 Hr	1632	Deep Fridge not working	Blood bank			Work in progress
2	27.01.2021	06.04 pm	06.10 pm	00.06 Hr	259	Lift no-02 Not working	Time Office	06.02.2021	02.45 pm	

Total Complaint	24
Pending Complaint	2
Complete Complaint	22
Complaint Precentage	92%


M. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 25/01/2021 to 31/01/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	23.01.2021	10.20 am	11.05 am	00.45 Hr	1087	Casset AC Not working	Casulty	23.01.2021	11.55 pm	
2	25.01.2021	03.08 pm	04.35 pm	01.27 Hr	1274	LED Tubelight not working	Dialysis	27.01.2021	11.20 am	
3	25.01.2021	03.08 pm	04.00 pm	00.52 Hr	1275	Switch Board not working	Dialysis	26.01.2021	10.30 pm	
4	25.01.2021	09.45 am	10.00 am	00.15 Hr	1390	AC not working	OT Complex	25.01.2021	04.00 pm	
5	25.01.2021	02.40 pm	03.20 pm	00.40 Hr	4254	LED Panel 15watt not working	Dyotan Hall	30.01.2021	10.45 am	
6	25.01.2021	03.15 pm	04.00 pm	00.45 Hr	29520	Pendant Switch not working	MCRI ICU	30.01.2021	01.30 pm	
7	27.01.2021	06.04 pm	06.10 pm	00.06 Hr	259	Lift no-02 Not working	Time Office			Work in progress
8	28.01.2021	04.27 pm	05.30 pm	01.03 Hr	1277	Switch Board not working	Dialysis	29.01.2021	02.30 pm	
9	28.01.2021	10.30 am	11.20 am	00.50 Hr	1850	Cilling Fan & LED Tubelight not working	Urology Dept.	28.1.2021	02.20 pm	
10	28.01.2021	10.00 am	10.30 am	00.30 Hr	117	Casset AC Not working	Radiology Dept	28.01.2021	12.50 pm	
11	29.01.2021	11.35 am	11.55 am	00.20 Hr	4398	LED Tubelight not working	OBY Ward	30.01.2021	12.45 am	
12	29.01.2021	12.41 pm	03.10 pm	02.19 Hr	1454	Cilling Fan & LED Tubelight not working	MJPJAY ward	30.01.2021	12.45 pm	
13	29.01.2021	11.30 am	11.55 am	00.25 Hr	4394	Exouast fan not working	OBY Ward	30.01.2021	03.32 pm	
14	29.01.2021	03.40 pm	03.55 pm	00.15 Hr	118	Split AC not working	Radiology Dept	29.01.2021	04.05 pm	
15	30.01.2021	09.20 am	10.20 am	01.00 Hr	1456	LED Tubelight not working	MJPJAY ward	30.01.2021	12.15 pm	
16	30.01.2021	10.22 am	03.30 pm	01.08 Hr	3450	LED Tubelight not working	MMW	30.01.2021	03.40 pm	
17	30.01.2021	10.21 am	03.30 pm	05.09 Hr	3460	Switch Board not working	MMW	30.01.2021	03.40 pm	
18	30.01.2021	10.25 am	11.05 am	00.40 Hr	370	Switch Board not working	MICU	30.01.2021	04.05 pm	
19	30.01.2021	04.15 pm	04.25 pm	00.10 Hr	1392	LED Panel 15watt not working	OT Complex	30.01.2021	05.00 pm	
20	30.01.2021	10.25 am	12.05 pm	01.40 Hr	369	LED Tubelight not working	MICU	30.01.2021	04.10 pm	
Pending work										
1	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area	30.01.2021	04.10 pm	
2	21.01.2021	12.35 pm	12.55 pm	00.20 Hr	704	Refegator Compressor not working	Microbiology	29.01.2021	01.10 pm	
3	23.01.2021	12.08 pm	12.45 pm	00.37 Hr	1632	Deep Fridge not working	Blood bank			Work in progress

Total Complaint	23
Pending Complaint	2
Complete Complaint	21
Complaint Precentage	91%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 18/01/2021 to 24/01/2021

Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	18.01.2021	11.55 am	12.05 pm	00.10 Hr	2222	LED Light,Extencion board & Cilling fan not working	COVID 19 OPD	18.01.2021	12.30 pm	
2	18.01.2021	11.15 am	11.45 am	00.30 Hr	1377	AC Duct Cleaning work	OT-10	18.01.2021	04.10 pm	
3	18.01.2021	11.21 am	11.31 am	00.10 Hr	2176	LED Tube not working	OBGY ICU	18.01.2021	11.35 am	
4	18.01.2021	09.58 am	10.10 am	00.12 Hr	1078	LED light not working	Casulty	18.01.2021	12.10 pm	
5	18.01.2021	02.45 pm	03.00 pm	00.15 Hr	2225	Switch Board not working	COVID 19 OPD	18.01.2021	03.25 pm	
6	19.01.2021	10.15 am	10.40 am	00.25 Hr	1650	Tubelight & Cilling Fan not working	Surjery OPD	19.01.2021	12.00 pm	
7	19.01.2021	11.50 am	12.00 pm	00.10 Hr	2283	LED Tubelight not working	Ophthal OPD	19.01.2021	12.50 pm	
8	19.01.2021	04.15 pm	05.00 pm	00.45 Hr	2936	Refregator not working	Old Deluxe	23.01.2021	02.16 pm	
9	19.01.2021	01.07 pm	02.00 pm	00.53 Hr	1698	C.Fan Regulator & LED Tubelight not working	5th floor deluxe	19.01.2021	04.00 pm	
10	19.01.2021	03.41 pm	04.20 pm	00.39 Hr	1629	Switch Board not working	Blood bank	19.01.2021	04.25 pm	
11	19.01.2021	04.27 pm	04.31 pm	00.04 Hr	255	Lift No-05 not working	Time Office	19.01.2021	04.53 pm	
12	19.01.2021	09.39 am	11.40 am	01.01 Hr	2073	LED 15 watt fitting working	CVTS	21.01.2021	11.43 am	
13	20.01.2021	10.14 am	10.45 am	00.31 Hr	2229	LED light not working	COVID 19 OPD	20.01.2021	12.30 pm	
14	20.01.2021	01.29 pm	02.45 pm	01.16 Hr	7943	LED light not working	Salt Canteen	20.01.2021	02.55 pm	
15	20.01.2021	10.32 am	12.00 pm	01.28 Hr	3102	LED light not working	5th floor deluxe	20.01.2021	12.45 pm	
16	20.01.2021	02.55 pm	03.00 pm	00.05 Hr	1269	Switch Board not working	Dialysis	20.01.2021	03.13 pm	
17	20.01.2021	10.11 am	02.10 pm	03.59 Hr	664	Switch Board not working	FSW	20.01.2021	03.45 pm	
18	20.01.2021	03.50 pm	04.00 pm	00.10 Hr	1846	Cilling fan & Switch Bord not working	Urology Dept.	20.01.2021	04.20 pm	
19	21.01.2021	10.35 am	11.10 am	00.35 Hr	1381	AC not working	OT Complex	21.01.2021	11.01 am	
20	21.01.2021	12.35 pm	12.55 pm	00.20 Hr	704	Refegator Compressor not working	Microbiology			Work in progress
21	21.01.2020	12.50 pm	01.10 pm	00.20 Hr	3929	Split AC not working	ISO ICU	21.01.2021	03.10 pm	
22	21.01.2021	09.40 am	10.10 am	00.30 Hr	703	Refregator & Split AC not working	Microbiology	21.01.2021	09.50 am	
23	21.01.2021	10.18 am	11.10 am	00.52 Hr	1630	Mitsubishi AC not working	Blood bank	21.01.2021	03.20 pm	
24	21.01.2021	09.40 am	10.15 am	00.35 Hr	1446	Switch Board not working	MJPJAY ward	21.01.2021	12.30 pm	
25	22.01.2021	08.30 am	09.00 am	00.30 Hr	256	Lift No-06 Not working	Time Office	22.01.2021	09.34 am	
26	22.01.2021	10.45 am	11.05 am	00.20 Hr	1631	LED light not working	Blood bank	22.01.2021	12.45 pm	
27	22.01.2021	02.44 pm	03.10 pm	00.26 Hr	1385	Switch Board not working	OT Complex	23.01.2021	02.10 pm	
28	22.01.2021	01.10 pm	02.10 pm	01.00 Hr	284	LED Tubelight not working	Physilogy	22.01.2021	02.35 pm	
29	23.01.2021	02.50 pm	03.15 pm	00.25 Hr	3128	Switch Board not working	Optal Ward	23.01.2021	03.15 pm	
30	23.01.2021	12.08 pm	12.45 pm	00.37 Hr	1632	Deep Fridge not working	Blood bank			Work in progress
31	23.01.2021	12.55 pm	02.35 pm	01.40 Hr	1073	Switch Board not working	PICU	25.01.2021	03.40 pm	
Pending work										
1	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area			Work in progress

Total Complaint	32
Pending Complaint	3
Complete Complaint	29
Complaint Precentage	91%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 11/01/2021 to 17/01/2021

Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	09.01.2021	09.45 am	10.05 am	00.20 Hr	1370	AC Duct Cleaning work	OT Complex	09.01.2021	04.30 pm	
2	11.01.2021	09.30 am	09.45 am	00.15 Hr	2683	Aircooler jali repair	CSSD	11.01.2021	09.45 am	
3	11.01.2021	10.35 am	10.45 am	00.10 Hr	1527	LED light not working	Metron Offie	11.01.2021	10.45 am	
4	11.01.2021	03.50 pm	03.55 pm	00.05 Hr	2944	Wall fan not working	MCRI ICU	12.01.2021	02.25 pm	
5	11.01.2021	10.40 am	11.10 am	00.30 Hr	2075	Cilling Fan not working	MCRI OPD	11.01.2021	12.10 pm	
6	11.01.2021	02.20 pm	03.00 pm	00.40 Hr	2068	LED light not working	CVTS	11.01.2021	03.25 pm	
7	11.01.2021	09.35 am	10.00 am	00.25 Hr	246	Lift No-02 Light not working	Time Office	12.01.2021	12.19 pm	
8	12.01.2021	11.45 am	12.15 pm	00.30 Hr	3927	LED Tubelight not working	Ophthal ward	12.01.2021	01.05 pm	
9	12.01.2021	11.19 am	12.10 pm	00.51 Hr	1842	LED Tubelight & Cilling fan not working	Urology Dept.	12.01.2021	04.50 pm	
10	12.01.2021	03.30 pm	04.10 pm	00.40 Hr	4252	VJ Cable Replaced	IT Department	18.01.2021	11.20 am	
11	12.01.2021	10.51 am	11.30 am	00.39 Hr	3888	LED Light & Switch Board not working	SICU	12.01.2021	01.05 pm	
12	12.01.2021	09.50 am	10.05 am	00.15 Hr	2933	LED light not working	Old Deluxe	12.01.2021	11.30 am	
13	13.01.2021	10.20 am	11.00 am	00.40 Hr	2935	Switch Board not working	Old Deluxe	13.01.2021	11.45 am	
14	13.01.2021	10.30 am	11.45 am	00.15 Hr	2174	LED Tubelight not working	OBGY ICU	13.01.2021	11.45 am	
15	13.01.2021	04.59 pm	05.10 pm	00.11 Hr	249	Lift no-02 Not working	Time Office	13.01.2021	05.15 pm	
16	13.01.2021	10.30 am	11.45 am	00.15 Hr	2160	X-Ray Box not working	OBGY ICU	13.01.2021	12.05 pm	
17	13.01.2021	04.20 pm	04.45 pm	00.25 Hr	2229	LED light not working	Nephrology	13.01.2021	05.05 pm	
18	13.01.2021	03.35 pm	04.10 pm	00.35 Hr	2808	Extention board not working	Old Pead.	13.01.2021	05.15 pm	
19	13.01.2021	03.35 pm	04.55 pm	00.20 Hr	2807	Switch Board not working	Old Pead.	14.01.2021	04.55 pm	
20	15.01.2021	11.30 am	11.45 am	00.15 Hr	2082	Central AC not cooling	MCRI Dental	15.01.2021	11.45 am	
21	15.01.2021	10.15 am	12.45 pm	00.30 Hr	660	Gizer not working	FSW	15.01.2021	03.00 pm	
22	16.01.2021	10.30 am	10.55 am	00.25 Hr	684	LED Tubelight & Cilling fan not working	Linen Dept.	15.01.2021	11.50 am	
23	16.01.2021	04.00 pm	05.30 pm	01.30 Hr	1264	Switch Board not working	Dialysis	17.01.2021	09.45 am	
Pending work										
24	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area			Work in progress

Total Complaint	24
Pending Complaint	1
Complete Complaint	23
Complaint Precentage	96%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 04/01/2021 to 10/01/2021

Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	04.01.2021	09.50 am	10.15 am	00.25 Hr	1913	LED Tubelight not working	EMS ICU	04.01.2021	10.20 am	
2	04.01.2021	09.50 am	10.35 am	00.45 Hr	1915	Switch Board not working	EMS ICU	04.01.2021	11.15 am	
3	04.01.2021	03.31 pm	04.45 pm	01.14 Hr	1624	LED 18watt Panel	Blood bank	06.01.2021	11.26 am	
4	04.01.2021	03.50 pm	03.55 pm	00.05 Hr	240	Lift Not working-01 No	Time Office	04.01.2021	04.10 pm	
5	04.01.2021	02.19 pm	02.30 pm	00.11 Hr	1388	LED Tubelight not working	Pead.OPD	04.01.2021	02.55 pm	
6	04.01.2021	03.50 pm	04.05 pm	00.15 Hr	239	Lift Not working-02	Time Office	04.01.2021	05.00 pm	
7	05.01.2021	09.50 am	11.00 am	01.10 Hr	2148	LED light not working	Ex.Deluxe	06.01.2021	12.10 pm	
8	05.01.2021	09.30 am	09.55 am	00.25 Hr	2011	AC Not working	PICU	09.01.2021	11.40 am	
9	05.01.2021	12.08 pm	01.00 pm	00.42 Hr	1556	LED Tubelight not working	MMW	07.01.2021	02.40 pm	
10	05.01.2021	10.30 am	11.15 am	00.45 Hr	254	Lift not working	OPD Complex	05.01.2021	11.25 am	
11	06.01.2021	09.30 am	09.40 am	00.10 Hr	1363	LED light not working	OT Complex	06.01.2021	10.08 am	
12	06.01.2021	09.50 am	10.40 am	00.50 Hr	2149	Gizer not working	Ex.Deluxe	06.01.2021	11.00 am	
13	06.01.2021	10.45 am	12.00 pm	01.15 Hr	3210	LED light not working	Pead.OPD	06.01.2021	01.20 pm	
14	06.01.2021	10.41 am	12.10 pm	01.29 Hr	1591	Extencion Board new Required	MICU	07.01.2021	10.00 am	
15	06.01.2021	10.39 am	01.00 pm	02.21 Hr	1595	Switch Board not working	MICU	06.01.2021	02.30 pm	
16	07.01.2021	11.55 am	12.35 pm	00.40 Hr	2162	Electrical problame	Ex.Deluxe	07.01.2021	04.55 pm	
17	07.01.2021	10.13 am	12.35 pm	02.22 Hr	1924	AC Not working	EMS ICU	08.01.2021	04.15 pm	
18	07.01.2021	12.35 pm	12.55 pm	00.20 Hr	1690	Exhouast Fan not working	6th Floor	07.01.2021	02.50 pm	
19	07.01.2021	10.45 am	11.15 am	00.30 Hr	2155	Switch Board not working	6th Floor	09.01.2021	02.30 pm	
20	07.01.2021	02.20 pm	03.10 pm	00.50 Hr	2158	Ceiling fan not working	Ex.Deluxe	09.01.2021		
21	07.01.2021	09.59 am	10.50 am	00.51 Hr	241	Lift No-05 Not working	Time Office	07.01.2021	12.10 pm	
22	07.01.2021	10.35 am	12.10 pm	01.35 Hr	577	LED Tubelight not working	PSM Dept.	07.01.2021	04.45 pm	
23	08.01.2021	12.42 pm	12.55 pm	00.13 Hr	1927	Switch Board not working	EMS ICU	08.01.2021	01.30 pm	
24	08.01.2021	10.47 am	11.55 am	01.08 Hr	1625	LED Tubelight, Refrigerent & Split AC not working	Blood bank	08.01.2021	04.00 pm	
25	08.01.2021	02.50 pm	03.10 pm	00.20 Hr	2172	LED light not working	OBGY ICU	08.01.2021	03.30 pm	
26	08.01.2021	03.15 pm	03.30 pm	00.15 Hr	3504	Switch Board not working	Cardiac OT	08.01.2021	04.20 pm	
27	09.01.2021	03.00 pm	03.45 pm	00.45 Hr	1257	Switch Board not working	Dialysis	10.01.2021	11.55 pm	
Pending work										
28	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area			Work in progress
29	12-07-20	03.35 pm	04.10 pm	00.35 Hr	208	Lift Telephone wire laying	Time Office	09.01.2021	11.20 am	
30	28/12/2020	11.18 am	03.00 pm	03.42 Hr	4249	LED Culler 15 watt fitting not working	Dyotan Hall	06.01.2021	11.30 am	
31	29/12/2020	03.51 pm	04.35 pm	00.44 Hr	231	Lift No-02 Fan Not working	Time Office	05.01.2021	12.30 pm	

Total Complaint	31
Pending Complaint	1
Complete Complaint	30
Complaint Precentage	97%


M.V. Gulkwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 28/12/2020 to 03/01/2021


Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	28/12/2020	12.35 pm	02.10 pm	01.35 Hr	4571	LED Tubelight not working	Biochemistry Dept.	28/12/2020	03.05 pm	
2	28/12/2020	03.20 pm	03.55 pm	00.35 Hr	53	Electrical problame	School Phytherapy	28/12/2020	02.22 pm	
3	28/12/2020	11.37 am	12.10 pm	00.33 Hr	2065	Water filter not working	MCRI OPD	28/12/2020	01.00 pm	
4	28/12/2020	12.00 pm	02.10 pm	02.10 Hr	229	Water filter not working	Time Office	28/12/2020	02.45 pm	
5	28/12/2020	09.30 am	09.45 am	00.15 Hr	2923	AC Not Working	MCRI ICU	28/12/2020	12.45 pm	
6	28/12/2020	11.56 am	05.00 pm	05.04 Hr	610	LED Tubelight not working	CATH-LAB	30/12/2020	11.45 am	
7	28/12/2020	02.30 pm	02.41 pm	00.11 Hr	719	Cilling Fan not working	OPD Complex	28/12/2020	03.20 pm	
8	28/12/2020	11.18 am	03.00 pm	03.42 Hr	4249	LED Culler 15 watt fitting not working	Dyptan Hall			Work in progress
9	28/12/2020	10.07 am	12.35 pm	02.28 Hr	1435	Refragator not working	MJPJAY ward	01-04-21	01.20 pm	
10	28/12/2020	12.25 pm	04.30 pm	04.05 Hr	1801	LED Bulb not working	Super Deluxe	28/12/2020	04.55 pm	
11	28/12/2020	10.40 am	11.00 am	00.20 Hr	1348	LED Tubelight not working	OT Complex	01-01-21	03.10 pm	
12	28/12/2020	10.29 am	03.55 pm	05.26 Hr	2603	LED light not working	Medical Store	28/12/2020	04.31 pm	
13	29/12/2020	10.35 am	11.00 am	00.25 Hr	2004	Exention Board not working	PICU	29/12/2020	11.25 am	
14	29/12/2020	12.20 pm	12.55 pm	00.35 Hr	1353	AC Not Working	OT Complex	29/12/2020	03.20 pm	
15	29/12/2020	01.00 pm	01.15 pm	00.15 Hr	2163	X-Ray Box not working	OBYG ICU	30/12/2020	02.10 pm	
16	29/12/2020	03.51 pm	04.35 pm	00.44 Hr	231	Lift No-02 Fan Not working	Time Office			Work in progress
17	29/12/2020	09.45 am	10.35 am	00.50 Hr	230	Compressor not working	STP/ETP	29/12/2020	05:15 pm	
18	29/12/2020	02.50 pm	03.20 pm	00.30 Hr	2988	LED light not working	EMS ICU	29/12/2020	03.20 pm	
19	29/12/2020	11.06 am	12.10 pm	01.04 Hr	3446	LED Tubelight not working	MMW	29/12/2020	02.35 pm	
20	30/12/2020	11.38 am	12.35 pm	00.44 Hr	1177	Switch Board not working	OBYG ICU	30/12/2020	01.20 pm	
21	30/12/2020	11.11 am	11.55 am	00.44 Hr	3364	LED Bulb not working	MSW	30/12/2020	12.48 pm	
22	30/12/2020	12.35 pm	12.55 pm	00.20 Hr	233	Water filter not working	Time Office	30/12/2020	02.40 pm	
23	30/12/2020	02.17 pm	03.00 pm	00.43 Hr	1683	LED light not working	5th floor deluxe	30/12/2020	03.10 pm	
24	31/12/2020	12.20 pm	12.30 pm	00.10 Hr	1688	Extention board not working	5th floor deluxe	31/12/2020	01.20 pm	
25	31/12/2020	11.33 am	12.45 pm	01.12 Hr	1687	Refragator not working	5th floor deluxe	01-01-21	02.30 pm	
26	31/12/2020	11.46 am	12.55 pm	01.09 Hr	3209	Switch Board not working	Peditiric Dept.	01-01-21	01.20 pm	
27	31/12/2020	11.50 am	12.35 pm	00.45 Hr	3168	Refragator not working	Ex.Deluxe	01-04-21	12.55 pm	
28	31/12/2020	11.50 am	01.17 pm	01.27 Hr	2145	Cilling Fan not working	Ex. Deluxe	01-02-21	04.35 pm	
29	31/12/2020	11.06 am	12.30 pm	01.24 Hr	2241	Air-Blower not working	STP/ETP	31/12/2020	01.20 pm	
30	31/12/2020	01.18 pm	01.50 pm	00.38 Hr	2144	LED Tubelight not working	Ex. Deluxe	01-01-21	01.50 pm	
31	31/12/2020	10.20 am	10.30 am	00.10 Hr	1437	Switch Board not working	MJPJAY ward	01-01-21	10.30 pm	
32	31/12/2020	10.00 am	10.40 pm	00.40 Hr	1436	Cilling Fan Regulator not working	MJPJAY ward	01-01-21	10.40 am	
33	01-01-21	10.45 am	11.35 am	00.50 Hr	1249	Extention board not working	Dialysis	01-01-21	12.05 pm	
34	01-01-21	06.45 pm	08.00 pm	01.15 Hr	236	Lift not Working No-05	Time Office	01-02-21	10.20 am	
35	01-01-21	11.15 am	12.35 pm	01.20 Hr	1805	Refragator not working	Super Deluxe	01-04-21	10.25 am	
36	01-01-21	12.00 pm	12.45 pm	00.45 Hr	1250	16amp socket is not working	Dialysis	01-01-21	01.20 pm	
37	01-01-21	09.15 am	12.00 pm	02.45 Hr	235	Electric Motor not working	Dialysis	01-01-21	03.00 pm	

38	01-02-21	09.30 am	10.10 am	00.40 Hr	3877	Switch Board not working	SICU	01-02-21	10.10 am	
39	01-02-21	11.55 am	12.10 pm	00.15 Hr	7	LED Tubelight not working	Central Laibrary	01-02-21	02.50 pm	
40	01-02-21	11.35 am	02.10 pm	02.35 Hr	9	Water filter not working	Central Laibrary	01-02-21	03.20 pm	
41	01-02-21	12.10 pm	02.20 pm	02.10 Hr	2657	Water filter not working	Exam Cell	01-02-21	04.15 pm	
42	01-02-21	09.45 am	11.10 am	01.25 Hr	4572	Water filter not working	Biochemistry Dept.	01-02-21	11.55 am	
43	01-03-21	10.45 am	12.35 pm	01.50 Hr	237	Lift No-01 not working	Time Office	01-04-21	10.55 am	
Pending work										
1	21/12/2020	02.30 pm	03.20 pm	00.50 Hr	691	Refregator not working	OT Complex	01-04-21	10.30 am	
2	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area			Work in progress
3	12-07-20	03.35 pm	04.10 pm	00.35 Hr	208	Lift Telephone wire laying	Time Office			Work in progress

Total Complaint	46
Pending Complaint	4
Complete Complaint	42
Complaint Precentage	91%


M.A. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 21/12/2020 to 27/12/2020

Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	21/12/2020	03.15 pm	03.25 pm	00.10 Hr	3360	LED Tubelight not working	MSW	21/12/2020	03.35 pm	
2	21/12/2020	02.30 pm	03.20 pm	00.50 Hr	691	Refregator not working	OT Complex			Work in progress
3	21/12/2020	01.15 pm	03.20 pm	02.05 Hr	224	Exouast fan not working	Hospital Area			Work in progress
4	21/12/2020	03.00 pm	04.20 pm	01.20 Hr	2160	X-Ray Box not working	OBGY ICU	24/12/2020	11.00 am	
5	22/12/2020	10.20 am	10.20 am	-	299	LED light not working	Super Deluxe	22/12/2020	10.40 am	
6	23/12/2020	11.20 am	01.00 pm	01.40 Hr	1919	Light Problame	Pharmacology	23/12/2020	02.00 pm	
7	23/12/2020	12.35 pm	03.20 pm	02.45 Hr	464	LED Tubelight not working	TB Chest OPD	24/12/2020	09.11 am	
8	23/12/2020	03.21 pm	04.00 pm	00.39 Hr	1920	LED Tubelight not working	HR Department	23/12/2020	04.30 pm	
9	23/12/2020	03.46 pm	04.00 pm	00.14 Hr	3120	Switch Board not working	Isolation ICU	23/12/2020	04.40 pm	
10	24/12/2020	12.11 pm	02.30 pm	02.19 Hr	2162	AC Not Working	OBGY ICU	25/12/2020	04.00 pm	
11	24/12/2020	09.30 am	09.45 am	00.15 Hr	2656	Light not working	Exam Cell	24/12/2020	10.20 am	
12	24/12/2020	01.00 pm	02.00 pm	01.00 Hr	1623	LED Bulb not working	Blood bank	24/12/2020	02.00 pm	
13	25/12/2020	11.20 am	11.55 am	00.35 Hr	2125	Exouast fan not working	Ex.Deluxe	25/12/2020	01.20 pm	
14	26/12/2020	10.40 am	11.10 am	00.30 Hr	4	Water filter not working	Central Laibrary	26/12/2020	03.20 pm	
15	26/12/2020	11.10 am			228	Strsit Light not working	Campous Area	26/12/2020	01.20 pm	
16	26/12/2020	01.00 pm			letter	Light Maintance work	Dean Office	27/12/2020	05.00 pm	
Pending work										
1	12-07-20	03.35 pm	04.10 pm		208	Lift Telephone wire laying	Time Office			Work in progress
2	15/12/2020	04.10 pm	04.30 pm	00.20 Hr	281	Switch Board not working	PSM Dept.	21/12/2020	11.55 am	
3	16/12/2020	11.25 am	11.55 am	00.30 Hr	1336	AC Not working (Post.Opp.)	ot Complex	23/12/2020	04.05 pm	
4	16/12/2020	11.00 am	11.40 am	00.40 Hr	2926	LED light not working	MCRI ICU	28/12/2020	11.35 am	

Total Complaint	20
Pending Complaint	3
Complete Complaint	17
Complaint Precentage	85%


M. V. Gaiwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad

MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 14/12/2020 to 20/12/2020

Sr. No.	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	14/12/2020	08.35 am	08.48 am		215	LED light not working	Dean Office	14/12/2020	08.48 am	
2	14/12/2020	03.35 pm	03.55 pm		212	Lift not working.-05	Time Office	14/12/2020	04.05 pm	
3	14/12/2020	09.40 am	09.50 am		1333	OT No-10 AC Ducting Cleaning	OT Complex	14/12/2020	02.30 pm	
4	15/12/2020	10.00 am	12.00 pm		1430	LED light not working	MJPJY ward	15/12/2020	01.00 pm	
5	15/12/2020	04.10 pm	04.30 pm		281	Switch Board not working	PSM Dept.			Work in progress
6	16/12/2020	10.45 am	11.30 am		2923	AC Not working	MCRI ICU	16/12/2020	12.10 pm	
7	16/12/2020	11.25 am	11.55 am		1336	AC Not working (Post.Opp.)	ot Complex			Work in progress
8	16/12/2020	11.00 am	11.40 am		2926	LED light not working	MCRI ICU			Work in progress
9	17/12/2020	10.27 am	11.10 am		2053	LED light not working	MCRI Registation	17/12/2020	11.35 am	
10	17/12/2020	11.05 am	11.45 am		2119	Freez Not working	Ex.Deluxe	17/12/2020	02.00 pm	
11	17/12/2020	03.10 pm	03.25 pm		1337	LED Tubelight not working	OT Complex	19/12/2020	03.55 pm	
12	17/12/2020	11.20 am	02.35 pm		3113	Telephone cable laying work.	Isolation ICU	19/12/2020	10.30 am	
13	18/12/2020	04.30 pm	05.10 pm		1582	Switch Board not working	MMW	21/12/2020	11.30 am	
14	18/12/2020	10.35 am	12.00 pm		1242	AC Not Working	Dialasis	18/12/2020	12.00 pm	
15	18/12/2020	12.15 pm	12.45 pm		1338	Switch Board not working	OT Complex	18/12/2020	03.45 pm	
16	18/12/2020	02.35 pm	02.45 pm		1339	AC Not working	OT Complex	18/12/2020	03.30 pm	
17	19/12/2020	10.27 am	10.45 am		4018	Switch Board not working	OBGY OPD	19/12/2020	12.30 pm	
18	19/12/2020	11.22 am	12.35 pm		1340	LED Tubelight not working	OT Complex	19/12/2020	03.35 pm	
19	19/12/2020	10.50 am	11.25 am		222	Water coolar not working	Time Office	19/12/2020	12.35 pm	
20	19/12/2020	07.12 pm	07.20 pm		3116	Ventilator Pin not working	Isolation Icu	19/12/2020	07.20 pm	
21	19/12/2020	12.10 pm	12.55 pm		50	Projector Shifting work	Physotherapy C Build.	21/12/2020	12.20 pm	
22	19/12/2020	02.30 pm	03.00 pm		1341	AC Cleaning work	OT Complex-10	19/12/2020	04.10 pm	
Pending work										
1	12-07-20	03.35 pm	04.10 pm		208	Lift Telephone wire laying	Time Office			Work in progress

Total Complaint	23
Pending Complaint	4
Complete Complaint	19
Complaint Precentage	83%


M. V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad


Electrical Supervisor
MGM Aurangabad

MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 07/12/2020 to 13/12/2020

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Compliation	Close Time	Remark
1	12-07-20	09.55 am	10.05 am		1428	Cilling Fan Regulator not working	MJPJAY ward	12-07-20	10.05 am	
2	12-07-20	11.10 am	12.55 pm		1321	Switch Board not working	OT Complex	12-08-20	10.20 am	
3	12-07-20	04.05 pm	05.05 pm		650	Switch Board not working	FSW	12-08-20	01.30 pm	
4	12-07-20	03.35 pm	04.10 pm		208	Lift Telephone wire laying	Time Office			Work in progress
5	12-07-20	04.36 pm	05.00 pm		2044	LED Tubelight not working	MCRI OPD NO-13	12-08-20	12.59 pm	
6	12-08-20	10.40 am	01.00 pm		1910	Cilling Fan Regulator not working	Day Care ward	12-08-20	01.11 pm	
7	12-08-20	10.45 am	12.35 pm		205	X-Ray Box not working	SS OPD	12-08-20	12.41 pm	
8	12-08-20	11.30 am	12.15 pm		50	LED Tubelight not working	ENT OPD	12-08-20	12.30 pm	
9	12-08-20	01.00 pm	02.37 pm		2115	LED Bulb not working	Ex.Deluxe	12-10-20	11.15 am	
10	12-08-20	12.35 pm	03.13 pm		2221	Switch Board not working	Nephrology	12-08-20	03.54 pm	
11	12-08-20	10.20 am	12.35 pm		382	New LED Tubelight Required	OBGY Office	12-09-20	01.30 pm	
12	12-08-20	12.40 pm	03.20 pm		388	Switch Board not working	Urology Dept.	12-08-20	03.30 pm	
13	12-09-20	10.55 am	11.35 am		2913	Gizer not working	Old Deluxe	12-09-20	12.30 pm	
14	12-09-20	02.57 pm	04.10 pm		2155	LED light not working	OBGY ICU	12-10-20	11.10 pm	
15	12-09-20	11.45 am	12.29 pm		1788	Switch Board not working	Labour Room	12-09-20	12.33 pm	
16	12-09-20	11.30 am	12.39 pm		1238	Switch Board not working	Dialysis Dept.	12-09-20	01.15 pm	
17	12-09-20	12.50 pm	01.30 pm		2154	Humidity Temp.sensor not working	OBGY ICU	12-09-20	01.30 pm	
18	12-09-20	11.46 am	12.45 pm		280	Cat-06 Cable laying	PSM Dept.	12-09-20	02.29 pm	
19	12-10-20	09.20 am	10.00 am		211	Lift not working.-02	Time Office	12-10-20	12.20 pm	
20	12-10-20	11.45 am	01.00 pm		3197	LED Tubelight not working	Microbiology	12-11-20	02.00 pm	
21	12-10-20	10.20 am	10.55 am		210	Lift Not working.-05	Time Office	12-10-20	12.35 pm	
22	12-10-20	09.30 am	10.10 am		1328	LED light not working	OT Complex	12-10-20	11.35 am	
23	12-11-20	02.20 pm	02.30 pm		1330	LED Tubelight not working	OT Complex	12-11-20	03.10 pm	
24	12-11-20	04.15 pm	04.30 pm		3921	LED Tubelight not working	Ophthal OPD	12-12-20	01.20 pm	
25	12-11-20	12.00 pm	12.10 pm		807	Table fan not working	Cath lab	12-11-20	12.30 pm	
26	12-11-20	02.20 pm	04.30 pm		1832	LED Tubelight not working	Urology Dept.	12-12-20	10.15 am	
27	12-11-20	03.15 pm	04.10 pm		1331	AC Not Working	OT Complex	12-11-20	05.10 pm	
28	12-12-20	11.00 am	11.30 am		92	Switch Board not working	KI ICU	12-12-20	11.30 am	
29	12-12-20	10.18 am	10.45 am		2159	Switch Board not working	OBGY ICU	12-12-20	11.26 am	
30	12-12-20	02.10 pm	02.15 pm		2915	Cilling Fan not working	Old Deluxe	12-12-20	02.30 pm	
Pending work										
1	12-04-20	03.34 pm	04.20 pm		2	UPS not working	Central Laibrary			Call Transfer Bio-Medical Dept.
2	12-04-20	10.45 am	12.20 pm		574	Switch Board not working	PSM Dept.	12-07-20	12.30 pm	
3	12-05-20	03.55 pm	03.55 pm		1051	Switch Board not working	Casulty	12-11-20	12.20 pm	
4	12-03-20	11.00 am	12.35 pm		2039	X-Ray Box not working	MCRI OPD-12	12-07-20	10.45 am	

Total Complaint	34
Pending Complaint	1
Complete Complaint	33
Complaint Precentage	97%


M. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 30/11/2020 to 06/12/2020

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	27/11/2020	04.45 pm	05.00 pm		2600	Lift not working	Time Office	12-01-20	12.35 pm	
2	27/11/2020	09.15 am	10.10 am		1309	AC Not Working	OT Complex	27/11/2020	11.20 am	
3	28/11/2020	03.48 pm	03.48 pm		254	Lift not working	C Building	12-01-20	10.40 am	
4	30/11/2020	10.35 am	11.00 am		2056	LED light not working	CVTS	30/11/2020	11.20 am	
5	30/11/2020	10.55 am	11.45 am		1779	Switch Board & LED Light not working	Labour Room .	30/11/2020	01.20 pm	
6	30/11/2020	09.05 am	10.35 am		1781	Switch Board not working	Labour Room	30/11/2020	12.15 pm	
7	30/11/2020	12.30 pm	02.40 pm		641	Switch Board not working	FSW	30/11/2020	03.20 pm	
8	30/11/2020	12.30 pm	02.20 pm		640	Switch Board not working	FSW	30/11/2020	03.15 pm	
9	30/11/2020	11.00 am	04.35 pm		3425	LED Tubelight not working	MMW	12-03-20	11.45 am	
10	30/11/2020	01.00 pm	03.15 pm		201	Water filter not working	Time Office	30/11/2020	04.00 pm	
11	30/11/2020	12.15 pm	12.15 pm		1311	Switch Board not working	OT Complex	12-01-20	03.36 pm	
12	12-01-20	12.08 pm	12.50 pm		3348	Switch Board not working	MSW	12-01-20	12.55 pm	
13	12-01-20	11.21 am	12.10 pm		1909	LED Tubelight not working	Day Care ward	12-01-20	02.00 pm	
14	12-02-20	11.10 am	02.45 pm		1422	Gizer not working	MJPJAY ward	12-02-20	03.00 pm	
15	12-02-20	02.00 pm	02.19 pm		2037	New Switch board fitting	MCRI Ophthal OPD	12-02-20	02.31 pm	
16	12-02-20	11.45 am	01.55 pm		645	LED Tubelight not working	FSW	12-02-20	03.30 pm	
17	12-02-20	11.55 am	12.35 pm		2103	LED light not working	Ex.Deluxe	12-03-20	03.00 pm	
18	12-02-20	02.30 pm	02.45 pm		1	Lift not Working	Central Laibrary	12-03-20	04.10 pm	
19	12-02-20	11.46 am	01.35 pm		525	LED Tubelight not working	Psy OPD	12-02-20	03.15 pm	
20	12-02-20	10.20 am	11.35 am		3423	LED Tubelight not working	MMW	12-02-20	02.00 pm	
21	12-03-20	11.00 am	12.35 pm		2039	X-Ray Box not working	MCRI OPD-12			Work in progress
22	12-03-20	09.55 am	10.17 am		1529	LED Tubelight not working	Med.OPD	12-03-20	10.17 am	
23	12-03-20	10.35 am	12.00 pm		2909	LED light not working	Old Deluxe	12-03-20	03.32 pm	
24	12-03-20	02.45 pm	03.10 pm		1830	Switch Board & LED Light not working	Urology Dept.	12-03-20	03.30 pm	
25	12-03-20	11.15 am	01.00 pm		3349	LED Tubelight not working	MSW	12-03-20	02.35 pm	
26	12-03-20	12.20 pm	12.45 pm		2677	LED Tubelight not working	CSSD	12-04-20	02.30 pm	
27	12-04-20	03.34 pm	04.20 pm		2	UPS not working	Central Laibrary			Work in progress
28	12-04-20	01.00 pm	01.15 pm		2912	Switch Board not working	Old Deluxe	12-04-20	02.20 pm	
29	12-04-20	10.45 am	12.20 pm		574	Switch Board not working	PSM Dept.			Work in progress
30	12-05-20	11.30 am	11.45 am		355	AC Not Working	MICU	12-05-20	12.55 pm	
31	12-05-20	10.20 am	11.15 am		2059	LED 15 watt fitting working	CVTS	12-05-20	12.25 pm	
32	12-05-20	03.55 pm	03.55 pm		1051	Switch Board not working	Casulty			Work in progress
33	12-05-20	02.30 pm	03.00 pm		1324	AC Not Working	OT Complex	12-05-20	04.10 pm	
34	12-05-20	10.35 am	11.55 am		255	LED 15 watt fitting working	Physotherapy C Build.	12-05-20	03.45 pm	
Pending work										
1	21/11/2020	11.35 am	12.00 pm		123	AC Not Working	RGY ICU	23/11/2020	05.30 pm	
2	23/11/2020	10.00 am	11.30 am		2595	Water filter not working	Time Office	12-02-20	12.35 pm	
3	26/11/2020	10.00 am	12.01 pm		2399	Water filter not working	Central Laibrary	12-02-20	03.35 pm	
4	26/11/2020	12.35 pm	01.00 pm		273	LED Tubelight not working	Super Deluxe covid	27/11/2020	02.40 pm	
5	27/11/2020	04.45 pm	05.00 pm		2600	Lift not working	Time Office	12-01-20	12.35 pm	
6	28/11/2020	03.48 pm	03.48 pm		254	Lift not working	C Building	12-01-20	10.40 am	

Total Complaint	40
Pending Complaint	4
Complete Complaint	36
Complaint Precentage	90%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 22/11/2020 to 29/11/2020

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	22/11/2020	12.43 pm	01.00 pm		3340	switch board not wrngk	M S ward	26/11/2020	11.20 am	
2	23/11/2020	10.00 am	11.30 am		2595	Water filter not working	Time Office			Work in progress
3	23/11/2020	09.20 am	10.45 am		3623	CFL Bulb not working	Cardiac OT	23/11/2020	11.20 am	
4	23/11/2020	11.10 am	11.10 am		1577	New Exention Board	MICU	25/11/2020	11.50 am	
5	23/11/2020	03.00 pm	04.00 pm		280	LED Tubelight not working	Psychology Dept	23/11/2020	04.55 pm	
6	24/11/2020	09.35 am	09.40 am		2977	LED light not working	EICU	24/11/2020	10.10 am	
7	24/11/2020	12.43 pm	01.43 pm		1414	LED Bulb not working	MJPJAY ward	24/11/2020	02.20 pm	
8	24/11/2020	12.05 pm	12.30 pm		602	Harmonic metr not working	Cath lab OT	26/11/2020	03.00 pm	
9	24/11/2020	03.45 pm	03.55 pm		3851	Temperature metr not working	SICU	24/11/2020	04.00 pm	
10	26/11/2020	09.30 am	09.45 am		1528	LED Tubelight not working	Medicin OPD	26/11/2020	10.00 am	
11	26/11/2020	11.20 am	11.30 am		271	Cilling Fan not working	Super Deluxe covid	26/11/2020	11.45 am	
12	26/11/2020	12.00 pm	12.00 pm		1781	LED Tubelight not working	Central store	26/11/2020	12.50 pm	
13	26/11/2020	10.00 am	10.30 am		573	Water filter not working	P S M Dept	26/11/2020	12.00 pm	
14	26/11/2020	10.00 am	12.01 pm		2399	Water filter not working	Central Laibrary			Work in progress
15	26/11/2020	12.35 pm	01.00 pm		273	LED Tubelight not working	Super Deluxe covid			Work in progress
16	27/11/2020	10.20 am	10.30 am		1045	switch board not wrngk	Casulty	27/11/2020	11.45 am	
17	27/11/2020	09.53 am	11.00 am		201	LED Tubelight not working	S S OPD 238	27/11/2020	03.20 pm	
18	27/11/2020	11.20 am	01.45 pm		2905	Gizer not working	Old Deluxe	27/11/2020	02.20 pm	
19	27/11/2020	04.02 pm	11.30 am		3194	switch board not wrngk	Microbiology dept	28/11/2020	11.55 am	
20	27/11/2020	11.30 am	12.00 pm		3620	AC Not working	Cardiac OT	30/11/2020	10.30 am	
21	27/11/2020	10.15 am	10.45 am		1309	AC Not working	OT Complex	27/11/2020	11.20 am	
22	27/11/2020	04.45 pm	05.00 pm		2600	Lift not working	Time Office			Work in progress
23	28/11/2020	09.35 am	09.41 am		46	LED Tubelight not working	ENT OPD 236	28/11/2020	10.05 am	
24	28/11/2020	10.29 am	10.45 am		3109	LED Bulb not working	Isolation ICU	28/11/2020	11.00 am	
25	28/11/2020	10.14 am	12.25 pm		461	LED Tubelight not working	Pul.Med.OPD	28/11/2020	12.45 pm	
26	28/11/2020	11.30 am	11.50 am		1825	X-Ray Box not working	U P S Ward	28/11/2020	12.20 pm	
27	28/11/2020	10.20 am	11.31 am		1907	LED Bulb not working	New Deluxe	28/11/2020	04.10 pm	
28	28/11/2020	11.30 am	04.31 pm		3195	AC Not working	Microbiology dept	28/11/2020	04.45 pm	
29	28/11/2020	03.48 pm	03.48 pm		254	Lift not working	C Building			Work in progress
Pending work										
1	19/11/2020	01.35 pm	02.00 pm		2672	Motor not working	C S S D	30/11/2020	10.35 am	
2	21/11/2020	11.35 am	12.00 pm		123	AC Not Working	RGY ICU			Work in progress

Total Complaint	31
Pending Complaint	6
Complete Complaint	25
Complaint Percentage	81%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 17/11/2020 to 23/11/2020

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	17/11/2020	10.35 am	04.00 pm		3610	LED light not working	Cardiac OT	17/11/2020	04.50 pm	
2	17/11/2020	12.40 pm	02.00 pm		2026	Standing Fan not working	MCRI OPD	20/11/2020	02.40 pm	
3	17/11/2020	02.13 pm	04.00 pm		2027	AC Not Working	MCRI OPD	18/11/2020	04.45 pm	
4	18/11/2020	11.35am	11.40 am		1041	switch board not workng	casulty	18/11/2020	11.47 am	
5	18/11/2020	10.35 am	11.30 am		3912	LED Tubelight not working	ENT&Ophthal ward	18/11/2020	12.20 pm	
6	19/11/2020	12.25 pm	03.45 pm		1301	switch board not working	OT Complex	20/11/2020	04.00 pm	
7	19/11/2020	10.15 am	10.31 am		1042	Temperature meter not working	Casulty dept	19/11/2020	10.55 am	
8	19/11/2020	11.30 am	11.41 am		3103	LED Tubelight not working	Isolation ward ICU	19/11/2020	12.00 pm	
9	19/11/2020	12.30 pm	12.41 pm		1525	New wall fan fettendak	Matron Office	19/11/2020	01.10 pm	
10	19/11/2020	03.00 pm	03.00 pm		1803	LED Tubelight not working	Covid opd	19/11/2020	03.15 pm	
11	19/11/2020	12.50 pm	03.00 pm		3914	switch board not working	ENT&Ophthal covid	19/11/2020	03.30 pm	
12	19/11/2020	02.25 pm	02.41 pm		1302	switch board not working	OT Complex	20/10/2020	03.40 pm	
13	19/11/2020	01.35 pm	02.00 pm		2672	Motor not working	CSSD			Work in progress
14	20/11/2020	10.05 am	10.15 am		1804	Exouast fan not working	COVID 19 OPD	20/11/2020	10.35 am	
15	20/11/2020	09.55 pm	03.00 pm		102	AC Not Working	Radiology Dept	20/11/2020	03.45 pm	
16	20/11/2020	01.30 pm	04.30 pm		1905	switch board not working	New Deluxe	20/11/2020	05.10 pm	
17	20/11/2020	03.35 pm	04.00 pm		3915	Cilling Fan not working	ENT&OPHTHAL ward	21/11/2020	10.05 am	
18	20/11/2020	11.30 am	11.30 am		3105	LED light not working	Isolation ward ICU	21/11/2020	12.00 pm	
19	21/11/2020	11.35 am	12.00 pm		123	AC Not Working	RGY ICU			Work in progress
20	21/11/2020	09.30 am	10.00 am		2143	LED light not working	OBGY ICU	21/11/2020	12.15 pm	
21	21/11/2020	11.35 am	11.45 am		124	AC Not Working	RGY ICU	21/11/2020	12.30 pm	
22	21/11/2020	11.30 am	12.00 pm		3622	CFL Bulb not working	Cardiac OT	22/11/2020	10.45 am	
23	21/11/2020	10.45 am	11.00 am		103	AC Not Working	Radiology Dept	23/11/2020	3.00 pm	

Total Complaint	23
Pending Complaint	2
Complete Complaint	21
Complaint Precentage	91%


M. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 12/07/2021 to 18/07/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	12.07.2021	11.35 am	12.10 pm	00.45 Hr	1858	Cilling Fan not working	Old Deluxe	12.07.2021	02.45 pm	
2	12.07.2021	12.30 pm	02.45 pm	02.15 Hr	645	Split AC not working	CATH-LAB			Work in progress
3	12.07.2021	02.05 pm	02.35 pm	00.30 Hr	1452	LED Light not working	OBYG ICU	12.07.2021	03.15 pm	
4	12.07.2021	09.40 am	11.25 am	01.45 Hr	396	LED Tubelight not working	OT Complex	15.07.2021	03.40 pm	
5	12.07.2021	10.55 am	12.15 pm	01.20 Hr	367	Exhouast Fan not working	Psy.ward.	13.07.2021	03.25 pm	
6	12.07.2021	02.05 pm	02.55 pm	00.50 Hr	3632	Switch Board not working	Cardac OT	12.07.2021	03.45 pm	
7	12.07.2021	02.25 pm	02.50 pm	00.25 Hr	698	Switch Board not working	Pl,Surjery ward	12.07.2021	03.20 pm	
8	13.07.2021	11.35 am	11.45 am	00.10 Hr	2651	Electrical problame	Covid-19 OPD	13.07.2021	11.45 am	
9	13.07.2021	10.50 am	11.20 am	00.30 Hr	572	Switch Board not working	FMW	13.07.2021	12.30 pm	
10	13.07.2021	11.06 am	12.20 pm	01.14 Hr	766	Cilling Fan not working	MCRI OPD	14.07.2021	02.50 pm	
11	13.07.2021	10.15 am	11.25 am	01.10 Hr	3256	Gizer not working	MCRI ICU	13.07.2021	11.55 am	
12	13.07.2021	11.15 am	11.55 am	00.40 Hr	190	Split AC Tempreture meter not working.	RGY ICU	13.07.2021	12.15 pm	
13	13.07.2021	09.20 am	10.10 am	00.50 Hr	187	Split AC not working	Radiology.	13.07.2021	11.55 am	
14	13.07.2021	09.20 am	10.10 am	00.50 Hr	4579	Water cooler not working	Biomedical Dept.	14.07.2021	12.20 pm	
15	13.07.2021	02.55 pm	03.00 pm	00.05 Hr	317	Switch Board not working	School of Physiology	13.07.2021	03.00 pm	
16	14.07.2021	09.43 am	10.55 am	01.12 Hr	2988	LED Light not working	Old Deluxe	14.07.2021	11.30 am	
17	14.07.2021	10.50 am	11.10 am	00.20 Hr	751	Refregator not working	Microbiology	16.07.2021	02.40 pm	
18	14.07.2021	09.42 am	10.55 am	01.13 Hr	2986	X-Ray Box not working	Old Deluxe	14.07.2021	11.20 am	
19	14.07.2021	09.41 am	10.35 am	00.54 Hr	3987	Exhouast Fan not working	Old Deluxe	14.07.2021	11.15 am	
20	14.07.2021	11.00 am	11.05 am	00.05 Hr	2140	Lift No-05 not working	Time Office	14.07.2021	02.45 pm	
21	14.07.2021	09.35 am	10.55 am	01.20 Hr	2873	Cilling Fan not working	Super Deluxe	14.07.2021	11.50 am	
22	14.07.2021	12.50 pm	02.45 pm	01.55 Hr	1685	LED Light not working	CVTS	14.07.2021	03.55 pm	
23	14.07.2021	10.40 am	02.10 pm	03.30 Hr	162	LED Tubelight not working	F.Ortho ward	14.07.2021	03.30 pm	
24	14.07.2021	06.50 pm	06.55 pm	00.05 Hr	3220	Electrical problame	Ex.Deluxe	14.07.2021	06.55 pm	
25	15.07.2021	09.30 am	09.40 am	00.10 Hr	3221	Gizer not working	Ex.Deluxe	15.07.2021	09.40 am	
26	15.07.2021	01.15 pm	02.20 pm	01.05 Hr	2003	Electrical problame	Quality Department	15.07.2021	03.15 pm	
27	15.07.2021	09.40 am	10.15 am	00.35 Hr	2142	Lift No-05 not working	Time Office	15.07.2021	02.20 pm	
28	15.07.2021	12.48 pm	02.15 pm	01.27 Hr	50	LED 15 watt fitting working	Endoscopy	17.07.2021	02.30 pm	
29	15.07.2021	02.27 pm	03.10 pm	00.43 Hr	282	Split AC not working	Dental OPD	15.07.2021	03.40 pm	
30	15.07.2021	02.15 pm	02.55 pm	00.40 Hr	1565	LED Tubelight not working	Med.OPD	17.07.2021	10.25 am	
31	15.07.2021	10.45 am	11.00 am	00.15 Hr	2006	Extention Board not working	Quality Department	15.07.2021	11.15 am	
32	15.07.2021	12.19 pm	12.55 pm	00.36 Hr	663	Switch Board not working	Hemotology	16.07.2021	11.10 am	
33	15.07.2021	10.20 am	10.30 am	00.10 Hr	573	Tharmameter not working	FMW	15.07.2021	10.35 am	
34	15.07.2021	04.05 pm	04.45 pm	00.40 Hr	1923	Cilling Fan not working	BVG Office	15.07.2021	05.00 pm	
35	15.07.2021	11.56 am	12.15 pm	00.19 Hr	4043	LED Tubelight not working	OBYG OPD	16.07.2021	12.15 pm	
36	15.07.2021	04.12 pm	04.50 pm	00.38 Hr	662	LED Tubelight not working	Hemotology	16.07.2021	03.25 pm	
37	16.07.2021	02.55 pm	03.10 pm	00.15 Hr	3223	Gizer not working	Ex.Deluxe	16.07.2021	03.10 pm	

38	16.07.2021	02.30 pm 17.07.21	02.30 pm 17.07.21	0	MGM/CONS T.DEPT/068	AC chiller plant cleaning work.	Main plant	18.07.2021	02.50 pm	
39	16.07.2021	03.15 pm	04.10 pm	00.55 Hr	597	LED Tubelight not working	PSM Dept.	17.07.2021	11.05 am	
40	16.07.2021	10.35 am	11.10 am	00.35 Hr	3540	Split AC not working	Cardac OT			Work in progress
41	17.07.2021	09.35 am	09.55 am	00.20 Hr	806	Electrical problame	Central store	17.07.2021	10.03 am	
42	17.07.2021	01.25 pm	02.40 pm	01.15 Hr	666	LED Light not working	Hemotology	17.07.2021	03.05 pm	
43	17.07.2021	09.10 am	10.10 am	01.00 Hr	2143	Lift No-05 not working	Time Office	17.07.2021	10.55 am	
Pending work										
1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress

Total Complaint	44
Pending Complaint	3
Complete Complaint	41
Complaint Precentage	93%


M.N. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 05/07/2021 to 11/07/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	05.07.2021	09.45 am	10.00 am	00.15 Hr	2506	Cilling Fan not working	Opthal OPD	05.07.2021	10.15 am	
2	05.07.2021	12.21 pm	02.45 pm	02.24 Hr	292	Cilling Fan not working	PSM Dept.	07.07.2021	04.45 pm	
3	05.07.2021	10.22 am	11.10 am	00.48 Hr	2852	LED Light not working	Super Deluxe	05.07.2021	12.40 pm	
4	06.07.2021	10.05 am	10.35 am	00.30 Hr	159	LED Tubelight not working	F.Ortho ward	06.05.2021	11.10 am	
5	06.07.2021	03.00 pm	03.30 pm	00.30 Hr	645	LED 15 watt fitting working	Hemotology	06.07.2021	04.15 pm	
6	06.07.2021	10.10 am	10.15 am	00.05 Hr	2135	LED Light not working	Time Office	06.07.2021	10.15 am	
7	06.07.2021	10.00 pm	10.05 am	00.05 Hr	67	Electrical panel instalation work	AC Plant	07.07.2021	01.00 am	
8	06.07.2021	03.22 pm	04.10 pm	00.48 Hr	2848	Cilling Fan not working	Pead.ward	07.07.2021	11.00 am	
9	06.07.2021	02.40 pm	03.20 pm	00.40 Hr	385	Switch Board not working	OT Complex	07.07.2021	04.30 pm	
10	07.07.2021	09.51 am	11.20 am	01.29 Hr	388	LED Tubelight not working	OT Complex	07.07.2021	04.20 pm	
11	07.07.2021	03.25 pm	04.50 pm	01.25 Hr	2134	Lift no-05 & 06 not working	Time Office	07.07.2021	05.20 pm	
12	07.07.2021	12.05 pm	02.40 pm	02.35 Hr	1857	LED 15 watt fitting working	Old Deluxe			Requirment work
13	07.07.2021	03.45 pm	04.20 pm	00.35 Hr	71	Cilling Fan not working	ENT OPD	09.07.2021	11.05 am	
14	08.07.2021	09.55 am	10.00 am	00.05 Hr	1663	LED Tubelight not working	Surgery OPD	08.07.2021	10.00 am	
15	08.07.2021	04.30 pm	04.45 pm	00.15 Hr	1897	LED light not working	Covid opd	08.07.2021	04.55 pm	
16	08.07.2021	09.55 am	10.15 am	00.20 Hr	746	Switch Board not working	Microbiology	08.07.2021	12.30 pm	
17	08.07.2021	02.13 pm	02.40 pm	00.27 Hr	2850	LED Tubelight not working	Pead.ward	08.07.2021	04.10 pm	
18	08.07.2021	01.20 pm	02.40 pm	01.20 Hr	429/430	Repairing work	MICU			Project
19	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress
20	08.07.2021	11.45 am	12.20 pm	00.35 Hr	3215	Fan Regulator not working	Ex.Deluxe	08.07.2021	02.45 pm	
21	08.07.2021	11.36 am	11.55 am	00.19 Hr	185	AC Duct Cleaning work	Radiology Dept	08.07.2021	02.40 pm	
22	08.07.2021	10.35 am	10.40 am	00.05 Hr	2983	LED Light not working	Old Deluxe	08.07.2021	10.40 am	
23	09.07.2021	10.34 am	11.15 am	00.41 Hr	749	Refregator not working	microbiology	12.07.2021	12.15 pm	
24	09.07.2021	10.56 am	12.20 pm	01.24 Hr	391	LED Tubelight not working	OT Complex	10.07.2021	04.20 pm	
25	09.07.2021	01.50 pm	02.55 pm	01.05 Hr	748	Split AC not working	Microbiology	09.07.2021	03.15 pm	
26	09.07.2021	10.57 am	12.05 pm	01.08 Hr	392	LED Tubelight not working	OT Complex	09.07.2021	04.30 pm	
27	09.07.2021	10.40 am	12.55 pm	02.15 Hr	1616	Refregator not working	CCU+CVTS	12.07.2021	11.15 am	
28	09.07.2021	12.50 pm	03.10 pm	02.20 Hr	1615	LED 15 watt fitting working	CCU+CVTS	12.07.2021*	03.55 pm	
29	09.07.2021	10.40 am	11.55 am	01.15 Hr	1681	Switch Board not working	CVTS	10.07.2021	04.00 pm	
30	09.07.2021	12.35 pm	02.20 pm	01.45 Hr	360	Exhouast Fan not working	Psy.ward.	09.07.2021	03.05 pm	
31	10.07.2021	10.35 am	11.15 am	00.40 Hr	72	Cilling Fan not working	School of Physiology	10.07.2021	11.15 am	
32	10.07.2021	10.20 am	11.45 am	01.25 Hr	3236	Cilling Fan not working	Pead.ward	10.07.2021	01.10 pm	
33	10.07.2021	12.15 pm	12.55 pm	00.40 Hr	434	LED Light not working	Isolation ICU	12.07.2021	04.35 pm	
34	10.07.2021	10.00 am	10.55 am	00.55 Hr	2851	Cilling Fan not working	Pead.ward	10.07.2021	12.05 pm	
35	10.07.2021	02.35 pm	03.10 pm	00.35 Hr	2066	Extention Board not working	PICU	12.07.2021	10.15 am	
36	10.07.2021	11.16 am	12.55 pm	01.39 Hr	1448	LED Bulb not working	OBGY ICU	12.07.2021	03.05 pm	
37	10.07.2021	02.17 pm	03.20 pm	01.03 Hr	1682	Switch Board not working	CVTS	10.07.2021	04.30 pm	
38	10.07.2021	10.10 am	10.45 am	00.35 Hr	3216	Gizer not working	Ex.Deluxe	10.07.2021	03.30 pm	

39	11.07.2021	11.10 am	12.20 pm	01.10 Hr	2260	LED Tubelight & Cilling fan not working	Nephrology ward	12.07.2021	10.35 am	
Pending work										
1	08.06.2021	10.20 am	12.20 pm	02.00 Hr	1262	Motor not working 10Hp	Biomedical Dept.	05.07.2021	10.40 am	
2	16.06.2021	04.05 pm	04.25 pm	00.20 Hr	737	Refregator not working	Microbiology	12.07.2021	04.05 pm	
3	18.06.2021	03.45 pm	04.00 pm	00.15 Hr	739	Old Voltas AC Remove work	Microbiology	07.07.2021	11.35 am	
4	30.06.2021	11.10 am	11.25 am	00.15 Hr	2538	Split AC not working	Cardac OT	07.08.2021	04.10 pm	

Total Complaint	43
Pending Complaint	1
Complete Complaint	42
Complaint Precentage	98%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 21/06/2021 to 27/06/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmpaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	21.06.2021	11.20 am	11.50 am	00.30 Hr	1886	Cilling Fan not working	Covid-19 OPD	21.06.2021	12.45 pm	
2	21.06.2021	11.10 am	11.45 am	00.35 Hr	3233	Gizer not working	MCRI ICU	21.06.2021	12.20 pm	
3	21.06.2021	10.40 am	11.25 am	00.45 Hr	3221	Gizer not working	MCRI ICU Waiting area	21.06.2021	12.05 pm	
4	21.06.2021	11.44 am	12.10 pm	00.26 Hr	1678	Gizer not working	CCU+CVTS	21.06.2021	12.30 pm	
5	21.06.2021	11.00 am	11.45 am	00.45 Hr	2830	LED Light not working	Super Deluxe	21.06.2021	04.45 pm	
6	21.06.2021	10.55 am	11.20 am	00.25 Hr	1776	Cilling Fan not working	Male Ortho ward	21.06.2021	12.20 pm	
7	21.06.2021	12.23 pm	02.40 pm	02.17 Hr	2844	Cilling Fan not working	Pead.Dept.	23.06.2021	11.20 am	
8	21.06.2021	03.36 pm	03.36 pm	0	85	Extention board Replace	EMS ICU	21.06.2021	03.36 pm	
9	22.06.2021	09.30 am	09.55 am	00.25 Hr	1902	Gizer not working	House Keaping	22.06.2021	12.20 pm	
10	22.06.2021	09.30 am	09.55 am	00.25 Hr	2832	LED Tubelight not working	Super Deluxe	22.06.2021	10.30 am	
11	22.06.2021	02.15 pm	03.00 pm	00.45 Hr	2516	LED Tubelight not working	CSSD	22.06.2021	03.25 pm	
12	22.06.2021	10.38 am	12.50 pm	02.12 Hr	1436	Switch Board not working	OBYG ICU	22.06.2021	03.40 pm	
13	22.06.2021	12.35 pm	04.30 pm	03.55 Hr	1247	LED Light not working	OBYG ICU	23.06.2021	11.36 am	
14	23.06.2021	04.55 pm	05.00 pm	00.05 Hr	743	Split AC not working	Microbiology	24.06.2021	11.10 am	
15	23.06.2021	09.30 am	10.15 am	00.45 Hr	3795	Extention Board not working	Covid MICU	23.06.2021	01.50 pm	
16	23.06.2021	11.20 am	11.55 am	00.35 Hr	1248	LED Light not working	OBYG Ward	23.06.2021	04.35 pm	
17	23.06.2021	01.05 pm	02.30 pm	01.25 Hr	2298	Nsg.Call Bell system not working	Ex.Deluxe	24.06.2021	09.30 am	Bio.Dept work
18	23.06.2021	12.35 pm	12.55 pm	00.20 Hr	2507	LED Tubelight not working	Record Section	23.06.2021	02.35 pm	
19	23.06.2021	11.40 am	02.10 pm	02.20 Hr	2107	LED Tubelight not working	Time Office	23.06.2021	03.20 pm	
20	24.06.2021	11.30 am	11.30 am	0	2234	LED Bulb not working	MCRI ICU	24.06.2021	11.30 am	
21	24.06.2021	09.45 am	10.15 am	00.30 Hr	1929	LED Tubelight not working	Security Office	24.06.2021	11.10 am	
22	24.06.2021	10.20 am	11.10 am	00.50 Hr	2111	Water filter not working	HR Dept.	24.06.2021	12.30 pm	
23	24.06.2021	11.00 am	11.25 am	00.25 Hr	2109	LED Tubelight not working	HR Dept.	24.06.2021	11.25 am	
24	24.06.2021	12.00 pm	02.00 pm	02.00 Hr	1556	LED Tubelight & Switch Board not working,	Med.OPD	24.06.2021	02.45 pm	
25	24.06.2021	09.34 am	11.55 am	02.21 Hr	1426	Switch Board not working	NICU	24.06.2021	01.45 pm	
26	25.06.2021	02.50 pm	03.10 pm	00.20 Hr	2112	Lift No-06 Not working	Time Office	25.06.2021	04.10 pm	
27	25.06.2021	02.50 pm	03.10 pm	00.20 Hr	2113	Lift No-06 Not working	Time Office	25.06.2021	04.10 pm	
28	25.06.2021	10.15 am	10.35 am	00.20 Hr	704	Extension Board requirement	Kt ICU	25.06.2021	10.35 am	
29	25.06.2021	02.45 pm	03.15 pm	00.30 Hr	687	LED Light not working	SICU	26.06.2021	12.10 pm	
30	25.06.2021	10.30 am	12.55 pm	02.25 Hr	1304	Cilling Fan not working	MSW	25.06.2021	02.45 pm	
31	26.06.2021	11.35 am	12.15 pm	00.40 Hr	377	LED Tubelight not working	OT Complex	26.06.2021	01.15 pm	
32	26.06.2021	11.35 am	12.00 pm	00.25 Hr	376	LED Tubelight not working	OT Complex	26.06.2021	01.00 pm	
33	26.06.2021	12.35 pm	02.20 pm	01.45 Hr	3143	LED Tubelight not working	Ophthal ward	26.06.2021	03.40 pm	
34	26.06.2021	11.16 am	12.10 pm	00.54 Hr	2838	FCU Not working	Super Deluxe			Work in progress
35	26.06.2021	05.15 pm	05.30 pm	00.15 Hr	2116	Water filter not working	Time Office	27.06.2021	01.00 pm	
36	26.06.2021	11.20 am	11.50 am	00.30 Hr	235	LED Tubelight not working	SS OPD	28.06.2021	11.30 am	
37	26.06.2021	12.35 pm	02.15 pm	01.40 Hr	3144	Cilling Fan not working	ENT OPD	26.06.2021	03.45 pm	
38	26.06.2021	11.30 am	02.40 pm	03.10 Hr	3537	LED Light not working	Cardac OT	28.06.2021	02.30 pm	

39	26.06.2021	11.55 am	02.45 pm	02.50 Hr	402	Switch Board not working	Covid MICU	26.06.2021	04.00 pm	
40	26.06.2021	03.55 pm	04.15 pm	00.20 Hr	2974	Cilling Fan not working	Old Deluxe	26.06.2021	04.15 pm	
41	27.06.2021	07.40 am	09.30 am	01.50 Hr	2116	Lift No-06 Not working	Time Office	26.06.2021	04.00 pm	
Pending work										
1	05.06.2021	04.10 pm	04.30 pm	00.20 Hr	2391	Lift no-02 Not working	Time Office	24.06.2021	04.00 pm	
2	08.06.2021	10.20 am	12.20 pm	02.00 Hr	1262	Motor not working 10Hp	Biomedical Dept.			Work in progress
3	16.06.2021	04.05 pm	04.25 pm	00.20 Hr	737	Refregator not working	Microbiology			Work in progress
4	18.06.2021	03.45 pm	04.00 pm	00.15 Hr	739	Old Voltas AC Remove work	Microbiology			Work in progress

Total Complaint	45
Pending Complaint	4
Complete Complaint	41
Complaint Precentage	91%


M. A. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 28/06/2021 to 04/07/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	27.06.2021	10.00 am	10.15 am	00.15 Hr	3242	LED Light not working	MCRI ICU	30.06.2021	10.20 am	
2	28.06.2021	10.35 am	10.41 am	00.06 Hr	1662	Vision Volder not working	Ophthal OPD	28.06.2021	11.18 am	
3	28.06.2021	10.14 am	10.21 am	00.07 Hr	746	LED Tubelight not working	Central lab.	28.06.2021	10.30 am	
4	28.06.2021	11.55 am	12.05 pm	00.10 Hr	753	Cilling Fan not working	MCRI OPD-11	28.06.2021	12.45 pm	
5	28.06.2021	10.51 am	11.00 am	00.09 Hr	2118	Lift not working.	OPD	28.06.2021	11.30 am	
6	28.06.2021	09.10 am	11.00 am	01.10 Hr	2117	Lift No-03 not working	Time Office	28.06.2021	02.00 pm	
7	28.06.2021	04.30 pm	04.47 pm	00.17 Hr	1852	LED Light not working	Old Deluxe	29.06.2021	03.00 pm	
8	28.06.2021	03.20 pm	03.30 pm	00.10 Hr	2120	LED Light not working	Time Office	28.06.2021	03.36 pm	
9	28.06.2021	09.50 am	10.10 am	00.20 Hr	757/734	New Extention Board Requirement.	MCRI PRQ Cabin	28.06.2021	02.45 pm	
10	29.06.2021	11.00 am	11.15 am	00.15 Hr	3170	LED 15 watt fitting working	New Deluxe	01.07.2021	12.40 pm	
11	29.06.2021	11.00 am	11.30 am	00.30 Hr	2122	Lift No-06 Not working	Time Office	29.06.2021	12.35 pm	
12	29.06.2021	06.40 pm	06.55 pm	00.15 Hr	2123	Lift No-06 Not working	Time Office	30.06.2021	10.15 am	
13	29.06.2021	02.32 pm	03.10 pm	00.38 Hr	1231	LED 15 watt fitting working	MET Cell	30.06.2021	04.00 pm	
14	29.06.2021	10.20 am	11.00 am	00.40 Hr	3239	LED Light not working	MCRI ICU	29.06.2021	04.05 pm	
15	29.06.2021	10.22 am	11.10 am	00.48 Hr	3243	Cilling fan not working	MCRI ICU	29.06.2021	11.35 am	
16	30.06.2021	11.30 am	11.45 am	00.15 Hr	802	UPS Battery change	Central store	30.06.2021	12.04 pm	
17	30.06.2021	11.56 am	12.35 pm	00.39 Hr	1615	LED Light not working	Casulty	30.06.2021	03.00 pm	
18	30.06.2021	11.10 am	11.25 am	00.15 Hr	2538	Split AC not working	Cardac OT			Work in progress
19	30.07.2021	04.33 pm	05.00 pm	00.27 Hr	70	Extention Board not working	MGM SOP	01.07.2021	11.47 am	
20	30.06.2021	10.10 am	10.45 am	00.35 Hr	2839	LED 15 watt fitting working	Super Deluxe	30.06.2021	03.45 pm	
21	30.06.2021	12.16 pm	12.45 pm	00.29 Hr	2844	LED 15 watt fitting working	Super Deluxe	30.06.2021	03.55 pm	
22	30.06.2021	11.55 am	02.55 pm	03.00 Hr	1616	LED 15 watt fitting working	Casulty	30.06.2021	03.10 pm	
23	01.07.2021	10.55 am	11.15 am	00.20 Hr	441	LED Tubelight not working	Ortho OPD	01.07.2021	11.55 am	
24	01.07.2021	10.45 am	11.50 am	01.05 Hr	3207	Cilling Fan not working	Ex.Deluxe	01.07.2021	01.05 pm	
25	01.07.2021	11.30 am	02.15 pm	02.45 Hr	382	LED Tubelight not working	OT Complex	01.07.2021	02.45 pm	
26	01.07.2021	11.12 am	12.55 pm	01.43 Hr	2518	Air Cooler not working	CSSD	01.07.2021	02.50 pm	
27	01.07.2021	02.25 pm	02.25 pm	0	1534	LED Bulb not working	Metron Office	01.07.2021	02.25 pm	
28	02.07.2021	05.00 pm	05.20 pm	00.20 Hr	1618	LED 15 watt fitting working	Casulaty	02.07.2021	05.55 pm	
29	02.07.2021	11.49 am	12.15 pm	00.26 Hr	2061	AC Vent not working	PICU	03.07.2021	10.45 am	
30	02.07.2021	08.30 pm	09.00 pm	00.30 Hr	2126	Lift No-05 not working	Time Office	03.07.2021	09.05 am	
31	02.07.2021	10.40 am	11.25 am	00.45 Hr	2849	Cilling Fan not working	Super Deluxe	02.07.2021	03.15 pm	
32	03.07.2021	03.30 pm	04.15 pm	00.45 Hr	2127	Lift No-01 not working	Time Office	03.07.2021	05.00 pm	
33	04.07.2021	07.35 am	09.05 am	01.30 Hr	2129	Lift No-06 Not working	Time Office	04.07.2021	11.00 am	
Pending work										
1	08.06.2021	10.20 am	12.20 pm	02.00 Hr	1262	Motor not working 10Hp	Biomedical Dept.			Work in progress
2	16.06.2021	04.05 pm	04.25 pm	00.20 Hr	737	Refregator not working	Microbiology			Work in progress
3	18.06.2021	03.45 pm	04.00 pm	00.15 Hr	739	Old Voltas AC Remove work	Microbiology			Work in progress
4	26.06.2021	11.16 am	12.10 pm	00.54 Hr	2838	FCU Not working	Super Deluxe	27.06.2021	04.20 pm	

Total Complaint	37
Pending Complaint	.4
Complete Complaint	33
Complaint Precentage	89%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 14/06/2021 to 20/06/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	14.06.2021	12.00 pm	12.20 pm		732	LED Tubelight not working	Microbiology	14.06.2021	12.35 pm	
2	14.06.2021	10.25 am	10.50 am		224	LED Tubelight not working	OT Complex	14.06.2021	11.15 am	
3	14.06.2021	02.36 pm	02.55 pm		230	Cilling Fan not working	OPD	15.06.2021	04.20 pm	
4	14.06.2021	09.30 am	09.45 am		2397	Lift not working-OPD	Time Office	14.06.2021	11.25 am	
5	15.06.2021	03.30 pm	04.20 pm		2398	Lift not working No-01	Time Office	15.06.2021	06.20 pm	
6	15.06.2021	11.00 am	11.30 am		1660	Camera wire laying work	Blood bank	18.06.2021	04.00 pm	
7	16.06.2021	09.55 am	10.05 am		1414	Tharmameter not working	NICU	16.06.2021	10.05 am	
8	16.06.2021	09.40 am	10.10 am		736	Electrical problame	Linen Dept.	16.06.2021	10.10 am	
9	16.06.2021	12.40 am	12.40 am		2636	Tharmameter not working	MJPJAY ward	16.06.2021	12.45 pm	
10	16.06.2021	10.40 am	02.20 pm		1648	Insect Tubelight not working	Blood bank	16.06.2021	04.15 pm	
11	16.06.2021	08.05 am	09.20 am		2399	Lift not working No-01	Time Office	16.06.2021	09.45 am	
12	16.06.2021	04.05 pm	04.25 pm		737	Refregator not working	Microbiology			Work in progress
13	17.06.2021	08.45 am	09.20 am		letter	Lift not working No-01	Time Office	17.06.2021	10.20 am	
14	17.06.2021	11.55 am	02.35 pm		1846	LED Light not working	Old Deluxe	17.06.2021	04.00 pm	
15	17.06.2021	12.20 pm	02.55 pm		2249	Cilling Fan not working	Nephrology ward	17.06.2021	04.55 pm	
16	17.06.2021	02.00 pm	04.15 pm		3157	LED Light not working	New Deluxe	18.06.2021	01.00 pm	
17	17.06.2021	12.00 pm	03.20 pm		1847	Cilling Fan not working	Old Deluxe	17.06.2021	04.35 pm	
18	18.06.2021	09.15 am	09.45 am		2851	Switch Board not working	Quality Department	18.06.2021	10.30 am	
19	18.06.2021	10.15 am	11.35 am		739	LED Tubelight not working	MCRI OPD	18.06.2021	12.30 pm	
20	18.06.2021	11.30 am	11.45 am		741	LED Tubelight not working	MCRI OPD	18.06.2021	12.00 pm	
21	18.06.2021	02.45 pm	03.00 pm		1676	Gizer not working	CCU+CVTS	18.06.2021	03.00 pm	
22	18.06.2021	03.45 pm	04.00 pm		739	Old Voltas AC Remove work	Microbiology			Work in progress
23	19.06.2021	11.40 am	12.20 pm		1848	Gizer not working	Old Deluxe	19.06.2021	01.10 pm	
Pending work										
1	05.06.2021	04.10 pm	04.30 pm	00.20 Hr	2391	Lift no-02 Not working	Time Office			Light & Fan Probleme
2	08.06.2021	10.20 am	12.20 pm	02.00 Hr	1262	Motor not working 10Hp	Biomedical Dept.			Work in progress
3	08.06.2021	11.25 am	12.10 pm	00.45 Hr	360	Focus lamp not working	OT Complex	18.06.2021	02.40 pm	

Total Complaint	26
Pending Complaint	4
Complete Complaint	22
Complaint Precentage	85%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 07/06/2021 to 13/06/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	07.06.2021				Project	Cilling fan-04,LED Tubelight & Switch board fitting work	Nephrology ward	07.06.2021	03.20 pm	
2	07.06.2021	10.50 am	10.55 am	00.05 Hr	2056	AC Vent not working	PICU	07.06.2021	11.25 am	
3	07.06.2021	06.15 pm	06.35 pm	00.20 Hr	208	Cilling Fan not working	TL ward	07.06.2021	06.35 pm	
4	07.06.2021	10.20 am	10.20 am	0	1835	Thermameter not working	Old Deluxe	09.07.2021	02.35 pm	
5	07.06.2021	10.22 am	11.50 am	01.28 Hr	1836	Room Heater not working	Old Deluxe	09.07.2021	02.35 pm	
6	08.06.2021	10.10 am	11.15 am	01.05 Hr	207	X-Ray Box not working	RGY ICU	08.06.2021	01.15 pm	
7	08.06.2021	10.20 am	11.10 am	00.50 Hr	1609	Table fan not working	CVTS	08.06.2021	11.45 am	
8	08.06.2021	10.20 am	12.20 pm	02.00 Hr	1262	Motor fan not working 10Hp	Biomedical Dept.			Work in progress
9	08.06.2021	12.30 pm	02.10 pm	02.20 Hr	222	Switch Board not working	SICU	08.06.2021	03.05 pm	
10	08.06.2021	10.45 am	11.15 am	00.30 Hr	38	Water filter not working	Central Laibrary	08.06.2021	12.10 pm	
11	08.06.2021	11.25 am	12.10 pm	00.45 Hr	360	Focus lamp not working	OT Complex			Work in progress
12	08.06.2021	11.23 am	12.10 pm	00.47 Hr	1881	Cilling Fan not working	Covid-19 OPD	08.06.2021	01.00 pm	
13	09.06.2021	12.35 pm	12.40 pm	00.05 Hr	2440	Switch Board not working	Isolation ICU	09.06.2021	01.00 pm	
14	09.06.2021	11.40 am	12.10 pm	00.30 Hr	1124	Focus lamp not working	Labour Room	09.06.2021	01.10 pm	
15	09.06.2021	11.41 am	12.20 pm	00.39 Hr	1125	LED Bulb not working	Labour Room	09.06.2021	01.00 pm	
16	09.06.2021	11.00 am	02.05 pm	03.05 Hr	2631	LED Tubelight not working	TL ward	10.06.2021	05.00 pm	
17	09.06.2021	02.15 pm	02.40 pm	00.25 Hr	1674	Gizer not working	CCU	09.06.2021	04.40 pm	
18	09.06.2021	11.05 am	02.30 pm	03.25 Hr	1769	LED Tubelight not working	Male Ortho ward	10.06.2021	10.45 am	
19	10.06.2021	11.20 am	11.45 am	00.25 Hr	4038	Cilling Fan not working	OBGY OPD	10.06.2021	12.02 pm	
20	10.06.2021	01.01 pm	02.45 pm	01.44 Hr	367	LED Tubelight not working	OT Complex	11.06.2021	03.30 pm	
21	10.06.2021	04.00 pm	05.10 pm	01.10 Hr	2278	Switch Board not working	Ex.Deluxe	11.06.2021	03.34 pm	
22	10.06.2021	04.00 pm	04.50 pm	00.50 Hr	2279	Cilling Fan not working	Ex.Deluxe	12.06.2021	11.25 am	
23	10.06.2021	09.40 am	09.55 am	00.15 Hr	176	VRV Casset unit-01 not working	Radiology	10.06.2021	11.10 am	
24	10.06.2021	01.30 pm	02.00 pm	00.30 Hr	1272	X-Ray Box not working	Casulaty	10.06.2021	02.15 pm	
25	10.06.2021	10.35 am	02.40 pm	04.05 Hr	2633	LED Bulb not working	TL ward	10.06.2021	05.25 pm	
26	11.06.2021	09.20 am	09.45 am	00.25 Hr	475	Cilling Fan not working	TB Chest OPD	11.06.2021	10.15 am	
27	11.06.2021	11.50 am	12.20 pm	00.30 Hr	1761	Cilling Fan not working	Ortho Ward	11.06.2021	12.45 pm	
28	11.06.2021	01.31 pm	01.50 pm	00.19 Hr	2443	Switch Board not working	Isolation ICU	11.06.2021	01.50 pm	
29	11.06.2021	10.35 am	12.20 pm	01.45 Hr	1840	Cilling Fan not working	Old Deluxe	11.06.2021	03.05 pm	
30	11.06.2021	02.00 pm	02.30 pm	00.30 Hr	700	Electrical problame	Linen Dept.	11.06.2021	03.00 pm	
31	11.06.2021	10.46 am	11.45 am	00.59 Hr	869	LED Light not working	Anatomy	12.06.2021	11.00 am	
32	11.06.2021	10.49 am	02.10 pm	03.21 Hr	2961	LED Light not working	Hemotology	12.06.2021	04.16 pm	
33	11.06.2021	12.30 pm	01.05 pm	00.35 Hr	1772	LED Light not working	Male Ortho ward	12.06.2021	10.20 am	
34	11.06.2021	09.45 am	10.20 am	00.35 Hr	2394	Lift No-06 Not working	Time Office	11.06.2021	12.20 pm	
35	11.06.2021	11.50 am	12.40 pm	00.50 Hr	1771	Exhouast Fan not working	Male Ortho ward	12.06.2021	09.45 am	
36	11.06.2021	02.00 pm	02.45 pm	00.45 Hr	730	X-Ray Box not working	MCRI OPD	12.06.2021	02.12 pm	

37	12.06.2021	11.46 am	02.55 pm	03.09 Hr	3790	Switch Board not working	MICU	12.06.2021	05.30 pm	
38	12.06.2021	02.30 pm	02.55 pm	00.25 Hr	2283	Water filter not working	Ex.Deluxe	12.06.2021	03.45 pm	
39	12.06.2021	10.20 am	11.10 am	00.50 Hr	2395	Water filter not working	Time Office	12.06.2021	02.20 pm	
40	12.06.2021	10.50 am	11.20 am	00.30 Hr	2396	Water filter not working	7th floor	12.06.2021	04.00 pm	
41	12.06.2021	11.35 am	12.20 am	00.45 Hr	184	Split AC not working	RGY ICU	12.06.2021	02.40 pm	
42	12.06.2021	02.55 pm	03.40 pm	00.45 Hr	2411	AC Water lickege	Central Research Dept.	13.06.2021	10.20 am	
Pending work										
1	04.06.2021	12.10 pm	12.45 pm	00.35 Hr	511	Refregator not working	Isolation ICU	07.06.2021	12.10 pm	
2	05.06.2021	04.10 pm	04.30 pm	00.20 Hr	2391	Lift no-02 Not working	Time Office			Light & Fan Probleme

Total Complaint	44
Pending Complaint	3
Complete Complaint	41
Complaint Precentage	93%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 31/05/2021 to 06/06/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	31.05.2021	09.30 am	10.20 am	00.50 Hr	710	AC not working	MCRI OPD	31.05.2021	11.45 am	
2	01.06.2021	10.20 am	11.20 am	01.00 Hr	2962	Switch Board not working	Old Deluxe	01.06.2021	12.10 pm	
3	01.06.2021	11.20 am	12.10 pm	00.50 Hr	1238	LED Tubelight & Switch Board not working,	OBGY Ward	01.06.2021	04.35 pm	
4	01.06.2021	02.30 pm	02.50 pm	00.20 Hr	356	Switch Board not working	OT Complex	03.06.2021	03.50 pm	
5	01.06.2021	02.30 pm	02.35 pm	00.05 Hr	355	Switch Board not working	OT Complex	01.06.2021	02.35 pm	
6	01.06.2021	02.20 pm	02.55 pm	00.35 Hr	1604	AC not working	CCU	01.06.2021	03.10 pm	
7	01.06.2021	12.10 pm	04.10 pm	04.00 Hr	1940	Cilling Fan not working	Pharmacology	03.06.2021	09.45 am	
8	01.06.2021	03.20 pm	03.55 pm	00.35 Hr	639	AC not working	CATH-LAB	01.06.2021	05.00 pm	
9	01.06.2021	11.20 am	12.10 pm	00.50 Hr	2385	Water cooler not working	Time Office	03.06.2021	12.20 pm	
10	01.06.2021	09.35 am	09.55 am	00.20 Hr	894	Cilling Fan not working	Central lab.	03.06.2021	10.45 am	
11	01.06.2021	10.30 am	11.20 am	00.50 Hr	2386	Lift No-06 Not working	Time Office	01.06.2021	11.20 am	
12	01.06.2021	03.45 pm	04.10 pm	00.25 Hr	698	LED Tubelight not working	Linen Dept.	02.06.2021	10.30 am	
13	02.06.2021	11.05 am	11.20 am	00.15 Hr	592	LED Tubelight not working	PSM Dept.	02.06.2021	11.40 am	
14	02.06.2021	03.40 pm	05.10 pm	01.30 Hr	1123	OT Lamp not working	Labour Room	03.06.2021	01.15 pm	
15	02.06.2021	02.35 pm	02.45 pm	00.10 Hr	357	Switch Board not working	OT Complex	02.06.2021	02.45 pm	
16	02.06.2021	10.45 am	11.15 am	00.30 Hr	1330	AC not working	Dialysis	02.06.2021	12.10 pm	
17	02.06.2021	12.25 pm	12.55 pm	00.30 Hr	1121	LED Bulb not working	Labour Room	03.06.2021	12.55 pm	
18	03.06.2021	03.15 pm	03.30 pm	00.15 Hr	358	Switch Board not working	OT Complex	03.06.2021	03.30 pm	
19	03.06.2021	10.20 am	10.45 am	00.25 Hr	896	AC not working	Central Lab.	03.06.2021	11.45 am	
20	03.06.2021	02.30 pm	03.30 pm	01.00 Hr	676	Switch Board not working	SICU	03.06.2021	04.10 pm	
21	03.06.2021	11.20 am	11.45 am	00.25 Hr	735	Split AC not working	Central Lab.	03.06.2021	12.20 pm	
22	04.06.2021	10.20 am	10.45 am	00.25 Hr	641	Switch Board not working	EMS ICU	04.06.2021	10.45 am	
23	04.06.2021	11.40 am	02.45 pm	03.05 Hr	474	LED Tubelight & X-Ray box not working	TB Chest OPD	05.06.2021	10.35 am	
24	04.06.2021	10.15 am	12.20 pm	02.05 Hr	1549	Switch Board not working	Medicin OPD	05.06.2021	02.25 pm	
25	04.06.2021	11.05 am	12.20 pm	01.15 Hr	1552	Switch Board not working	Medicin OPD	05.06.2021	02.25 pm	
26	04.06.2021	12.10 pm	12.45 pm	00.35 Hr	511	Refregator not working	Isolation ICU			Work in progress
27	04.06.2021	11.10 am	11.35 am	00.25 Hr	510	Switch Board not working	Isolation ICU	04.06.2021	11.35 am	
28	05.06.2021	10.05 am	10.25 am	00.20 Hr	1551	LED Tubelight not working	Medicin OPD	05.06.2021	11.15 am	
29	05.06.2021	04.10 pm	04.30 pm	00.20 Hr	2391	Lift no-02 Not working	Time Office			Light & Fan Probleme
Pending work										
1	19.05.2021	03.38 pm	04.15 pm	00.37 Hr	161	Electrical New Work	Radiology Dept	01.06.2021	04.20 pm	
2	29.05.2021	10.59 am	11.15 am	00.16 Hr	2305	Refregator not working	Medical Store	02.06.2021	04.00 pm	

Total Complaint	31
Pending Complaint	2
Complete Complaint	29
Complaint Precentage	94%


M.V. Gaiwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 24/05/2021 to 30/05/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	24.05.2021	10.20 am	10.40 am		2382	Electrical New Work	Time Office	24.05.2021	10.40 am	
2	24.05.2021	10.10 am	10.45 am		1875	Cilling Fan not working	Covid-19 OPD	24.05.2021	11.30 am	
3	24.05.2021	11.31 am	02.40 pm		1872	Wall fan not working	Covid-19 OPD	26.05.2021	11.30 am	
4	24.05.2021	10.30 am	11.30 am		2381	Refregator not working	Time Office	27.05.2021	12.15 pm	
5	24.05.2021	10.45 am	11.10 am		2118	Pedastrail fan not working	Resistration Dept.	24.05.2021	11.10 am	
6	24.05.2021	10.40 am	10.55 am		2514	Switch Board not working	CSSD	24.05.2021	11.00 am	
7	24.05.2021	02.30 pm	03.00 pm		175	Wind Blower not working	RGY ICU	24.05.2021	03.20 pm	
8	24.05.2021	02.10 pm	03.07 pm		387	Cilling Fan not working	OBGY Ward	24.05.2021	03.07 pm	
9	24.05.2021	10.51 am	12.10 pm		3955	Switch Board not working	Covid-19 Opthal ward	24.05.2021	04.35 pm	
10	24.05.2021	09.45 am	10.15 am		2960	LED Light not working	Hemotology	24.05.2021	10.55 am	
11	24.05.2021	10.45 am	11.15 am		885	Cilling Fan not working	Central Lab.	24.05.2021	11.30 am	
12	25.05.2021	12.30 pm	02.32 pm		1257	LED Tubelight not working	Casulaty	25.05.2021	03.30 pm	
13	25.05.2021	12.55 pm	02.45 pm		1828	Switch Board not working	Old Deluxe	26.05.2021	03.10 pm	
14	25.05.2021	11.10 am	12.10 pm		3780	AC not working	MICU	25.05.2021	12.45 pm	
15	25.05.2021	03.00 pm	03.20 pm		672	AC not working	SICU	25.05.2021	05.00 pm	
16	25.05.2021	02.30 pm	03.01 pm		176	Split AC not working	RGY ICU	25.05.2021	04.00 pm	
17	26.05.2021	10.45 am	10.45 am		41	Exhouast Fan not working	Endoscopy	26.05.2021	11.15 am	
18	26.05.2021	11.35 am	12.10 pm		1652	Refregator not working	Blood bank	27.05.2021	03.20 pm	
19	26.05.2021	11.30 am	12.10 pm		2245	Switch Board not working	Nephrology ward	26.05.2021	02.45 pm	
20	26.05.2021	01.45 pm	02.00 pm		1429	LED Light not working	OBGY ICU	26.05.2021	02.39 pm	
21	27.05.2021	09.10 am	09.30 am		1669	LED 15 watt fitting working	CVTS	27.05.2021	10.55 am	
22	27.05.2021	12.05 pm	12.45 pm		2266	aC not working	EICU	27.05.2021	02.00 pm	
23	27.05.2021	04.30 pm	04.45 pm		1654	Split AC not working	Blood bank	27.05.2021	05.10 pm	
24	27.05.2021	10.45 am	10.55 am		letter	LED Tubelight not working	Physiotherapy	27.05.2021	10.55 am	
25	27.05.2021	05.00 pm	05.15 pm		1655	LED Tubelight not working	Blood bank	27.05.2021	05.30 pm	
26	28.05.2021	12.11 pm	02.40 pm		3496	Switch Board not working	MMW	28.05.2021	03.00 pm	
27	28.05.2021	10.20 am	11.15 am		3150	Extention board not working	New Deluxe	28.05.2021	12.15 pm	
28	29.05.2021	09.45 am	10.10 am		353	LED Tubelight not working	OT Complex	29.05.2021	11.15 am	
29	29.05.2021	03.20 pm	03.30 pm		2384	AC not working	Time Office	30.05.2021	09.30 am	
30	29.05.2021	09.45 am	10.30 am		354	Switch Board not working	OT Complex	29.05.2021	11.40 am	
31	29.05.2021	09.10 am	11.15 am		2248	LED Tubelight not working	Nephrology ward	29.05.2021	11.55 am	
32	29.05.2021	09.20 am	10.10 am		169	AC not working	Radiology Dept	29.05.2021	11.00 am	
33	29.05.2021	12.15 pm	02.15 pm		591	LED Tubelight not working	PSM Dept.	29.05.2021	02.40 pm	
34	29.05.2021	01.21 pm	02.45 pm		3152	LED Light not working	Urology Dept.	29.05.2021	03.30 pm	
35	29.05.2021	10.59 am	11.15 am		2305	Refregator not working	Medical Store			Work in progress
36	29.05.2021	01.20 pm	02.55 pm		3151	Cilling Fan not working	Urology Dept.	29.05.2021	03.45 pm	
37	29.05.2021	11.40 am	12.20 pm		1239	LED Light not working	OBGY Ward	29.05.2021	02.40 pm	

38	31.05.2021	11.45 am	12.15 pm		1877	LED Light & Switch Board not working	Covid-19 OPD	31.05.2021	01.00 pm	
39	31.05.2021	02.45 pm	03.00 pm		2410	Ceiling Fan not working	Central Research Dept.	31.05.2021	03.00 pm	
Pending work										
1	10.05.2021	03.30 pm	04.10 pm	00.40 Hr	817	AC not working	2D Eco Dept.	25.05.2021	12.10 pm	
2	19.05.2021	12.05 pm	02.10 pm	00.05 Hr	1938	Split AC not working	Pharmacology	25.05.2021	04.10 pm	
3	19.05.2021	03.38 pm	04.15 pm	00.37 Hr	161	Electrical New Work	Radiology Dept			Work in progress

Total Complaint	42
Pending Complaint	2
Complete Complaint	40
Complaint Percentage	95%


M. V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 17/05/2021 to 23/05/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	17.05.2021	12.15 pm	12.25 pm	00.10 Hr	2528	LED Tubelight not working	Cardiac OT	17.05.2021	02.46 pm	
2	17.05.2021	11.20 am	11.45 am	00.25 Hr	505	Pedstroal Fan Not working	Isolation ICU	17.05.2021	04.10 pm	
3	17.05.2021	11.20 am	11.55 am	00.35 Hr	729	Split AC not working	Microbiology	18.05.2021	10.45 am	
4	17.05.2021	01.20 pm	03.20 pm	02.00 Hr	1132	Electrical problame	5th floor deluxe	17.05.2021	04.00 pm	
5	17.05.2021	01.15 pm	03.00 pm	01.45 Hr	1130	Switch Board not working	5th floor deluxe	17.05.2021	03.15 pm	
6	18.05.2021	09.46 am	11.36 am	01.50 Hr	1212	Cilling Fan not working	Urology ward	18.05.2021	01.00 pm	
7	18.05.2021	04.21 pm	04.49 pm	00.28 Hr	1250	Switch Board not working	Casulaty	18.05.2021	05.00 pm	
8	18.05.2021	11.35 am	12.20 pm	00.45 Hr	171	Blower not working	RGY ICU	20.05.2021	04.15 pm	
9	19.05.2021	10.30 am	11.10 am	00.40 Hr	2262	LED Light not working	EICU	19.05.2021	11.45 am	
10	19.05.2021	09.52 am	10.15 am	00.23 Hr	1649	Split AC not working	Blood bank	19.05.2021	11.35 am	
11	19.05.2021	12.30 pm	12.49 pm	00.19 Hr	340	LED Tubelight not working	OT Complex	19.05.2021	01.00 pm	
12	19.05.2021	09.31 am	10.04 am	00.33 Hr	2375	Motor not working	Fountain	19.05.2021	11.20 am	
13	19.05.2021	12.00 pm	12.15 pm	00.15 Hr	341	Switch Board not working	OT Complex	19.05.2021	12.45 pm	
14	19.05.2021	12.05 pm	02.10 pm	00.05 Hr	1938	Split AC not working	Pharmacology			Work in progress
15	19.05.2021	03.38 pm	04.15 pm	00.37 Hr	161	Electrical New Work	Radiology Dept			Work in progress
16	19.05.2021	11.20 am	12.10 pm	00.50 Hr	letter	2 x 2 LED Panel Requirement	Registrar Cabin	19.05.2021	12.10 pm	
17	19.05.2021	10.20 am	11.10 am	00.50 Hr	1871	Wall fan not working	Covid-19 OPD	19.05.2021	10.35 am	
18	20.05.2021	10.00 am	10.55 am	00.45 Hr	2298	LED Tubelight not working	Ophthal OPD	20.05.2021	10.35 am	
19	20.05.2021	11.35 am	02.40 pm	03.05 Hr	549	LED Tubelight not working	FMW	20.05.2021	04.00 pm	
20	20.05.2021	11.25 am	02.35 pm	03.10 Hr	4575	LED Tubelight not working	Biochemistry Dept.	20.05.2021	03.00 pm	
21	20.05.2021	10.30 am	10.30 am	0	172	Split AC not working	RGY ICU	21.05.2021	11.00 am	
22	20.05.2021	11.20 am	03.00 pm	03.40 Hr	343	LED Tubelight not working	OT Complex	21.05.2021	03.00 pm	
23	21.05.2021	09.15 am	11.00 am	01.45 Hr	173	Exhouast Fan not working	RGY ICU	21.05.2021	11.30 am	
24	21.05.2021	05.00 pm	05.30 pm	00.30 Hr	1827	LED Light not working	Old Deluxe	22.05.2021	04.00 pm	
25	21.05.2021	05.30 pm	05.45 pm	00.15 Hr	1002	LED Tubelight not working	MMW	22.05.2021	09.45 am	
26	21.05.2021	09.20 am	09.45 am	00.15 Hr	215	Pedstroal Fan Not working	Resistration Dept.	21.05.2021	10.30 am	
27	22.05.2021	03.30 pm	03.45 pm	00.15 Hr	3770	Switch Board not working	MICU	22.05.2021	04.00 pm	
28	22.05.2021	01.34 pm	03.20 pm	01.46 Hr	1001	Switch Board not working	Medicin OPD	22.05.2021	04.45 pm	
29	22.05.2021	11.35 am	02.40 pm	03.05 Hr	1252	Switch Board not working	Casulaty	22.05.2021	03.20 pm	
30	22.05.2021	02.35 pm	02.40 pm	00.05 Hr	2117	Tubelight & Cilling Fan not working	OPD	22.05.2021	04.10 pm	
31	22.05.2021	05.30 pm	05.45 pm	00.15 Hr	3202	Exhouast Fan not working	Ex.Deluxe	23.05.2021	02.30 pm	
32	22.05.2021	04.00 pm	04.50 pm	00.50 Hr	3769	LED Tubelight not working	MICU	23.05.2021	04.10 pm	
Pending work										
1	10.05.2021	12.10 pm	02.30 pm	02.20 Hr	613	Wall fan not working	EMS ICU	21.05.2021	11.35 am	
2	10.05.2021	03.30 pm	04.10 pm	00.40 Hr	817	AC not working	2D Eco Dept.			Work in progress
3	11.05.2021	11.40 am	11.55 am	00.15 Hr	612/616	Thermameter not working	EMS ICU	19.05.2021	04.10 pm	
4	12.05.2021	11.50 am	02.40 pm	02.50 Hr	1650	Split AC not working	Blood bank	19.05.2021	02.40 pm	

5	14.05.2021	11.05 am	12.10 pm	01.05 Hr	170	Split AC not working	RGY ICU	19.05.2021	12.20 pm	
6	15.05.2021	09.46 am	10.35 am	00.49 Hr	391	Refregator not working	Urology Dept.	19.05.2021	03.20 pm	

Total Complaint	38
Pending Complaint	3
Complete Complaint	35
Complaint Precentage	92%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 10/05/2021 to 16/05/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	10.05.2021	12.35 pm	12.40 pm	00.05 Hr	611	Wall fan not working	EMS ICU	10.05.2021	01.05 pm	
2	10.05.2021	03.00 pm	04.35 pm	01.35 Hr	1664	LED Tubelight not working	CVTS	11.05.2021	10.45 am	
3	10.05.2021	04.00 pm	04.45 pm	00.45 Hr	1232	Air Cooler not working	OBGY Ward	12.05.2021	01.30 pm	
4	10.05.2021	12.10 pm	02.30 pm	02.20 Hr	613	Wall fan not working	EMS ICU			Work in progress
5	10.05.2021	03.30 pm	04.10 pm	00.40 Hr	817	AC not working	2D Eco Dept.			Work in progress
6	10.05.2021	10.33 am	02.20 pm	03.47 Hr	2620	LED light & cilling Fan not working	Pls/Urology ward	11.05.2021	12.30 pm	
7	10.05.2021	11.00 am	11.15 am	00.15 Hr	1757	LED Tubelight not working	M.Ortho ward	10.05.2021	11.25 am	
8	10.05.2021	10.00 am	12.20 pm	02.20 Hr	2809	LED light not working	Super Deluxe	11.05.2021	09.10 am	
9	10.05.2021	12.45 pm	02.30 pm	01.45 Hr	1861	Cilling Fan not working	Covid-19 OPD	10.05.2021	04.10 pm	
10	11.05.2021	09.05 am	09.10 am	00.05 Hr	2810	Electrical problame	Super Deluxe	11.05.2021	09.10 am	
11	11.05.2021	11.05 am	11.35 am	00.30 Hr	1606	VRV 1 unit sensor not working	Casulty ICU	12.05.2021	03.20 pm	
12	11.05.2021	11.40 am	11.55 am	00.15 Hr	612/616	Thermameter not working	EMS ICU			Work in progress
13	11.05.2021	11.30 am	12.20 pm	00.50 Hr	2116	Telephone cable laying work.	Registration counter	13.05.2021	02.40 pm	
14	11.05.2021	10.00 am	10.45 am	00.45 Hr	1666	LED Tubelight not working	CCU	11.05.2021	11.05 am	
15	11.05.2021	10.02 am	11.10 am	01.08 Hr	658	LED Light not working	SICU	11.05.2021	12.10 pm	
16	11.05.2021	01.40 pm	02.30 pm	00.50 Hr	1545	Cat-6 Cable Requirement	Medicin OPD	11.05.2021	03.45 pm	
17	12.05.2021	11.50 am	02.40 pm	02.50 Hr	1650	Split AC not working	Blood bank			Work in progress
18	12.05.2021	11.45 am	12.20 pm	00.35 Hr	333	Switch Board not working	OT Complex	12.05.2021	01.05 pm	
19	12.05.2021	11.20 am	01.00 pm	01.40 Hr	1233	Cilling Fan not working	OBGY Ward	12.05.2021	02.20 pm	
20	12.05.2021	11.45 am	03.00 pm	03.15 Hr	3211	LED light & cilling Fan not working	MCRI ICU	12.05.2021	03.30 pm	
21	14.05.2021	05.40 pm	05.45 pm	00.05 Hr	624	Switch Board not working	EMS ICU	14.05.2021	05.55 pm	
22	14.05.2021	11.05 am	12.10 pm	01.05 Hr	170	Split AC not working	RGY ICU			Work in progress
23	15.05.2021	10.25 am	10.30 am	00.05 Hr	818	LED light & cilling Fan not working	2D Eco Dept.	15.05.2021	10.30 am	
24	15.05.2021	08.29 am	09.40 am	01.11 Hr	2371	Lift no-02 Not working	Time Office	15.05.2021	12.30 pm	
25	15.05.2021	10.00 am	10.45 am	00.45 Hr	2582	Switch Board not working	NICU	17.05.2021	12.30 pm	
26	15.05.2021	09.47 am	10.00 am	00.13 Hr	392	Cilling Fan not working	Urology Dept.	15.05.2021	10.20 am	
27	15.05.2021	03.00 pm	03.30 pm	00.30 Hr	1252	Pedastral fan not working	Biomedical Dept.	15.05.2021	04.10 pm	
28	15.05.2021	09.46 am	10.35 am	00.49 Hr	391	Refregator not working	Urology Dept.			Work in progress
29	16.05.2021	03.30 pm	03.45 pm	00.15 Hr	3143	Switch Board not working	New Deluxe	16.05.2021	03.45 pm	

Total Complaint	29
Pending Complaint	6
Complete Complaint	23
Complaint Precentage	79%


M. K. Raikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 03/04/2021 to 09/05/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	02.05.2021	11.00 am	02.45 pm	03.45 Hr	2355	LED light not working	Time Office	03.05.2021	03.00 pm	
2	03.05.2021	10.25 am	11.35 am	01.10 Hr	2354	LED light not working	Time Office	03.05.2021	02.30 pm	
3	03.05.2021	11.56 am	12.46 pm	00.50 Hr	1858	Wall fan not working	Covid-19 OPD	04.05.2021	11.05 am	
4	03.05.2021	10.15 am	10.20 am	00.05 Hr	891	LED light not working	Central Lab.	04.05.2021	10.30 am	
5	03.05.2021	10.50 am	11.10 am	00.20 Hr	319	LED Tubelight not working	OT Complex	03.05.2021	03.15 pm	
6	03.05.2021	11.50 am	12.35 pm	00.45 Hr	2114	Cilling Fan not working	OPD Registration	03.05.2021	02.30 pm	
7	05.05.2021	11.00 am	12.15 pm	01.15 Hr	3756	Switch Board not working	MICU	05.05.2021	03.30 pm	
8	05.05.2021	02.30 pm	02.45 pm	00.15 Hr	223	LED Tubelight not working	OPD S.S.	06.05.2021	03.00 pm	
9	06.05.2021	10.55 am	11.20 am	00.25 Hr	2431	Cilling Fan not working	Isolation ICU	06.05.2021	11.40 am	
10	06.05.2021	10.20 am	10.45 am	00.25 Hr	168	AC not working.	RGY ICU	07.05.2021	11.45 am	
11	06.05.2021	11.10 am	11.55 am	00.45 Hr	34	LED Bulb not working	Central Laibrary	06.05.2021	12.15 pm	
12	06.05.2021	11.17 am	12.10 pm	00.53 Hr	325	Switch Board not working	OT Complex	08.05.2021	04.10 pm	
13	06.05.2021	10.25 am	11.35 am	01.10 Hr	2365	Water coolar not working	Time Office	08.05.2021	02.10 pm	
14	07.05.2021	05.10 pm	05.30 pm	00.20 Hr	606	Cilling Fan not working	EMS ICU	08.05.2021	12.00 pm	
15	07.05.2021	10.25 am	12.10 pm	00.45 Hr	4035	Cilling fan not working	OBYG OPD	07.05.2021	03.20 pm	
16	07.05.2021	05.00 pm	05.15 pm	00.15 Hr	letter	Pedastral fan Instalation	EMS ICU	07.05.2021	05.30 pm	
17	07.05.2021	03.10 pm	03.25 pm	00.15 Hr	35	Water coolar sound probleme.	Central Laibrary	08.05.2021	11.55 pm	
18	08.05.2021	09.50 am	10.20 am	00.30 Hr	66	LED Tubelight not working	ENT OPD	08.05.2021	10.45 am	
19	08.05.2021	12.10 pm	12.55 pm	00.45 Hr	472	Cilling Fan not working	TB Chest OPD	08.05.2021	03.45 pm	
20	08.05.2021	03.42 pm	03.45 pm	00.03 Hr	609	Pedastral fan not working	EMS ICU	08.05.2021	03.45 pm	
21	08.05.2021	11.00 am	12.10 pm	01.10 Hr	1229	Cilling Fan not working	OBYG Ward	08.05.2021	03.30 pm	
22	08.05.2021	10.50 am	11.55 am	01.05 Hr	1823	Wall fan not working	Old Deluxe	08.05.2021	02.30 pm	
Pending work										
1	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy	04.05.2021	11.55 am	
2	19.04.2021	12.00 pm	12.03 pm	00.03 Hr	2507	Air Cooler not working	CSSD	05.05.2021	05.00 pm	
3	29.04.2021	11.40 am	12.10 pm	00.30 Hr	3224	LED Tubelight & Cfl Not workin	Cardiac OT	03.05.2021	11.55 am	
4	29.04.2021	02.10 pm	04.00 pm	01.50 Hr	1812	Switch Board not working	Old Deluxe	05.05.2021	04.30 pm	
5	29.04.2021	11.38 am	11.52 am	00.14 Hr	1116	Tempreture not working	Labour Room	05.05.2021	11.55 am	
6	30.04.2021	03.20 pm	04.10 pm	00.50 Hr	3485	X-Ray Box not working	MMW	08.05.2021	10.10 am	
7	02.05.2021	04.30 pm	04.35 pm	00.05 Hr	1260	Compressor Motor not working	Biomedical Dept.	07.05.2021	11.10 am	
8	02.05.2021	11.00 am	02.45 pm	03.45 Hr	2355	LED light not working	Time Office	03.05.2021	03.00 pm	

Total Complaint	30
Pending Complaint	0
Complete Complaint	30
Complaint Precentage	100%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 26/04/2021 to 02/05/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	26.04.2021	12.25 pm	12.55 pm	00.30 Hr	2199	Water coolar not working	House Keaping	29.04.2021	02.40 pm	
2	26.04.2021	11.13 am	11.18 am	00.05 Hr	2248	Electrical problame	Covid-19 OPD	26.04.2021	11.25 am	
3	26.04.2021	11.20 am	11.30 am	00.10 Hr	156	Cat-6 Cable Requirement	Radiology Dept	26.04.2021	11.30 am	
4	26.04.2021	11.55 am	12.15 pm	00.20 Hr	3948	Cilling Fan not working	ENT OPD	26.04.2021	03.10 pm	
5	26.04.2021	03.15 pm	03.20 pm	00.05 Hr	1851	LED Light not working	Covid-19 OPD	26.04.2021	03.55 pm	
6	26.04.2021	10.20 am	03.00 pm	04.40 Hr	309	LED Tubelight not working	OT Complex	26.04.2021	03.54 pm	
7	26.04.2021	02.01 pm	02.01 pm	0	1787	LED Bulb not working	Central Store	26.04.2021	02.30 pm	
8	26.04.2021	12.50 pm	02.40 pm	01.50 Hr	683	Cilling Fan not working	FMW	27.04.2021	11.40 am	
9	26.04.2021	12.50 pm	12.56 pm	00.06 Hr	601	Cilling Fan not working	EMS ICU	27.04.2021	12.00 pm	
10	26.04.2021	10.20 am	11.40 am	01.20 Hr	2050	Pedastral fan not working	CVTS	26.04.2021	03.05 pm	
11	28.04.2021	03.55 pm	04.15 pm	00.20 Hr	2352	Cilling Fan not working	Time Office	29.04.2021	11.05 am	
12	28.04.2021	12.14 pm	12.45 pm	00.31 Hr	2426	AC Not working	Isolation ICU	29.04.2021	02.00 pm	
13	29.04.2021	03.35 pm	03.40 pm	00.05 Hr	3749	Extention board not working	MICU	29.04.2021	03.40 pm	
14	29.04.2021	11.40 am	12.10 pm	00.30 Hr	3224	LED Tubelight & Cfl Not workin	Cardiac OT			Work in progress
15	29.04.2021	02.10 pm	04.00 pm	01.50 Hr	1812	Switch Board not working	Old Deluxe			Requirment work
16	29.04.2021	11.38 am	11.52 am	00.14 Hr	1116	Tempreture not working	Labour Room			Work in progress
17	30.04.2021	10.30 am	10.47 am	00.17 Hr	313	Cilling Fan not working	School of Bio-Med.	30.04.2021	11.45 am	
18	30.04.2021	11.13 am	01.55 pm	02.45 Hr	1856	Wall fan not working	Covid-19 OPD	30.04.2021	04.15 pm	
19	30.04.2021	03.20 pm	04.10 pm	00.50 Hr	3485	X-Ray Box not working	MMW			Work in progress
20	30.04.2021	11.40 am	12.15 pm	00.35 Hr	1816	LED Light not working	Old Deluxe	30.04.2021	03.55 pm	
21	30.04.2021	11.40 am	11.55 am	00.15 Hr	1817	Exhouast Fan not working	Old Deluxe	01.05.2021	03.50 pm	
22	30.04.2021	10.00 am	10.15 am	00.15 Hr	710	AC Not working	OPD No-09	01.05.2021	11.20 am	
23	01.05.2021	12.30 pm	12.50 pm	00.20 Hr	2356	Lift No-06 Not working	Time Office	01.05.2021	02.10 pm	
24	02.05.2021	10.00 am	10.25 am	00.25 Hr	2357	Lift No-06 Not working	Time Office	02.05.20221	11.15 am	
25	02.05.2021	10.26 am	10.48 am	00.22 Hr	2358	Lift no-02 Not working	Time Office	02.05.2021	12.15 pm	
26	02.05.2021	04.30 pm	04.35 pm	00.05 Hr	1260	Compressor Motor not working	Biomedical Dept.			Work in progress
Pending work										
1	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress
2	19.04.2021	12.00 pm	12.03 pm	00.03 Hr	2507	Air Cooler not working	CSSD			Work in progress

Total Complaint	28
Pending Complaint	7
Complete Complaint	21
Complaint Precentage	75%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 19/04/2021 to 25/04/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	19.04.2021	03.55 pm	04.45 pm		1307	AC Not working	Dialysis	19.04.2021	05.00 pm	
2	19.04.2021	10.07 am	11.10 am		2564	Switch Board not working	NICU	20.04.2021	10.45 am	
3	19.04.2021	12.00 pm	12.03 pm		2507	Air Cooler not working	CSSD			Work in progress
4	19.04.2021	03.11 pm	04.05 p		1539	Air Cooler not working	Medicin OPD	21.04.2021	02.30 pm	
5	19.04.2021	12.15 pm	12.40 pm		2988	Water coolar not working	MCRI ICU	19.04.2021	12.50 pm	
6	19.04.2021	12.24 pm	02.10 pm		303	LED Light not working	OT Complex	20.04.2021	03.10 pm	
7	20.04.2021	03.00 pm	03.10 pm		304	LED Light not working	OT Complex	20.04.2021	03.10 pm	
8	20.04.2021	04.57 pm	05.00 pm		1558	AC Not working	Medicin OPD	21.04.2021	10.45 am	
9	20.04.2021	10.00 am	10.15 am		671	Electrical problame	Pathology	20.04.2021	10.15 am	
10	21.04.2021	03.45 pm	04.10 pm		849	Cilling Fan not working	MCRI OPD	23.04.2021	12.35 pm	
11	21.04.2021	04.00 pm	04.55 pm		2346	Water coolar not working	3rd floor	26.04.2021	04.55 pm	
12	21.04.2021	02.05 pm	02.10 pm		305	Switch Board not working	OT Complex	21.04.2021	02.45 pm	
13	21.04.2021	11.19 am	12.10 pm		2953	Wall fan not working	Hemotology	24.04.2021	11.35 am	
14	21.04.2021	02.45 pm	03.10 pm		2338	Lift No-06 Not working	Time Office	21.04.2021	04.00 pm	
15	21.04.2021	09.00 am	10.45 am		2243	Cilling Fan not working	EMS ICU	21.04.2021	03.00 pm	
16	22.04.2021	10.30 am	10.45 am		1310	AC Not working	Dialysis	22.04.2021	02.50 pm	
17	22.04.2021	02.45 pm	03.25 pm		1806	Wall fan not working	Old Deluxe	24.04.2021	01.10 pm	
18	22.04.2021	03.45 pm	04.10 pm		645	Humidity meter not working	SICU	25.04.2021	11.05 am	
19	22.04.2021	11.50 am	02.10 pm		3229	Electrical problame	Pead.Dept.	25.04.2021	10.55 pm	
20	22.04.2021	02.25 pm	03.10 pm		306	LED light not working	OT Complex	22.04.2021	04.00 pm	
21	23.04.2021	09.15 am	10.00 am		1235	Cat-6 Cable Requirement	Casulty	23.04.2021	10.30 am	
22	23.04.2021	11.13 am	12.10 pm		2248	Electrical problame	Covid-19 OPD	23.04.2021	12.35 pm	
23	23.04.2021	11.14 am	11.55 am		2247	AC Not working	Covid-19 OPD	23.04.2021	12.10 pm	
24	23.04.2021	11.07 am	11.45 am		1896	Switch Board not working	Super Deluxe	23.04.2021	12.55 pm	
25	23.04.2021	11.35 am	02.55 pm		310	Table fan not working	Physotherapy C Build.	24.04.2021	10.45 am	
26	23.04.2021	10.06 am	11.56 am		64	Telephone cable laying work.	ENT OPD	24.04.2021	12.00 pm	
27	24.04.2021	09.35 am	10.55 am		1237	Telephone cable laying work.	Medicin OPD	24.04.2021	11.30 am	
28	24.04.2021	09.35 am	09.45 am		2000	Wall fan not working	EMS ICU	26.04.2021	12.50 pm	
29	24.04.2021	11.10 am	12.00 pm		65	Telephone cable laying work.	ENT OPD	24.04.2021	01.15 pm	
30	24.04.2021	09.50 am	10.15 am		261	Wall fan not working	Physotherapy C Build.	24.04.2021	03.20 pm	
31	24.04.2021	10.30 am	12.10 pm		307	LED Tubelight not working	OT Complex	24.04.2021	02.40 pm	
32	25.04.2021	02.09 pm	02.09 pm		153	All Cilling fan Checking.	Ortho Ward	25.04.2021	02.35 pm	
33	25.04.2021	09.55 am	10.20 am		3947	All Cilling fan Checking.	ENT Ward	25.04.2021	12.55 pm	
34	25.04.2021	01.31 pm	01.31 pm		1752	All Cilling fan Checking.	Male Ortho ward	25.04.2021	04.10 pm	
Pending work										
1	09.03.2021	10.35 am	11.15 am	00.40 Hr	297	Lift-02 Fan not working	Time Office	21.04.2021	01.31 pm	
2	30.03.2021	03.54 pm	04.15 pm		2323	Lift-06 Cilling fan not working	Time Office	23.04.2021	12.45 pm	
3	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress

Total Complaint	37
Pending Complaint	2
Complete Complaint	35
Complaint Percentage	95%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 12/04/2021 to 18/04/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	12.04.2021	11.15 am	11.35 am	00.20 Hr	3094	AC not working	OT Complex	12.04.2021	02.40 pm	
2	12.04.2021	12.30 pm	12.45 pm	00.15 Hr	3943	Switch Board not working	H ICU	12.04.2021	01.44 pm	
3	12.04.2021	01.30 pm	01.30 pm	0	3944	Switch Board not working	H ICU	12.04.2021	03.30 pm	
4	12.04.2021	12.05 pm	12.45 pm	00.40 Hr	2556	Switch Board not working	NICU	12.04.2021	04.00 pm	
5	12.04.2021	03.41 pm	04.15 pm	00.34 Hr	1419	Switch Board not working	OBYG ICU	15.04.2021	10.22 pm	
6	12.04.2021	10.30 am	11.45 am	01.15 Hr	2340	Cilling Fan not working	Time Office	12.04.2021	04.35 pm	
7	12.04.2021	02.30 pm	02.30 pm		1990	Switch Board not working	EMS ICU	12.04.2021	05.35 pm	
8	13.04.2021	03.45 pm	03.55 pm	00.10 Hr	1647	LED Light not working	Blood bank	13.04.2021	04.05 pm	
9	15.04.2021	10.25 am	10.45 am	00.20 Hr	2506	LED Tubelight not working	CSSD	15.04.2021	10.45 am	
10	15.04.2021	03.05 pm	03.25 pm	00.20 Hr	2241	Switch Board not working	EICU	15.04.2021	03.25 pm	
11	15.04.2021	02.00 p	02.40 pm	00.40 Hr	1980	Switch Board not working	EMS ICU	15.04.2021	03.40 pm	
12	15.04.2021	12.35 pm	02.40 pm	00.05 Hr	3396	LED Tubelight not working	MSW	15.04.2021	04.15 pm	
13	15.04.2021	12.15 pm	02.35 pm	00.20 Hr	630	Wall fan not working	CATH-LAB	15.04.2021	04.25 pm	
14	16.04.2021	09.20 am	09.25 am	00.05 Hr	262	Cilling Fan not working	Dental	16.04.2021	03.30 pm	
15	16.04.2021	09.15 am	09.25 am	00.10 Hr	1843	Switch Board not working	Covid-19 OPD	16.04.2021	09.25 am	
16	16.04.2021	02.29 pm	03.15 pm	00.46 Hr	1750	Cilling Fan not working	Ortho Ward	17.04.2021	03.25 pm	
17	16.04.2021	03.22 pm	04.15 pm	00.53 Hr	1844	Switch Board not working	Covid-19 OPD	17.04.2021	02.15 pm	
18	16.04.2021	01.50 pm	03.45 pm	01.55 Hr	3097	LED Tubelight not working	OT Complex	16.04.2021	04.10 pm	
19	16.04.2021	01.45 pm	03.20 pm	01.35 Hr	3098	Switch Board not working	OT Complex	16.04.2021	04.00 pm	
20	17.04.2021	09.45 am	10.55 am	01.10 Hr	1889	LED Tubelight not working	Super Deluxe	17.04.2021	11.15 am	
21	17.04.2021	04.00 pm	0		4142	Extention Board New -05 Nos	EMS ICU	17.04.2021	04.15 pm	
22	17.04.2021	12.00 pm	12.35 pm	00.35 Hr	846	LED Tubelight not working	MCRI OPD	17.04.2021	03.00 pm	
23	17.04.2021	01.54 pm	02.20 pm	00.26 Hr	1998	X-Ray Box not working	EMS ICU	17.04.2021	02.50 pm	
24	17.04.2021	02.00 pm	02.35 pm	00.35 Hr	644	LED Tubelight not working	SICU	17.04.2021	05.20 pm	
25	17.04.2021	10.35 am	12.10 pm	03.35 Hr	1209	Cilling Fan not working	Plastic Surg ward	17.04.2021	04.35 pm	
26	17.04.2021	11.35 am	12.20 pm	00.55 Hr	2343	LED Tubelight not working	Time Office	17.04.2021	12.20 pm	
27	17.04.2021	12.21 pm	02.45 pm	01.14 Hr	32	Water filter not working	Central Laibrary	19.04.2021	10.45 am	
28	17.04.2021	09.30 am	09.45 am	00.15 Hr	2197	Motor not working	Time Office	17.04.2021	10.15 am	
29	17.04.2021	12.45 pm	01.00 pm	00.15 Hr	2987	Cilling Fan not working	MCRI ICU	19.04.2021	01.20 pm	
30	17.04.2021	10.08 am	02.45 pm	04.37 Hr	2562	Switch Board not working	NICU	19.04.2021	12.35 pm	
Pending work										
1	09.03.2021	10.35 am	11.15 am	00.40 Hr	297	Lift-02 Fan not working	Time Office			Work in progress
2	30.03.2021	03.54 pm	04.15 pm		2323	Lift-06 Cilling fan not working	Time Office			Work in progress
3	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress

Total Complaint	33
Pending Complaint	3
Complete Complaint	30
Complaint Precentage	91%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 05/04/2021 to 11/04/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	05.04.2021	09.05 am	09.35 am		2949	Cilling Fan not working	ENT Countar	05.04.2021	10.05 am	
2	05.04.2021	11.00 am	11.30 am		2412	LED Tubelight not working	Isolation ICU	05.04.2021	12.30 pm	
3	05.04.2021	11.00 am	11.35 am		2411	Cilling Fan not working	Isolation ICU	05.04.2021	12.35 pm	
4	05.04.2021	02.35 pm	02.40 pm		144	Cat-6 Cable Requirement	Radiology Dept	06.04.2021	03.00 pm	
5	05.04.2021	12.10 pm	12.35 pm		2414	Electrical problame	Isolation ICU	05.04.2021	12.35 pm	Requirment work
6	05.04.2021	11.02 am	11.38 am		258	LED Tubelight & Cilling fan not working	Dental	05.04.2021	12.20 pm	
7	05.04.2021	02.30 pm	02.35 pm		2336	Electrical problame	Time Office	05.04.2021	02.50 pm	
8	06.04.2021	12.20 pm	02.10 pm		3308	LED Tubelight not working	Skin & VD	06.04.2021	03.00 pm	
9	06.04.2021	03.30 pm	04.10 pm		693	Iron(press) not working	Linen Dept.	07.04.2021	11.55 pm	
10	06.04.2021	12.55 pm	02.25 pm		3736	LED Tubelight not working	MICU	06.04.2021	02.30 pm	
11	06.04.2021	10.36 am	11.10 am		31	Water coolar not working	Central Laibrary	06.04.2021	04.10 pm	
12	06.04.2021	02.19 pm	02.45 pm		1491	Cilling Fan not working	MJPJAY ward	06.04.2021	03.10 pm	
13	07.04.2021	10.40 am	10.45 am		2249	Switch Board not working	Covid-19 OPD	07.04.2021	10.50 am	
14	07.04.2021	12.15 pm	12.40 pm		1983	Cilling Fan not working	EMS ICU	07.04.2021	12.40 pm	
15	07.04.2021	03.00 pm	04.30 pm		1877	Cilling Fan not working	Super Deluxe	07.04.2021*	06.20 pm	
16	07.04.2021	10.20 am	11.35 am		2502	Cilling fan & Switch Bord not working	Ophthamology	07.04.2021	12.45 pm	
17	07.04.2021	11.35 am	11.55 am		2337	Water filter not working	6th Floor	07.04.2021	12.20 pm	
18	07.04.2021	02.07 pm	03.05 pm		1984	LED Light not working	EMS ICU	07.04.2021	04.10 pm	
19	07.04.2021	10.21 am	11.25 am		3737	LED Tubelight not working	MICU	08.04.2021	03.00 pm	
20	07.04.2021	09.50 am	11.00 am		2501	Air Cooler not working	Ophthamology	07.04.2021	01.10 pm	
21	07.04.2021	12.00 pm	12.45 pm		3092	Switch Board not working	OT Complex	07.04.2021	12.45 pm	
22	07.04.2021	12.15 pm	12.32 pm		2225	Electrical problame	Ex.Deluxe	07.04.2021	02.45 pm	
23	08.04.2021	11.00 am	11.15 am		4032	Focus lamp not working	OBGY OPD	08.04.2021	11.15 am	
24	08.04.2021	12.20 pm	02.45 pm		634	LED Light not working	SICU	08.04.2021	03.15 pm	
25	08.04.2021	09.30 am	09.45 am		2338	Lift No-06 Not working	Time Office	08.04.2021	11.15 am	
26	09.04.2021	10.30 am	10.40 am		2250	Switch Board not working	Covid-19 OPD	09.04.2021	10.45 am	
27	09.04.2021	11.30 am	11.55 am		545	Switch Board not working	FMW	09.04.2021	12.20 pm	
28	09.04.2021	11.45 am	12.10 pm		844	LED Tubelight not working	MCRI OPD Register	09.04.2021	12.55 pm	
29	09.04.2021	02.35 pm	04.10 pm		2251	X-Ray Box not working	Covid-19 OPD	10.04.2021	12.20 pm	
30	09.04.2021	10.35 am	12.25 pm		1213	Air Cooler not working	OBGY Ward	10.04.2021	01.15 pm	
31	09.04.2021	04.05 pm	04.35 pm		1301	Electrical problame	Dialysis	09.04.2021	11.35 am	
32	10.04.2021	10.40 am	10.55 am		640	AC Not Cleaning	SICU	10.04.2021	11.05 am	
33	10.04.2021	06.00 pm	06.10 pm		628	Switch Board not working	CATH-LAB	10.04.2021	06.10 pm	
34	11.04.2021	11.15 am	11.45 am		3094	AC Not working	OT Complex	11.04.2021	12.10 pm	
Pending work										
1	09.03.2021	10.35 am	11.15 am	00.40 Hr	297	Lift-02 Fan not working	Time Office			Work in progress
2	09.03.2021	10.30 am	10.45 am	00.15 Hr	63	Water coolar not working	School Physiotherapy			Pipeline Probleme

3	10.03.2021	10.45 am	11.05 am	00.20 Hr	1213	AC Not working	Casulty	11.04.2021	11.55 pm	
4	30.03.2021	03.54 pm	04.15 pm		2323	Lift-06 Cilling fan not working	Time Office			Work in progress
5	17.03.2021	12.47 pm	02.40 pm	02.12 Hr	1259	Compressor Motor not working	Biomedical Dept.	07.04.2021	12.20 pm	
6	16.03.2021	04.30 pm	04.45 pm	00.15 Hr	260	Water coolar not working	Physiotherapy			Pipeline Problame
7	26.03.2021	03.00 pm	03.30 pm	00.30 Hr	868	Air Cooler not working	Anatomy			Work in progress

Total Complaint	41
Pending Complaint	3
Complete Complaint	38
Complaint Precentage	93%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 24/10/2021 to 31/10/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	25.10.2021	09.35 am	10.20 am		1114	LED Tubelight not working	M.Ortho ward	25.10.2021	11.45 am	
2	25.10.2021	09.45 am	10.10 am		643	Tharmameter not working	NICU	25.10.2021	12.35 pm	
3	25.10.2021	02.57 pm	03.55 pm		1268	LED Tubelight not working	Biochemistry Dept.	28.10.2021	02.00 pm	
4	25.10.2021	10.35 am	11.55 pm		3043	Switch Board not working	MMW	25.10.2021	03.15 pm	
5	25.10.2021	02.55 pm	03.25 pm		1506	LED Tubelight not working	Casulty	26.10.2021	11.55 am	
6	25.10.2021	02.55 pm	03.15 pm		1507	LED Tubelight not working	Casulty	26.10.2021	10.55 am	
7	26.10.2021	10.20 am	11.50 am		2013	UPS Battery change	MCRI OPD	26.10.2021	11.50 am	
8	26.10.2021	02.00 pm	02.20 pm		3444	LED Tubelight not working	OT Complex	26.10.2021	03.30 pm	
9	26.10.2021	02.00 pm	02.20 pm		3447	LED Tubelight not working	OT Complex	26.10.2021	03.30 pm	
10	26.10.2021	11.50 am	12.55 pm		2290	LED Tubelight not working	Pead.ward	27.10.2021	11.50 am	
11	26.10.2021	03.18 pm	03.21 pm		3445	Switch Board not working	OT Complex	26.10.2021	03.30 pm	
12	26.10.2021	10.20 am	10.45 am		Letter	LED Tubelight not working	Parking Side	27.10.2021	03.00 pm	
13	26.10.2021	03.35 pm	03.55 pm		19	Aakash Kandil Instalation	Hospital Build.	02.11.2021	11.55 am	
14	26.10.2021	11.30 am	11.55 am		1420	Switch Board not working	Covid OPD	26.11.2021	12.30 pm	
15	27.10.2021	02.30 pm	02.45 pm		1914	Exhouast Fan not working	House kiping Dept.	30.10.2021	11.10 am	
16	28.10.2021	10.30 am	10.50 am		1654	X-Ray Box not working	CCU+CVTS	28.10.2021	11.15 am	
17	28.10.2021	11.05 am	11.55 am		1656	X-Ray Box not working	CCU+CVTS	01.11.2021	11.00 am	
18	28.10.2021	11.05 am	12.10 pm		1657	LED Tubelight not working	CCU+CVTS	01.11.2021	11.11 am	
19	28.10.2021	09.45 am	11.05 am		340	Switch Board not working	Super Deluxe	28.10.2021	12.10 pm	
20	28.10.2021	10.15 am	11.00 am		2512	LED Tubelight not working	Record Section	28.10.2021	11.45 am	
21	28.10.2021	04.04 pm	04.20 pm		2648	LED 18watt Panel	Old Deluxe	28.10.2021	04.35 pm	
22	29.10.2021	03.10 pm	04.20 pm		1577	Cilling Fan not working	Medicin OPD	29.10.2021	04.50 pm	
23	29.10.2021	02.38 pm	03.15 pm		3118	Cilling Fan not working	Hematology ICU	01.11.2021	03.15 pm	
24	30.10.2021	12.45 pm	12.55 pm		2898	LED Tubelight not working	Pead.ward	30.10.2021	03.20 pm	
Pending work										
1	01.10.2021	11.00 am	11.25 am		2726	Call Bell not working	New Deluxe	27.10.2021	10.55 am	
2	04.10.2021	10.00 am	10.15 am		1676	DipFreez not working	Blood bank			Work in progress

Total Complaint	26
Pending Complaint	1
Complete Complaint	25
Complaint Precentage	96%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 19/07/2021 to 25/07/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	19.07.2021	04.20 pm	04.55 pm	00.35 Hr	2148	LED light not working	5th floor deluxe	21.07.2021	02.15 pm	
2	19.07.2021	03.25 pm	04.10 pm	00.45 Hr	852	Cilling Fan not working	MJPJAY ward	19.07.2021	04.10 pm	Fan shifting work.F.Hook is not avelable
3	19.07.2021	11.20 am	11.45 am	00.25 Hr	2147	Lift No-06 Not working	Time Office	19.07.2021	12.15 pm	
4	19.07.2021	10.01 am	10.30 am	00.29 Hr	4044/3564	Cat-6 Cable Requirement	OBGY OPD	19.07.2021	03.20 pm	
5	19.07.2021	11.10 am	11.45 am	00.35 Hr	1142	LED Bulb not working	Labour Room	19.07.2021	02.50 pm	
6	19.07.2021	12.15 pm	12.45 pm	00.30 Hr	237	Cilling Fan not working	OPD Complex	19.07.2021	01.10 pm	
7	20.07.2021	10.54 am	11.00 am	00.06 Hr	1143	Tharmameter not working	Labour Room	20.07.2021	11.00 am	
8	20.07.2021	04.30 pm	04.45 pm	00.15 Hr	2854	Refregator not working	Pead.ward	20.07.2021	05.00 pm	
9	20.07.2021	10.01 am	11.10 am	01.09 Hr	1456	Switch Board not working	OBGY ICU	21.07.2021	04.00 pm	
10	20.07.2021	11.22 am	11.45 am	00.23 Hr	293	Switch Board & Cat-6 Requirement	PSM Dept.	20.07.2021	11.55 am	
11	20.07.2021	01.22 p	02.40 pm	01.18 Hr	1863	Gizer not working	Old Deluxe	20.07.2021	03.00 pm	
12	20.07.2021	03.41 pm	04.00 pm	00.19 Hr	3227	Gizer not working	Ex.Deluxe	21.07.2021	03.41 pm	
13	21.07.2021	11.55 am	12.20 pm	00.25 Hr	749	Steel Refregator not working	Central Lab.			Work in progress
14	21.07.2021	07.00 pm	07.05 pm	00.05 Hr	1865	Electrical problame	Old Deluxe	21.07.2021	07.05 pm	
15	21.07.2021	04.15 pm	04.55 pm	00.40 Hr	1664	LED Light not Working	Blood bank	23.07.2021	11.32 am	
16	21.07.2021	10.15 am	10.55 am	00.40 Hr	1144	LED light not working	Labour Room	21.07.2021	11.20 am	
17	21.07.2021	11.30 am	11.55 am	00.25 Hr	755	Split AC not working	Microbiology	24.07.2021	02.40 pm	
18	22.07.2021	04.10 pm	04.20 pm	00.10 Hr	2151	Lift No-01 not working	Time Office	22.07.2021	05.05 pm	
19	22.07.2021	03.15 pm	04.20 pm	01.05 Hr	2858	LED Tubelight,Cilling Fan & Switch Board not working.	Old Peadiatric ward	24.07.2021	03.00 pm	
20	22.07.2021	08.55 am	09.10 am	00.15 Hr	3101	Iron(press) not working	Linen Dept.	22.07.2021	10.30 am	
21	22.07.2021	10.30 am	10.50 am	00.20 Hr	166	Gizer not working	F.Ortho ward	24.07.2021	10.50 am	
22	22.07.2021	12.13 pm	12.20 pm	00.07 Hr	582	Switch Board not working	FMW	23.07.2021	12.20 pm	
23	22.07.2021	10.57 am	11.07 am	00.10 Hr	318	Switch Board not working	School of Physiology	23.07.2021	11.55 am	
24	22.07.2021	12.15 pm	12.25 pm	00.10 Hr	581	X-Ray Box not working	FMW	22.07.2021	12.25 pm	
25	22.07.2021	12.15 pm	12.45 pm	00.30 Hr	192	Exhouast fan & Switch Board not working.	Readiology	23.07.2021	11.15 am	
26	23.07.2021	10.30 am	11.20 am	00.50 Hr	1453	Insect Killer not working	NICU			Bio.Dept work
27	23.07.2021	10.45 am	10.55 am	00.10 Hr	2070	Split AC not working	PICU	24.07.2021	11.15 am	
28	23.07.2021	12.08 pm	12.45 pm	00.37 Hr	1452	X-Ray Box not working	NICU	24.07.2021	10.25 am	
29	23.07.2021	10.26 am	10.46 am	00.20 Hr	442	LED Tubelight not working	Ortho OPD	23.07.2021	11.18 am	
30	23.07.2021	04.30 pm	04.45 pm	00.15 Hr	1317	LED Tubelight not working	MSW	26.07.2021	02.15 pm	
31	23.07.2021	10.15 am	10.25 am	00.10 Hr	1866	Gizer not working	Old Deluxe	24.07.2021	10.45 am	
32	23.07.2021	09.30 am	09.45 am	00.15 Hr	193	Mitsubishi AC not working	MRI Dept.			Work in progress
33	24.07.2021	12.42 pm	12.55 pm	00.13 Hr	2153	Lift No-05 not working	Time Office	24.07.2021	02.45 pm	
34	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress
35	24.07.2021	09.20 am	09.35 am	00.15 Hr	1342	Switch Board not working	Dialysis	24.07.2021	10.20 am	

36	24.07.2021	10.25 am	11.10 am	00.45 Hr	478	LED Tubelight not working	Pul.Medicin OPD	24.07.2021	12.25 pm	
37	25.07.2021	08.20 am	09.00 am	00.40 Hr	2154	Lift No-01 not working	Time Office	25.07.2021	11.15 am	
38	25.07.2021	11.30 am	02.00 pm	-	Letter(069)	Control panel replacement work	Water supply tank	25.07.2021	02.45 pm	
Pending work										
1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress
2	12.07.2021	12.30 pm	02.45 pm	02.15 Hr	645	Split AC not working	CATH-LAB	19.07.2021	11.15 am	
3	16.07.2021	10.35 am	11.10 am	00.35 Hr	3540	Split AC not working	Cardac OT	22.07.2021	09.55 am	

Total Complaint	41
Pending Complaint	4
Complete Complaint	37
Complaint Precentage	90%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 26/07/2021 to 01/08/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	26.07.2021	02.45 pm	03.00 pm	00.15 Hr	241	LED Tubelight not working	SS OPD	26.07.2021	03.30 pm	
2	26.07.2021	04.10 pm	04.35 pm	00.25 Hr	53	Water Purifire not working	MTCN	27.07.2021	04.10 pm	
3	26.07.2021	03.08 pm	03.32 pm	00.24 Hr	532	LED Tubelight not working	Psy.OPD	26.07.2021	03.55 pm	
4	26.07.2021	03.20 pm	04.00 pm	00.40 Hr	438	Extention Board not working	MICU Covid-19	31.07.2021	12.05 pm	
5	26.07.2021	10.50 am	11.05 am	00.15 Hr	224	Gizer not working	MJPJAY ward	26.07.2021	03.10 pm	
6	26.07.2021	11.45 am	12.15 pm	00.30 Hr	3312	Exhouast fan Board not working.	Skin OPD	27.07.2021	12.35 pm	
7	26.07.2021	02.19 pm	02.35 pm	00.16 Hr	412	Switch Board not working	OT Complex	27.07.2021	02.00 pm	
8	26.07.2021	08.00 am	08.40 am	00.40 Hr	2155	Lift No-05 not working	Time Office	27.05.2021	10.00 am	
9	26.07.2021	12.00 pm	12.35 pm	00.35 Hr	3229	LED Tubelight not working	6th Floor	26.07.2021	04.15 pm	
10	27.07.2021	11.01 am	11.20 am	00.19 Hr	751	Cilling Fan not working	Blood bank	27.07.2021	11.40 am	
11	27.07.2021	02.47 pm	04.00 pm	01.13 Hr	502	Gizer not working	MCRI ICU	27.07.2021	04.20 pm	
12	28.07.2021	10.32 am	10.55 am	00.23 Hr	2509	LED Tubelight not working	MRI Dept.	28.07.2021	11.15 am	
13	28.07.2021	09.55 am	10.15 am	00.20 Hr	2122	Switch Board not working	Resistation	28.07.2021	10.40 am	
14	28.07.2021	11.30 am	02.45 pm	03.15 Hr	374	LED Tubelight not working	Psy.ward.	31.07.2021	04.00 pm	
15	29.07.2021	11.15 am	11.35 am	00.20 Hr	4582	Water cooler not working	Biochemistry Dept.	29.07.2021	12.44 pm	
16	29.07.2021	02.38 pm	04.15 pm	01.37 Hr	479	Cilling Fan not working	Pul.Medicin OPD	31.07.2021	10.10 am	
17	29.07.2021	09.27 am	10.45 am	01.18 Hr	2514	LED Tubelight not working	Ophal.OPD	29.07.2021	11.10 am	
18	29.07.2021	11.22 am	11.30 am	00.08 Hr	854	LED Tubelight not working	MJPJAY ward	29.07.2021	11.30 am	
19	29.07.2021	11.10 am	11.55 am	00.45 Hr	2158	Lift No-04 not working	Time Office	29.07.2021	01.20 pm	
20	29.07.2021	10.20 am	11.10 am	00.50 Hr	2159	VRV Casset unit-01 not working	Time Office	30.07.2021	12.00 pm	
21	29.07.2021	10.07 am	11.55 am	01.48 Hr	2888	LED 15 watt fitting working	Super Deluxe	31.07.2021	11.15 am	
22	29.07.2021	02.36 pm	04.45 pm	02.09 Hr	2664	Switch Board not working	Covid opd	29.07.2021	04.15 pm	
23	29.07.2021	12.20 pm	12.50 pm	00.30 Hr	1624	X-Ray Box not working	CCU+CVTS	29.07.2021	12.30 pm	
24	30.07.2021	01.15 pm	01.45 pm	00.30 Hr	2283	LED light not working	EICU	30.07.2021	02.30 pm	
25	30.07.2021	02.45 pm	03.15 pm	00.30 Hr	2074	FCU Not working	PICU	30.07.2021	03.40 pm	
26	30.07.2021	12.14 pm	04.20 pm	04.06 Hr	3236	Exhouast fan Board not working.	Ex.Deluxe	31.07.2021	01.00 pm	
27	30.07.2021	12.10 pm	02.00 pm	01.50 Hr	2665	LED Light not working	Covid opd	30.07.2021	02.15 pm	
28	30.07.2021	12.17 pm	02.40 pm	02.23 Hr	2893	Cilling Fan not working	Super Deluxe	31.07.2021	11.35 am	
29	30.07.2021	12.13 pm	12.25 pm	00.12 Hr	3235	LED 15 watt fitting working	Ex.Deluxe	31.07.2021	12.45 pm	
30	30.07.2021	03.09 pm	04.09 pm	01.00 Hr	783	VRV Casset unit-01 not working	MCRI OPD	31.07.2021	12.00 pm	
31	30.07.2021	03.25 pm	04.10 pm	00.45 Hr	679	LED Tubelight not working	Hemotology ICU	31.07.2021	10.35 am	
32	30.07.2021	12.17 pm	02.00 pm	01.43 Hr	2892	LED 15 watt fitting working	Super Deluxe	31.07.2021	11.25 am	
33	30.07.2021	11.32 am	12.45 pm	01.13 Hr	1622	LED 15watt not working	Casulty	30.07.2021	05.00 pm	
34	31.07.2021	10.40 am	11.05 am	00.25 Hr	1623	LED Light not working	Casulty	31.07.2021	03.10 pm	
35	31.07.2021	09.15 am	10.20 am	01.05 Hr	682	Cilling Fan not working	Hemotology	31.07.2021	10.45 am	
36	31.07.2021	10.00 am	02.05 pm	04.05 Hr	2896	LED 15 watt fitting working	Super Deluxe	31.07.2021	03.05 pm	
37	31.07.2021	10.05 am	02.15 pm	04.10 Hr	2897	Exhouast Fan not working	Super Deluxe	31.07.2021	03.10 pm	
Pending work										

1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress
2	21.07.2021	11.55 am	12.20 pm	00.25 Hr	749	Steel Refregator not working	Central Lab.	31.07.2021	12.05 pm	
3	23.07.2021	09.30 am	09.45 am	00.15 Hr	193	Mitsubishi AC not working	MRI Dept.			Work in progress
4	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress

Total Complaint	41
Pending Complaint	3
Complete Complaint	38
Complaint Precentage	93%


M. V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 02/08/2021 to 08/08/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	02.08.2021	09.20 am	10.00 am	00.40 Hr	383	AHU not working	OT Complex	02.08.2021	11.00 am	
2	02.08.2021	03.25 pm	04.10 pm	00.45 Hr	679	LED Tubelight not working	Hemotology ICU	03.08.2021	10.35 am	
3	02.08.2021	10.05 am	11.10 am	01.05 Hr	685	LED 15 watt fitting working	Hemotology	02.08.2021	01.05 pm	
4	02.08.2021	09.35 am	11.00 am	00.25 Hr	422	Switch Board not working	OT Complex	02.08.2021	03.00 pm	
5	02.08.2021	03.00 pm	03.30 pm	00.30 Hr	4050	Cilling Fan not working	OBGY OPD	03.08.2021	02.50 pm	
6	02.08.2021	10.05 am	10.45 am	00.40 Hr	683	LED Tubelight not working	Hemotology	02.08.2021	12.45 pm	
7	02.08.2021	02.40 pm	03.10 pm	00.30 Hr	1591	Extention Board not working	Covid-19	03.08.2021	11.05 am	
8	02.08.2021	10.05 am	10.30 am	00.25 Hr	376	LED light not working	Psyciology ward	02.08.2021	12.25 pm	
9	02.08.2021	10.00 am	10.30 am	00.30 Hr	599	LED Tubelight not working	PSM Dept.	02.08.2021	11.05 am	
10	03.08.2021	11.00 am	11.55 am	00.55 Hr	Letter	Weallding machine conection	7th floor	07.08.2021	11.55 am	
11	03.08.2021	10.00 am	10.20 am	00.20 Hr	1344	Switch Board not working	Dialysis	03.08.2021	10.20 am	
12	03.08.2021	10.41 am	11.00 am	00.19 Hr	1544	Bell not working	Cardac OT	05.08.2021	05.00 pm	
13	03.08.2021	09.24 am	10.20 am	00.56 Hr	1104	Switch Board not working	Super Deluxe	03.08.2021	11.55 am	
14	03.08.2021	11.20 am	12.05 pm	00.45 Hr	646	Split AC not working	CATH-LAB	05.08.2021	03.20 pm	
15	02.08.2021	10.24 am	11.45 am	01.25 Hr	759	Split AC not working	Microbiology	03.08.2021	03.00 pm	
16	03.08.2021	11.10 am	12.05 pm	00.55 Hr	67	Water Purifire not working	Time Office	03.08.2021	02.35 pm	
17	04.08.2021	10.30 am	10.45 am	00.15 Hr	1108	AC Duct Cleaning work	Super Deluxe	04.08.2021	12.10 pm	
18	04.08.2021	02.15 pm	02.35 pm	00.20 Hr	380	Switch Board not working	Psy.ward.	04.08.2021	03.20 pm	
19	04.08.2021	11.40 am	02.20 pm	02.40 Hr	199	LED Bulb not working	Radiology Dept	04.08.2021	03.10 pm	
20	04.08.2021	04.25 pm	04.35 pm	00.10 Hr	1665	Refregator not working	Blood bank			Work in progress
21	04.08.2021	09.15 am	09.40 pm	00.25 Hr	1107	LED Light not Working	Super Deluxe	04.08.2021	10.00 am	
22	05.08.2021	02.20 pm	02.55 pm	00.35 Hr	445	AHU not working	MICU	05.08.2021	03.45 pm	
23	05.08.2021	11.06 am	11.20 am	00.14 Hr	2526	LED Tubelight not working	CSSD	05.08.2021	11.20 am	
24	05.08.2021	09.30 am	09.45 am	00.15 Hr	Letter	UPS Battery change	Dean Office	05.08.2021	04.00 pm	
25	06.08.2021	01.30 pm	02.00 pm	00.30 Hr	789	FCU Not working	MCRI OPD-11	06.08.2021	04.05 pm	
26	06.08.2021	09.30 am	09.50 am	00.20 Hr	Oral	125 KVA DG servicing work. (180AH/12Volt Battary-02Nos, 15/40watt Oil-05ltr & Diesel 30ltr MGM-MCH Substation to Padegawon 125 KVA DG transfer) Gate pass No-150	Padegaon	06.08.2021	03.20 pm	
27	06.08.2021	02.30 pm	03.45 pm	00.25 Hr	425	Switch Board not working	OT Complex	06.08.2021	04.00 pm	
28	06.08.2021	02.25 pm	03.00 pm	00.35 Hr	2170	Gizer not working	Time Office	07.08.2021	02.20 pm	
29	07.08.2021	11.30 am	11.55 am	00.25 Hr	Letter	Weallding machine conection	7th floor	07.08.2021	11.55 am	
30	07.08.2021	10.10 am	11.35 am	00.25 Hr	2266	X-Ray Box not working	Nephrology ward	07.08.2021	12.25 pm	
31	07.08.2021	02.16 pm	03.10 pm	00.54 Hr	2527	LED 15 watt fitting working	CSSD	07.08.2021	04.20 pm	
32	07.08.2021	11.45 am	12.00 pm	00.15 Hr	Letter	UPS Battery change	Perches Deparment	07.08.2021	12.00 pm	
33	08.08.2021	09.30 am	10.00 am	00.30 Hr	804	FCU Not working	Radiology Dept	08.08.2021	11.45 am	
Pending work										

1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress
2	23.07.2021	09.30 am	09.45 am	00.15 Hr	193	Mitsubishi AC not working	MRI Dept.	06.08.2021	03.20 pm	
3	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress

Total Complaint	36
Pending Complaint	3
Complete Complaint	33
Complaint Percentage	91%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 09/08/2021 to 15/08/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	09.08.2021	10.40 am	11.15 am		104	Switch Board not working	FSW	09.08.2021	09.45 am	
2	09.08.2021	09.25 am	10.10 am		1320	Switch Board not working	MSW	09.08.2021	04.30 pm	
3	09.08.2021	10.35 am	11.05 am		384	Electical wiring removing work	Psy ward	09.08.2021	11.45 am	
4	09.08.2021	10.30 am	10.55 am		1152	FCU Not working	Labour Room	10.08.2021	04.30 pm	
5	09.08.2021	02.27 pm	03.10 pm		1268	Cilling Fan not working	OBYG ICU	12.08.2021	11.25 am	
6	09.08.2021	04.30 pm	05.00 pm		429	LED Tubelight not working	OT Complex	09.08.2021	05.15 pm	
7	09.08.2021	02.25 pm	03.10 pm		2170	Gizer not working	7th floor	14.08.2021	11.45 am	
8	09.08.2021	02.05 pm	03.00 pm		792	Switch Board not working	MCRI OPD	09.08.2021	03.40 pm	
9	09.08.2021	04.20 pm	04.30 pm		Letter	10Hp Motor Fighter change	AC Plant	09.08.2021	05.00 pm	
10	10.08.2021	12.45 pm	02.40 pm		855	Wall fan not working	MJPJAY ward	10.08.2021	10.20 pm	
11	10.08.2021	11.10 am	12.05 pm		1790	LED Tubelight not working	M.Ortho ward	10.08.2021	02.50 pm	
12	10.08.2021	02.30 pm	04.45 pm		446	Split AC not working	Isolation ICU	10.08.2021	06.00 pm	
13	10.08.2021	10.59 am	12.05 pm		1626	LED 15watt not working	CCU+CVTS	10.08.2021	02.20 pm	
14	10.08.2021	10.45 am	11.25 am		693	LED 15watt not working	Hemotology	10.08.2021	11.30 am	
15	11.08.2021	09.50 am	02.40 pm		432	LED Tubelight not working	OT Complex	11.08.2021	03.30 pm	
16	11.08.2021	09.35 am	12.15 pm		4264	LED 15watt not working	Pharm.Lecture Hall	13.08.2021	04.05 pm	
17	11.08.2021	10.50 am	11.05 am		1566	Cilling Fan not working	Medicin OPD	16.08.2021	11.45 am	
18	11.08.2021	10.27 am	01.50 pm		388	Cilling Fan not working	Psy ward	12.08.2021	10.05 am	
19	11.08.2021	10.26 am	10.55 am		389	LED 15watt not working	Psy ward	12.08.2021	10.30 am	
20	11.08.2021	11.05 am	12.45 pm		2413	Wall fan not working	Central Research Dept.	16.08.2021	03.05 pm	
21	11.08.2021	11.20 am	12.15 pm		3239	X-Ray Box not working	Pead.ward	11.08.2021	12.45 pm	
22	12.08.2021	04.20 pm	04.55 pm		447	Extention Board not working	MICU	13.08.2021	11.00 am	
23	12.08.2021	09.30 am	10.45 am		1120	Switch Board not working	Super Deluxe	12.08.2021	11.05 am	
24	12.08.2021	03.35 pm	03.55 pm		1710	Switch Board not working	SICU	12.08.2021	01.15 pm	
25	12.08.2021	10.30 am	11.05 am		3194	Extention Board not working	New Deluxe	12.08.2021	03.20 pm	
26	12.08.2021	10.18 am	11.15 am		2171	Gizer not working	7th floor	14.08.2021	12.25 pm	
27	12.08.2021	10.30 am	11.05 am		3193	Switch Board not working	New Deluxe	12.08.2021	02.30 pm	
28	13.08.2021	11.10 am	11.55 am		797	FCU Not working	New MCRI	13.08.2021	02.45 pm	
29	13.08.2021	10.13 am	10.25 am		1353	LED 15watt not working	Dialysis	13.08.2021	10.35 am	
30	13.08.2021	10.35 am	11.15 am		1690	LED 15watt not working	CVTS	13.08.2021	04.25 pm	
31	13.08.2021	02.20 pm	03.55 pm		108	LED 15watt not working	FSW	16.08.2021	10.45 am	
32	14.08.2021	11.11 am	12.30 pm		47	Water cooler not working	Central Laibrary	14.08.2021	04.20 pm	
33	14.08.2021	11.45 am	12.20 pm		394	Gizer not working	Psy ward	14.08.2021	04.45 pm	
34	14.08.2021	10.50 am	12.35 pm		3240	Cilling Fan not working	Pead.ward	14.08.2021	01.05 pm	
35	14.08.2021	11.00 am	12.20 pm		3251	Water filter not working	Ex.Deluxe	16.08.2021	09.30 am	
Pending work										
1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex			Work in progress
2	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress

3	04.08.2021	04.25 pm	04.35 pm	00.10 Hr	1665	Refregator not working	Blood bank			Work in progress
---	------------	----------	----------	----------	------	------------------------	------------	--	--	------------------

Total Complaint	38
Pending Complaint	3
Complete Complaint	35
Complaint Precentage	92%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 16/08/2021 to 22/08/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	16.08.2021	11.15 am	12.05 pm		4261	VRV Casset unit-01 not working	Dyotan Hall			Work in progress
2	16.08.2021	03.40 pm	03.40 pm		809	LED Tubelight not working	Central store	16.08.2021	04.16 pm	
3	16.08.2021	11.14 am	12.25 pm		232	Refregator not working	MJPJAY ward	23.08.2021	11.55 am	
4	16.08.2021	10.36 am	11.05 am		508	Gizer not working	MCRI ICU	17.08.2021	12.45 pm	
5	17.08.2021	12.05 pm	12.35 pm		16	Split AC not working	IVF Dept.	17.08.2021	12.55 pm	
6	17.08.2021	10.45 am	11.55 am		1632	LED 15watt not working	Casulty	18.08.2021	12.15 pm	
7	18.08.2021	09.45 am	10.00 am		2290	LED light not working	EICU	18.08.2021	10.55 am	
8	18.08.2021	12.13 pm	12.15 pm		1272	LED Tubelight not working	Anasteshiya dept.	18.08.2021	12.15 pm	
9	19.08.2021	11.35 am	11.55 am		1138	Switch Board not working	Super Deluxe	18.08.2021	12.45 pm	
10	19.08.2021	02.35 pm	03.15 pm		3197	Refregator not working	New Deluxe	20.08.2021	12.15 pm	
11	19.08.2021	03.58 pm	04.25 pm		878	LED Tubelight not working	Anatomy	20.08.2021	12.55 pm	
12	19.08.2021	02.30 pm	02.45 pm		439	LED Tubelight not working	OT Complex	19.08.2021	03.30 pm	
13	19.08.2021	05.17 pm	05.25 pm		2179	Lift No-11 not working	Time Office	19.08.2021	07.00 pm	
14	19.08.2021	09.48 am	10.15 am		1136	Switch Board not working	Super Deluxe	19.08.2021	11.00 am	
15	19.08.2021	10.45 am	11.35 am		196	Split AC not working	RGY ICU	21.08.2021	12.22 pm	
16	20.08.2021	10.05 am	10.45 am		1139	Cilling Fan not working	Super Deluxe	20.08.2021	11.05 am	
17	20.08.2021	05.10 pm	05.35 pm		1141	Split AC not working	Super Deluxe	21.08.2021	11.40 am	
18	20.08.2021	10.20 am	11.15 am		451	Split AC not working	MICU	20.08.2021	04.05 pm	
19	20.08.2021	10.05 am	10.40 am		1475	Humidety meter not working	NICU	21.08.2021	12.00 pm	
20	20.08.2021	11.10 am	11.20 am		1133	Electrical problame	Super Deluxe	20.08.2021	11.20 am	
21	20.08.2021	05.10 pm	05.45 pm		1142	Cilling Fan not working	Super Deluxe	21.08.2021	12.20 pm	
22	20.08.2021	10.05 am	10.45 am		1473	Refregator not working	NICU	20.08.2021	11.55 am	
23	20.08.2021	10.42 am	11.15 am		2180	Lift No-03 not working	Time Office	20.08.2021	02.40 pm	
24	21.08.2021	12.00 pm	12.45 pm		1145	LED 15watt not working	Super Deluxe	21.08.2021	01.30 pm	
25	21.08.2021	11.50 am	12.25 pm		1325	Switch Board not working	MSW	21.08.2021	02.35 pm	
26	21.08.2021	10.00 am	10.15 am		800	Electrical problame	MCRI OPD	23.08.2021	12.30 pm	
27	21.08.2021	12.00 pm	02.40 pm		277	Refregator not working	Medical Store	21.08.2021	04.05 pm	
Pending work										
1	08.07.2021	02.20 pm	02.55 pm	00.35 Hr	393	Stabilizer not working	OT Complex	17.08.2021	12.25 pm	Not Reparibale
2	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress
3	04.08.2021	04.25 pm	04.35 pm	00.10 Hr	1665	Refregator not working	Blood bank	23.08.2021	04.00 pm	

Total Complaint	30
Pending Complaint	2
Complete Complaint	28
Complaint Precentage	93%


M. V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 23/08/2021 to 29/08/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	23.08.2021	09.15 am	09.40 am		294	Cilling Fan not working	Dental OPD	23.08.2021	09.40 am	
2	23.08.2021	09.30 am	10.55 am		3103	Iron(press) not working	Linen Dept.	23.08.2021	11.55 am	
3	23.08.2021	02.30 pm	03.10 pm		1467	LED Light not Working	OBYG ICU	23.08.2021	03.45 pm	
4	23.08.2021	10.30 am	10.55 am		14	Telephone cable laying work.	Lift	28.08.2021	04.20 pm	
5	23.08.2021	10.00 am	10.55 am		1885	LED Tubelight not working	Old Deluxe.	23.08.2021	11.30 am	
6	23.08.2021	02.31 pm	03.20 pm		1716	LED Light not Working	SICU	23.08.2021	04.00 pm	
7	23.08.2021	02.45 pm	03.20 pm		2533	LED Tubelight not working	CSSD	24.08.2021	11.25 am	
8	23.08.2021	10.05 am	10.30 am		1883	Gizer not working	Old Deluxe	23.08.2021	04.05 pm	
9	24.08.2021	10.05 am	10.25 am		2677	LED Bulb not working	Covid opd	24.08.2021	10.30 am	
10	24.08.2021	09.45 am	10.15 am		1484	Extention Board not working	NICU	24.08.2021	02.40 pm	
11	24.08.2021	11.33 am	12.03 pm		1396	LED Tubelight not working	Pead.OPD	24.08.2021	02.15 pm	
12	24.08.2021	04.02 pm	04.57 pm		3105	Iron(press) not working	Linen Dept.	28.08.2021	04.02 pm	
13	24.08.2021	08.50 am	09.25 am		2185	Switch Board not working	Time Office	29.08.2021	02.10 pm	
14	24.08.2021	11.45 am	12.15 pm		3633	LED Tubelight not working	Cardac OT	24.08.2021	03.30 pm	
15	24.08.2021	02.40 pm	03.15 pm		3154	LED Tubelight & Cilling fan not working	ENT Ward	25.08.2021	03.45 pm	
16	24.08.2021	11.20 am	01.00 pm		2865	Electrical problame	Pead.ward	24.08.2021	04.00 pm	
17	24.08.2021	10.30 am	02.35 pm		1707	Switch Board not working	SICU	28.08.2021	11.10 am	
18	24.08.2021	02.30 pm	02.55 pm		3155	LED Tubelight & Cilling fan not working	ENT Ward	25.08.2021	02.30 pm	
19	24.08.2021	09.45 am	11.55 am		590	X-Ray Box not working	FMW	25.08.2021	03.20 pm	
20	25.08.2021	11.50 am	01.45 pm		2678	LED 15watt not working	Covid opd	25.08.2021	02.15 pm	
21	25.08.2021	02.17 pm	02.55 pm		1890	Water cooler not working	Old Deluxe			Work in progress
22	25.08.2021	04.00 pm	05.00 pm		181	X-Ray Box not working	F.Ortho ward	25.08.2021	05.25 pm	
23	25.08.2021	11.15 am	02.40 pm		294	LED Tubelight not working	PSM Dept.	27.08.2021	02.30 pm	
24	25.08.2021	02.16 pm	03.15 pm		1889	Switch Board not working	Old Deluxe	25.08.2021	05.00 pm	
25	25.08.2021	03.32 pm	03.45 pm		593	Switch Board not working	FMW	25.08.2021	04.00 pm	
26	25.08.2021	11.25 am	12.15 pm		2534	LED Tubelight not working	CSSD	25.08.2021	04.15 pm	
27	25.08.2021	02.17 pm	03.20 pm		1891	LED 15watt not working	Old Deluxe	25.08.2021	04.45 pm	
28	26.08.2021	10.35 am	10.45 am		Letter	LED Tubelight not working	Rasistar Office	26.08.2021	11.00 am	
29	26.08.2021	11.15 am	12.55 pm		2243	Switch Board not working	STP/ETP			Work in progress
30	26.08.2021	08.50 am	11.55 am		2188	Lift No-05 not working	Time Office	26.08.2021	11.35 am	
31	26.08.2021	11.30 am	11.30 am		295	Power point not working	Dental OPD	26.08.2021	11.30 am	
32	26.08.2021	12.10 pm	12.55 pm		652	FCU Not working	CATH-LAB	26.08.2021	04.15 pm	
33	26.08.2021	04.10 pm	04.35 pm		1894	Cilling Fan not working	Old Deluxe	26.08.2021	05.00 pm	
34	26.08.2021	12.10 pm	01.55 pm		443	LED Tubelight not working	Ortho OPD	26.08.2021	02.30 pm	
35	27.08.2021	02.10 pm	02.15 pm		200	Extention Board not working	MJPJAY ward	27.08.2021	02.15 pm	
36	27.08.2021	12.20 pm	02.40 pm		1628	LED 15watt not working	CCU+CVTS	28.08.2021	11.45 am	
37	27.08.2021	09.30 am	10.20 am		2128	Switch Board not working	Resistation	27.08.2021	11.00 am	
38	28.08.2021	09.00 am	10.05 am		1159	Refregator not working	Super Deluxe	28.08.2021	10.35 am	
39	28.08.2021	10.20 am	11.35 am		1160	Switch Board not working	Super Deluxe	28.08.2021	01.25 pm	
40	28.08.2021	10.57 am	11.10 am		826	Switch Board not working	2D Eco	28.08.2021	11.30 am	

41	28.08.2021	12.10 pm	12.20 pm		3260	Switch Board not working	Ex.Deluxe	28.08.2021	12.20 pm	
42	28.08.2021	11.55 am	12.35 pm		434	LED Tubelght not working	OT Complex	28.08.2021	03.20 pm	
43	28.08.2021	03.25 pm	03.55 pm		1568	Table fan not working	Med.OPD	28.08.2021	04.35 pm	
44	28.08.2021	04.40 pm	05.00 pm		1366	Electrical problame	Dialysis	28.08.2021	05.00 pm	
45	28.08.2021	10.00 am	10.45 am		1159	Refregator not working	Super Deluxe			Work in progress
Pending work										
1	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress
2	16.08.2021	11.15 am	12.05 pm		4261	VRV Casset unit-01 not working	Dyotan Hall			Work in progress

Total Complaint	47
Pending Complaint	5
Complete Complaint	47
Complaint Precentage	89%


M.S. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 30/08/2021 to 05/09/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	29.08.2021	05.39 pm	05.39 pm		3262	Electrical problame	Ex.Deluxe	29.08.2021	07.19 pm	
2	30.08.2021	10.00 am	10.15 am		3108	Iron(press) not working	Linen Dept.	30.08.2021	10.15 am	
3	30.08.2021	10.56 am	12.03 pm		449	LED Tubelight not working	OT Complex	30.08.2021	03.50 pm	
4	30.08.2021	12.46 pm	02.45 pm		182	Cilling Fan not working	F.Ortho ward	30.08.2021	03.25 pm	
5	30.08.2021	03.30 pm	03.40 pm		3109	LED Tubelight not working	Linen Dept.	30.08.2021	04.00 pm	
6	30.08.2021	12.45 pm	02.45 pm		1163	Refregator not working	Super Deluxe			Work in progress
7	31.08.2021	09.19 am	10.00 am		76	LED Tubelight not working	ENT OPD	31.08.2021	10.10 am	
8	31.08.2021	03.45 pm	04.00 pm		1164	Cilling Fan not working	Super Deluxe	31.08.2021	04.35 pm	
9	31.08.2021	12.39 pm	04.35 pm		463	Split AC not working	MICU			Work in progress
10	01.09.2021	09.05 am	09.30 am		3267	Exhouast Fan not working	Ex.Deluxe	01.09.2021	10.05 am	
11	01.09.2021	10.49 am	12.45 pm		538	LED Tubelight not working	Psy OPD	01.09.2021	01.35 pm	
12	01.09.2021	09.54 am	09.54 am		3201	X-Ray Box not working	Ueology Department	01.09.2021	02.21 pm	
13	01.09.2021	11.24 am	12.35 pm		2685	Cilling Fan not working	Covid opd	01.09.2021	04.20 pm	
14	01.09.2021	11.20 am	02.00 pm		2690	Exhouast Fan not working	Covid opd	01.09.2021	02.35 pm	
15	01.09.2021	11.23 am	12.45 pm		2684	LED Tubelight not working	Covid OPD	01.09.2021	01.00 pm	
16	01.09.2021	10.19 am	03.30 pm		452	LED Tubelight not working	OT Complex	01.09.2021	03.30 pm	
17	02.09.2021	02.25 pm	03.25 pm		1697	Switch Board not working	CVTS	02.09.2021	04.00 pm	
18	02.09.2021	04.45 pm	05.10 pm		8157	Water filter not working	IOM	04.09.2021	10.45 am	
19	03.09.2021	10.20 am	11.35 am		3303	Water filter not working	PSM Dept.	04.09.2021	11.30 am	
20	04.09.2021	09.48 am	11.35 am		2519	Switch Board not working	Ophthal.OPD	04.09.2021	12.40 pm	
21	04.09.2021	09.35 am	10.55 am		863	FCU Not working	MCRI ICU	04.09.2021	05.00 pm	
Pending work										
1	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS			Work in progress
2	16.08.2021	11.15 am	12.05 pm		4261	VRV Casset unit-01 not working	Dyotan Hall			Work in progress
3	25.08.2021	02.17 pm	02.55 pm		1890	Water cooler not working	Old Deluxe			Work in progress
4	26.08.2021	11.15 am	12.55 pm		2243	Switch Board not working	STP/ETP			Work in progress

Total Complaint	25
Pending Complaint	6
Complete Complaint	19
Complaint Precentrage	76%


M. V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 06/09/2021 to 12/09/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	05.09.2021	11.20 am	11.25 am		1897	Gizer not working	Old Deluxe	07.09.2021	11.35 am	
2	06.09.2021	11.00 am	11.35 am		888	Lift no-02 Not working	Time Office	06.09.2021	02.40 pm	
3	06.09.2021	09.30 am	09.45 am		295	Electrical problame	PSM Dept.	06.09.2021	10.30 am	
4	06.09.2021	02.25 pm	03.05 pm		2711	LED Light not Working	New Deluxe	06.09.2021	03.05 pm	
5	06.09.2021	12.15 pm	12.40 pm		863	AHU Servicing work	MCRI OPD	06.09.2021	04.10 pm	
6	06.09.2021	03.13 pm	04.00 pm		1169	Refregator not working	Super Deluxe	10.09.2021	10.40 am	
7	07.09.2021	11.20 am	11.23 am		2601	LED Light not Working	Old Deluxe	07.09.2021	11.25 am	
8	07.09.2021	09.45 am	10.00 am		868	Switch Board not working	MCRI OPD-10	07.09.2021	10.20 am	
9	07.09.2021	12.02 pm	12.35 pm		3548	LED Light not Working	Cardac OT	07.09.2021	02.15 pm	
10	07.09.2021	10.45 am	11.15 am		1906	Water filter not working	Time Office	07.09.2021	12.35 pm	
11	07.09.2021	02.25 pm	03.35 pm		249	Cilling Fan not working	SS OPD	08.09.2021	02.00 pm	
12	07.09.2021	11.35 am	11.55 am		3159	Switch Board not working	ENT Ward	07.09.2021	04.15 pm	
13	07.09.2021	12.10 pm	12.55 pm		815	Split AC not working	Radiology	13.09.2021	09.55 p	
14	07.09.2021	09.40 am	09.55 am		1905	Water filter not working	Time Office	07.09.2021	02.10 pm	
15	07.09.2021	11.05 am	11.35 pm		1906	Water filter not working	HR,Blood Bank,Readiology,Canteen & MCRI OPD	07.09.2021	03.45 pm	
16	07.09.2021	01.08 pm	02.35 pm		1177	Refregator not working	Super Deluxe	10.09.2021	10.40 am	
17	07.09.2021	10.40 am	11.35 am		815	VRV Casset unit-01 not working	Casulty	07.09.2021	02.40 pm	
18	07.09.2021	12.21 pm	02.20 pm		234	LED Tubelight not working	MJPJAY ward	07.09.2021	03.00 pm	
19	08.09.2021	11.45 am	12.05 pm		1907	Water filter not working	Time Office	08.09.2021	12.45 pm	
20	08.09.2021	02.00 pm	02.25 pm		3025	Switch Board not working	MMW	08.09.2021	02.30 pm	
21	08.09.2021	10.05 am	12.15 pm		3160	Switch Board not working	Covid-19	08.09.2021	04.25 pm	
22	08.09.2021	12.21 pm	03.10 pm		239	Switch Board not working	MJPJAY ward	08.09.2021	09.25 am	
23	08.09.2021	11.30 am	12.15 pm		464	LED Tubelight not working	OT Complex	08.09.2021	12.15 pm	
24	08.09.2021	11.35 am	12.10 pm		2091	FCU Not working	PICU	09.09.2021	11.40 am	
25	09.09.2021	09.20 am	10.15 am		2093	FCU Not working	PICU	09.09.2021	11.40 am	
26	09.09.2021	01.00 pm	02.40 pm		2714	Switch Board not working	New Deluxe	09.09.2021	03.30 pm	
27	09.09.2021	02.00 pm	02.40 pm		2273	LED Tubelight & Cilling fan not working	Nephrology ward	09.09.2021	04.15 pm	
28	09.09.2021	10.39 am	10.55 am		2093	FCU Not working	PICU	09.09.2021	11.35 am	
29	09.09.2021	10.26 am	10.40 am		2195	Lift Not working	OPD	09.09.2021	11.55 am	
30	11.09.2021	11.38 am	12.10 pm		2266	LED Light not Working	Psy ward	11.09.2021	11.40 am	
31	11.09.2021	09.05 am	09.15 am		2415 & 2416	AHU not working	Reserch lab	11.09.2021	03.20 pm	
32	12.09.2021	09.30 am	09.55 am		Oral	FCU Cleaning work	OT Complex	12.09.2021	04.15 pm	
Pending work										
1	24.07.2021	01.45 pm	02.00 pm	00.15 Hr	1688	Table fan not working	CVTS	06.09.2021	10.40 am	
2	16.08.2021	11.15 am	12.05 pm		4261	VRV Casset unit-01 not working	Dyotan Hall	09.09.2021	02.45 pm	
3	25.08.2021	02.17 pm	02.55 pm		1890	Water cooler not working	Old Deluxe	06.09.2021	11.35 am	
4	26.08.2021	11.15 am	12.55 pm		2243	Switch Board not working	STP/ETP			Work in progress

5	30.08.2021	12.45 pm	02.45 pm		1163	Refrigerator not working	Super Deluxe	13.09.2021	04.00 pm	
6	31.08.2021	12.39 pm	04.35 pm		463	Split AC not working	MICU	10.09.2021	10.40 am	

Total Complaint	38
Pending Complaint	1
Complete Complaint	37
Complaint Percentage	97%


M.V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 13/09/2021 to 19/09/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	13.09.2021	09.30 am	09.45 am		444	LED Tubelight not working	Ortho OPD	13.09.2021	10.55 am	
2	13.09.2021	02.45 pm	03.35 pm		2873	Tharmameter not working	Pead.ward	18.09.2021	12.00 pm	
3	13.09.2021	11.15 am	11.35 am		1674	Switch Board not working	Blood bank	13.09.2021	11.40 am	
4	14.09.2021	10.20 am	10.55 am		471	LED Light not Working	OT Complex	14.09.2021	11.10 am	
5	14.09.2021	12.40 pm	02.20 pm		774	LED Tubelight not working	Microbiology	17.09.2021	03.05 pm	
6	14.09.2021	12.05 pm	12.40 pm		2269	LED Tubelight not working	Psy.ward.	14.09.2021	03.10 pm	
7	14.09.2021	12.05 pm	12.45 pm		2268	Standing Fan not Working	Psy.ward.			Work in Progress
8	14.09.2021	03.23 pm	04.20 pm		3275	LED Bulb not working	Ex.Deluxe	18.09.2021	10.40 am	
9	14.09.2021	12.10 pm	12.20 pm		874	LED Tubelight not working	MCRI OPD-18	14.09.2021	12.55 pm	
10	15.09.2021	10.30 am	10.45 am		1163	LED Bulb not working	Labour Room	15.09.2021	11.00 am	
11	15.09.2021	08.45 am	08.55 am		1162	Switch Board not working	Labour Room	15.09.2021	08.55 am	
12	15.09.2021	12.47 pm	02.47 pm		2607	Water cooler not working	Old Deluxe	17.09.2021	12.30 pm	
13	15.09.2021	10.45 am	11.35 am		1184	FCU Not working	Super Deluxe	15.09.2021	12.55 pm	
14	15.09.2021	12.00 pm	12.35 pm		3988	Switch Board not working	Hemotology ICU	15.09.2021	12.55 pm	
15	15.09.2021	11.50 am	12.45 am		2137	LED Tubelight not working	Dean Office	15.09.2021	03.20 pm	
16	16.09.2021	10.15 am	10.20 am		392	LED Tubelight not working	OBGY Dept.	16.04.2021	10.20 am	
17	16.09.2021	11.40 am	12.05 pm		1338	Cilling Fan not working	MSW	16.09.2021	12.50 pm	
18	16.09.2021	03.15 pm	04.15 pm		2608	LED Light not Working	Old Deluxe	17.09.2021	11.30 am	
19	16.09.2021	11.25 am	12.35 pm		1667	Cilling Fan not working	Casulty	18.09.2021	04.20 pm	
20	16.09.2021	11.40 am	12.20 pm		1339	LED Tubelight not working	MSW	16.09.2021	12.50 pm	
21	16.09.2021	11.45 am	12.00 pm		475	LED Tubelight not working	OT Complex	16.09.2021	12.35 pm	
22	17.09.2021	10.00 am	11.15 am		2273	Wall fan fitting	Psy.ward.	18.09.2021	02.10 pm	
23	17.09.2021	11.36 am	12.20 pm		777	Switch Board not working	Microbiology	17.09.2021	03.00 pm	
24	17.09.2021	10.21 am	11.35 am		3278	LED Light not Working	Ex.Deluxe	18.09.2021	11.20 am	
25	18.09.2021	09.21 am	09.35 am		2609	Gizer not working	Old Deluxe	18.09.2021	09.45 am	
26	18.09.2021	10.51 am	11.00 am		270	VGA Cable laying	Nephrology ward	18.09.2021	11.30 am	
27	18.09.2021	12.40 pm	03.15 pm		1234	LED Bulb not working	Emergncy Medicine	18.09.2021	04.34 pm	
28	18.09.2021	11.00 am	12.35 pm		3167	LED Tubelight not working	Covid-19	18.09.2021	03.35 p	
29	18.09.2021	02.35 pm	02.55 pm		2277	LED Tubelight not working	Nephrology ward	18.09.2021	03.20 pm	
30	18.09.2021	03.00 pm	03.30 pm		1401	Electrical Wiring work	Covid-19	18.09.2021	03.30 pm	
31	18.09.2021	10.35 am	10.40 am		4265	Earthing & LED Light not Working	IT Department	18.09.2021	04.00 pm	
32	18.09.2021	03.50 pm	04.15 pm		2097	FCU Not working	PICU	18.09.2021	04.55 pm	
Pending work										
1	26.08.2021	11.15 am	12.55 pm		2243	Switch Board not working	STP/ETP	18.09.2021	04.00 pm	

Total Complaint	33
Pending Complaint	1
Complete Complaint	32
Complaint Precentage	97%


M.V. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 20/09/2021 to 26/09/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	20.09.2021	12.00 pm	12.45 pm		3169	Refregator not working	ENT	21.09.2021	02.30 pm	
2	20.09.2021	03.15 pm	03.30 pm		1342	Cilling Fan not working	MSW	20.09.2021	03.30 pm	
3	20.09.2021	10.23 am	11.15 am		3030	LED Tubelight & Switch Board not working,	M.Med.ward	24.09.2021	03.15 pm	
4	20.09.2021	03.15 pm	03.30 pm		1340	Switch Board not working	MSW	20.09.2021	04.20 pm	
5	21.09.2021	11.07 am	11.45 am		644	Earthing Light not Working	Pathology Department	21.09.2021	12.30 pm	
6	21.09.2021	09.30 am	09.45 am		1666	FCU Not working	Casulty	21.09.2021	09.45 am	
7	21.09.2021	12.20 pm	02.00 pm		297	Cilling Fan not working	PSM Dept.	21.09.2021	02.15 pm	
8	21.09.2021	04.16 pm	05.00 pm		1675	LED 15watt not working	Blood bank	23.09.2021	11.15 am	
9	21.09.2021	10.55 am	11.15 am		2878	Refregator not working	Pead.ward			Work in progress
10	21.09.2021	09.55 am	11.15 am		2199	Motor not working	6th Floor	22.09.2021	04.30 pm	
11	21.09.2021	01.11 pm	02.10 pm		2612	Gizer not working	Old Deluxe	23.09.2021	10.45 am	
12	21.09.2021	10.15 am	10.55 am		1480	VRV Casset unit-01 not working	OBYG ICU	22.09.2021	03.15 pm	
13	21.09.2021	12.04 pm	12.35 pm		2877	Cilling Fan not working	Old Peadiatric ward	21.09.2021	01.40 pm	
14	22.09.2021	10.45 am	11.05 am		2511	LED Tubelight not working	Record Section	22.09.2021	11.50 am	
15	22.09.2021	12.30 pm	02.40 pm		247	LED Bulb not working	MJPJAY ward	22.09.2021	04.00 pm	
16	22.09.2021	10.27 am	12.15 pm		3996	Extention Board not working	Hematology	23.09.2021	02.40 pm	
17	22.09.2021	02.10 pm	04.15 pm		1909	LED Tubelight not working	Time Office	23.09.2021	12.30 pm	
18	22.09.2021	09.34 am	12.50 pm		1186	LED 12watt not workkkking	Super Deluxe	22.09.2021	04.10 pm	
19	23.09.2021	12.00 pm	02.45 pm		59	Call Bell not working	Central Laibrary	23.09.2021	03.40 pm	
20	23.09.2021	09.59 pm	10.15 am		1481	Switch Board not working	OICU	24.09.2021	10.55 am	
21	23.09.2021	06.20 pm	07.30 pm		58	OPD Lift not working	Central Laibrary	21.09.2021	07.30 pm	
22	23.09.2021	09.30 am	09.45 am		605	Lift No-06 Not working	Time Office	24.09.2021	12.30 pm	
23	23.09.2021	11.05 am	12.20 pm		722	Electrical problame	OBYG Ward-II	23.09.2021	03.25 pm	
24	24.09.2021	10.50 am	11.15 am		1731	LED Light not Working	SICU	24.09.2021	12.55 pm	
25	24.09.2021	03.00 pm	03.15 pm		1278	Electrical problame	OBYG Ward-I	24.09.2021	03.24 pm	
26	24.09.2021	10.15 am	03.00 pm		491	LED Tubelight not working	OT Complex	25.09.2021	03.17 pm	
27	24.09.2021	10.50 am	11.15 am		618	Split AC not working	NICU			Work in progress
28	24.09.2021	04.30 pm	04.55 pm		1642	Exhouast Fan not working	CCU+CVTS	25.09.2021	04.10 pm	
29	24.09.2021	12.20 pm	03.20 pm		291	LED Tubelight & Cilling fan not working	Psiology Dept.	24.09.2021	04.10 pm	
30	24.09.2021	11.26 am	04.30 pm		1277	Gizer not working	OBYG Ward-I	24.09.2021	04.45 pm	
31	24.09.2021	11.24 am	11.35 am		2618	Gizer not working	Old Deluxe	25.09.2021	11.29 am	
32	25.09.2021	10.20 am	10.20 am		1192	Tharmameter not working	Super Deluxe	25.09.2021	11.05 am	
33	25.09.2021	03.45 pm	04.00 pm		609	Lift not working	Time Office	25.09.2021	04.15 pm	
34	25.09.2021	10.58 am	12.25 pm		1194	Cilling Fan not working	Super Deluxe	25.09.2021	12.35 pm	
35	25.09.2021	09.30 am	10.30 am		606	Lift No-06 Not working	Time Office	25.09.2021	02.00 pm	
36	25.09.2021	10.41 am	11.11 am		1279	LED Tubelight not working	OBYG Ward-I	25.09.2021	03.40 pm	
37	26.09.2021	01.00 pm	01.15 pm		1344	Switch Board not working	MSW	26.09.2021	01.15 pm	
38	25.09.2021	12.55 pm	02.15 pm		3615					
Pending work										

1	14.09.2021	12.05 pm	12.45 pm	2268	Standing Fan not Working	Psy.ward.	20.09.2021	02.50 pm
---	------------	----------	----------	------	--------------------------	-----------	------------	----------

Total Complaint	39
Pending Complaint	2
Complete Complaint	37
Complaint Precentage	95%


M. A. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 27/09/2021 to 03/10/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	27.09.2021	09.50 am	09.55 am		2309	Cilling Fan not working	Medical Store	27.09.2021	10.15 am	
2	27.09.2021	10.00 am	10.20 am		2132	LED Tubelight not working	Registition Department	27.09.2021	10.31 am	
3	27.09.2021	11.28 am	11.28 am		885	Switch Board not working	MCRI OPD	27.09.2021	11.30 am	
4	27.09.2021	10.30 am	12.40 pm		1345	Switch Board not working	MSW	27.09.2021	03.00 pm	
5	27.09.2021	10.40 am	11.00 am		1196	Switch Board not working	Super Deluxe	27.09.2021	03.45 pm	
6	27.09.2021	12.25 pm	01.45 pm		1733	Switch Board not working	SICU	27.09.2021	02.10 pm	
7	27.09.2021	12.30 pm	02.45 pm		2278	Switch Board not working	Psy.ward.	27.09.2021	04.35 pm	
8	28.09.2021	09.20 am	10.15 am		1406	Call Bell not working	Central library	28.09.2021	10.55 am	
9	28.09.2021	03.00 pm	03.30 pm		887	Cat-06 Cable laying	MCRI OPD-10	29.09.2021	03.45 pm	
10	28.09.2021	03.30 pm	04.10 pm		724	Exhouast Fan not working	OBGY II			Work in progress
11	28.09.2021	12.20 pm	12.55 pm		306	LED 15watt not working	Super Deluxe	02.10.2021	09.45 am	
12	28.09.2021	10.25 am	10.35 am		3998	Switch Board not working	Hematology	04.10.2021	10.45 am	
13	28.09.2021	11.36 am	12.26 pm		1412	Switch Board not working	Covid OPD	01.10.2021	03.45 pm	
14	29.09.2021	03.13 pm	03.20 pm		615	Lift No-06 Not working	Time Office	29.09.2021	05.10 pm	
15	29.09.2021	10.50 am	11.10 am		2278	Exhouast Fan & Cilling Fan not working	Nephrology ward	29.09.2021	11.45 am	
16	28.09.2021	11.20 am	12.10 pm		1735	AHU Filter cleaning	SICU	29.09.2021	02.00 pm	
17	29.09.2021	04.29 pm	04.40 pm		3175	Switch Board not working	Hemotolgy Dept.	29.09.2021	04.55 pm	
18	29.09.2021	05.00 pm	05.15 pm		617	Refregator not working	Time Office	29.09.2021	05.30 pm	
19	30.09.2021	11.55 am	12.20 pm		477	Switch Board not working	MICU	30.09.2021	01.00 pm	
20	30.09.2021	02.46 pm	02.55 pm		2882	Refregator not working	Pead.ward	02.10.2021	02.40 pm	
21	30.09.2021	10.05 am	11.15 am		2249	LED Tubelight not working	STP/ETP	02.10.2021	12.15 pm	
22	30.09.2021	12.00 pm	12.40 pm		1686	Electrical problame	Casulty	30.09.2021	01.00 pm	
23	01.10.2021	11.54 am	12.35 pm		1703	LED 15watt not working	Dyotan Hall			Work in progress
24	01.10.2021	09.50 am	10.00 am		620	Lift No-05 not working	Time Office	01.10.2021	11.15 am	
25	01.10.2021	11.35 am	12.20 pm		1377	Switch Board not working	Dialysis	01.10.2021	02.30 pm	
26	01.10.2021	11.00 am	11.25 am		2726	Call Bell not working	New Deluxe			Work in progress
Pending work										
	24.09.2021	10.50 am	11.15 am		618	Split AC not working	NICU	28.09.2021	02.40 pm	

Total Complaint	27
Pending Complaint	3
Complete Complaint	24
Complaint Precentage	89%


M.Y. Naikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 04/10/2021 to 10/10/2021


Sr. No	Received Date	Time	Attende Time	Response Time	Cpmplaint No.	Nature Of Complent	Name Of Department	Date Of Completion	Close Time	Remark
1	04.10.2021	09.30 am	09.55 am		2546	LED Tubelight not working	CSSD	04.10.2021	11.15 am	
2	04.10.2021	10.00 am	11.35 am		1677	Switch Board not working	Blood bank	04.10.2021	03.00 pm	
3	04.10.2021	11.30 am	11.45 am		1488	VRV Casset unit-01 not working	OBGY ICU	04.10.2021	04.30 pm	
4	04.10.2021	12.00 pm	12.35 pm		1736	AC Vent not working	SICU	04.10.2021	02.45 pm	
5	04.10.2021	10.00 am	10.15 am		1676	DipFreez not working	Blood bank			Work in progress
6	04.10.2021	02.20 pm	03.05 pm		3403	LED Tubelight not working	OT Complex	04.10.2021	03.15 pm	
7	04.10.2021	09.35 am	10.55 am		1346	Cilling Fan not working	MSW	04.10.2021	03.50 pm	
8	04.10.2021	10.25 am	11.30 am		4057	LED Tubelight not working	OBGY OPD	04.10.2021	12.55 pm	
9	05.10.2021	11.00 am	11.30 am		622	Switch Board not working	NICU	05.10.2021	11.45 am	
10	05.10.2021	02.18 pm	02.45 pm		1738	LED 15watt not working	SICU	07.10.2021	03.35 pm	
11	05.10.2021	10.00 am	10.20 am		2100	Extention Board not working	PICU	05.10.2021	04.00 pm	
12	05.10.2021	10.50 am	11.00 am		1414	Cilling Fan not working	Covid-19	07.10.2021	12.40 pm	
13	05.10.2021	03.15 pm	03.55 pm		197	LED Tubelight not working	F.Ortho ward	05.10.2021	04.25 pm	
14	05.10.2021	02.18 pm	03.00 pm		3176	Switch Board not working	Hematology	05.10.2021	03.15 pm	
15	05.10.2021	09.20 am	09.45 am		3175	Switch Board not working	Hematology ICU	05.10.2021	11.35 am	
16	06.10.2021	10.10 am	10.50 am		250	Cilling Fan not working	MJPJAY ward	06.10.2021	01.00 pm	
17	06.10.2021	10.40 am	11.55 pm		1415	LED Tubelight not working	Covid-19	07.10.2021	01.00 pm	
18	06.10.2021	09.45 am	10.20 am		2703	Tharmameter not working	Old Deluxe			Work in progress
19	06.10.2021	09.45 am	09.55 am		2702	Cilling Fan not working	Old Deluxe	06.10.2021	01.10 pm	
20	06.10.2021	10.20 am	11.10 am		1736	Air cartain not working	SICU	09.10.2021	03.55 pm	
21	06.10.2021	02.30 pm	03.00 pm		3408	LED Tubelight not working	OT Complex	06.10.2021	03.45 pm	
22	06.10.2021	10.40 am	11.00 am		3406	LED Tubelight not working	OT Complex	06.10.2021	03.45 pm	
23	07.10.2021	10.00 am	10.15 am		898	Electrical Checkup	MCRI OPD	07.10.2021	11.05 am	
24	07.10.2021	12.15 pm	12.55 pm		2631	Gizer not working	Old Deluxe	07.10.2021	12.55 pm	
25	07.10.2021	02.50 pm	03.15 pm		3289	LED 15watt not working	MCRI ICU	07.10.2021	03.45 pm	
26	07.10.2021	01.50 pm	02.15 pm		104	LED Tubelight not working	PICU	09.10.2021	03.15 pm	
27	07.10.2021	02.50 pm	03.00 pm		623	Switch Board not working	Dean Office	07.10.2021	03.00 pm	
28	07.10.2021	10.00 am	12.15 pm		1348	Cilling Fan not working	MSW	07.10.2021	02.15 pm	
29	07.10.2021	05.50 pm	05.55 pm		663	Electrical problame	CATH-LAB	07.10.2021	07.00 pm	
30	07.10.2021	04.30 pm	04.45 pm		298	LED Tubelight not working	PSM Dept.	08.10.2021	10.45 am	
31	08.10.2021	09.20 am	09.55 am		318	Switch Board not working	Super Deluxe	08.10.2021	10.10 am	
32	08.10.2021	10.58 am	11.15 am		664	Split AC not working	CATH-LAB	08.10.2021	12.15 pm	
33	08.10.2021	11.00 am	11.55 am		25	X-Ray Box not working	Endoscophy	08.10.2021	01.37 pm	
34	08.10.2021	04.24 pm	04.35 pm		626	2TR Split AC not working	Time Office	09.10.2021	10.45 pm	
35	08.10.2021	10.28 am	11.00 am		1417	LED 15watt not working	Covid OPD	08.10.2021	03.15 pm	
36	08.10.2021	01.30 pm	02.40 pm		3288	Switch Board not working	Ex.Deluxe	08.10.2021	02.50 pm	
37	08.10.2021	12.30 pm	12.55 pm		670	Cilling Fan not working	NICU	08.10.2021	01.50 pm	
38	09.10.2021	11.10 am	11.55 am		3412	LED 15watt not working	OT Complex	09.10.2021	11.00 am	
39	09.10.2021	02.35 pm	02.55 pm		2731	LED 15watt not working	New Deluxe	09.10.2021	04.05 pm	
40	09.10.2021	04.45 pm	05.00 pm		628	Cilling Fan not working	Skin VD	09.10.2021	05.15 pm	

Pending work										
1	28.09.2021	05.30 pm	04.10 pm		724	Exhouast Fan not working	OBGY II			Work in progress
2	01.10.2021	11.54 am	12.35 pm		1703	LED 15watt not working	Dyotan Hall			Work in progress
3	01.10.2021	11.00 am	11.25 am		2726	Call Bell not working	New Deluxe			Work in progress
4	03.10.2021	11.20 am	11.35 am		1735	AHU Filter cleaning	ETCU	04.10.2021	02.00 pm	

Total Complaint	44
Pending Complaint	5
Complete Complaint	39
Complaint Precentage	.89%


M. V. Gaikwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 11/10/2021 to 17/10/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlplaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	11.10.2021	11.00 am	11.20 am		2104	Switch Board not working	Hematology ICU	11.10.2021	11.45 am	
2	11.10.2021	04.10 pm	04.45 pm		1349	Cilling Fan not working	MSW	11.10.2021	05.00 pm	
3	11.10.2021	12.30 pm	12.45 pm		1745	Cat-06 Cable laying	C' Building	15.10.2021	04.00 pm	
4	11.10.2021	02.54 pm	03.15 pm		2006	LED Tubelight & Cilling fan requirement	Community Med.	11.10.2021	05.00 pm	
5	11.10.2021	11.23 am	12.00 pm		1745	Switch Board not working	SICU	11.10.2021	12.15 pm	
6	11.10.2021	12.30 pm	12.40 pm		331	Switch Board not working	Radiology Dept	12.10.2021	12.05 pm	
7	12.10.2021	12.30 pm	12.30 pm		2106	Switch Board not working	Hematology ICU	12.10.2021	12.55 pm	
8	12.10.2021	11.18 am	12.20 pm		2735	Switch Board not working	New Deluxe	16.10.2021	01.45 pm	
9	12.10.2021	12.55 pm	02.40 pm		3636	LED Light not Working	Cardac OT			Work in progress
10	12.10.2021	11.15 am	12.00 pm		17	Telephone cable laying work.	Gate No-01	12.10.2021	04.20 pm	
11	12.10.2021	09.00 am	09.30 am		Letter	Switch Board not working	Dean Office	12.10.2021	04..00 pm	
12	13.10.2021	12.06 pm	12.26 pm		1668	Extention Board not working	Surgery OPD	13.10.2021	12.40 pm	
13	13.10.2021	12.06 pm	12.26 pm		1667	LED Tubelight not working	Surgery OPD	13.10.2021	12.45 pm	
14	13.10.2021	03.20 pm	03.55 pm		336	LED Light not Working	Radiology Dept	16.10.2021	04.30 pm	
15	13.10.2021	03.47 pm	04.10 pm		3041	Cilling Fan not working	MMW	16.10.2021	05.10 pm	
16	13.10.2021	02.30 pm	02.55 pm		835	Cilling Fan not working	Radiology Dept	13.10.2021	03.15 pm	
17	13.10.2021	10.04 am	10.35 am		2002	Switch Board not working	MCRI OPD	14.10.2021	12.30 pm	
18	14.10.2021	03.31 pm	03.45 pm		2637	Switch Board not working	Old Deluxe	16.10.2021	12.55 pm	
19	15.10.2021	09.55 am	10.45 am		2006	LED 15watt not working	MCRI OPD	15.10.2021	12.15 pm	
20	15.10.2021	12.30 pm	02.10 pm		631	Lift No-06 Not working	Time Office	15.10.2021	04.36 pm	
21	15.10.2021	08.24 am	09.15 am		633	Lift No-06 Not working	Time Office	15.10.2021	04.30 pm	
22	16.10.2021	12.30 pm	12.45 pm		1006	Electrical problame	Medicin Dept.	16.10.2021	12.45 pm	
23	16.10.2021	09.20 am	09.40 am		329	Cilling Fan not working	Scool of Bio.Scince	16.10.2021	12.10 pm	
24	16.10.2021	12.35 pm	12.55 pm		791	Split AC not working	Microbiology	18.10.2021	12.10 pm	
25	16.10.2021	11.06 am	11.45 am		177	X-Ray Box not working	F.Ortho ward	17.10.2021	05.10 pm	
26	16.10.2021	10.35 am	11.05 am		1952	LED Tubelight not working	Pharm.Lecture Hall	18.10.2021	04.05 pm	
27	17.10.2021	07.50 am	09.05 am		635	Lift No-06 Not working	Time Office	17.10.2021	10.45 am	
Pending work										
1	28.09.2021	03.30 pm	04.10 pm		724	Exhouast Fan not working	OBYG II	13.10.2021	02.40 pm	
2	01.10.2021	11.54 am	12.35 pm		1703	LED 15watt not working	Dyotan Hall			Work in progress
3	01.10.2021	11.00 am	11.25 am		2726	Call Bell not working	New Deluxe			Work in progress
4	04.10.2021	10.00 am	10.15 am		1676	DipFreez not working	Blood bank			Work in progress
5	06.10.2021	09.45 am	10.20 am		2703	Tharmameter not working	Old Deluxe	16.10.2021	04.00 pm	
6	10.10.2021	02.50 pm	02.50 pm		3306	LED Tubelight Requirement	PSM Dept.	12.10.2021	* 03.05 pm	

Total Complaint	33
Pending Complaint	4
Complete Complaint	29
Complaint Precentage	88%


M.V. Galkwad
MGM Aurangabad



Electrical Engineer
MGM Aurangabad



Electrical Supervisor
MGM Aurangabad


MGM MEDICAL COLLEGE & HOSPITAL
ELECTRICAL MAINTANCE REPORT 18/10/2021 to 24/10/2021

Sr. No	Received Date	Time	Attende Time	Response Time	Cpmlaint No.	Nature Of Complent	Name Of Department	Date Of Complation	Close Time	Remark
1	18.10.2021	09.50 am	09.50 am		516	Wall fan fitting	Dental OPD	18.10.2021	11.06 am	
2	18.10.2021	09.30 am	09.45 am		851	Extention Board not working	Hematology ICU	19.10.2021	12.45 pm	
3	18.10.2021	09.40 am	09.55 am		253	Electrical problame	MJPJAY ward	18.10.2021	12.10 pm	
4	18.10.2021	11.15 am	12.20 pm		1028	LED Tubelight not working	MICU	18.10.2021	03.15 pm	
5	18.10.2021	04.15 pm	04.45 pm		1684	LED 15watt not working	Blood bank	19.10.2021	02.00 pm	
6	18.10.2021	12.00 pm	12.35 pm		2304	LED Tubelight & Cilling fan Requirement	PSM Dept.	23.10.2021	03.40 pm	
7	18.10.2021	12.17 pm	12.45 pm		904	Wall Fan not Working	Central Lab.	18.10.2021	02.15 pm	
8	18.10.2021	11.19 am	12.10 pm		298	LED Tubelight not working	PSM Dept.	18.10.2021	12.25 pm	
9	18.10.2021	01.10 pm	02.45 pm		886	LED Tubelight not working	Anatomy	18.10.2021	03.35 pm	
10	18.10.2021	12.54 pm	03.35 pm		3432	Switch Board not working	OT Complex	18.10.2021	04.30 pm	
11	18.10.2021	01.00 pm	03.15 pm		3429	LED Tubelight not working	OT Complex	18.10.2021	03.30 pm	
12	18.10.2021	12.55 pm	04.36 pm		3424	LED 15watt not working	OT Complex	18.10.2021	05.00 pm	
13	19.10.2021	12.39 pm	01.35 pm		1236	LED Tubelight not working	MET Cell	19.10.2021	01.40 pm	
14	19.10.2021	10.58 am	11.05 am		2015	Switch Board not working	MJPJAY ward	19.10.2021	04.45 pm	
15	19.10.2021	03.19 pm	03.40 pm		1148	LED 15watt not working	5th floor deluxe	21.10.2021	04.35 pm	
16	19.10.2021	02.00 pm	02.15 pm		895	Projector Point requirement	Anatomy	19.10.2021	03.37 pm	
17	19.10.2021	04.31 pm	04.31 pm		1955	Projector Point requirement	Pharm.Lecture Hall	19.10.2021	05.28 pm	
18	19.10.2021	04.38 pm	04.55 pm		278	Electrical problame	Physiotherapy	19.10.2021	04.55 pm	
19	20.10.2021	10.00 am	10.05 am		3328	Electrical problame	Dermatology	20.10.2021	10.20 am	
20	20.10.2021	11.34 am	02.40 pm		2549	Switch Board not working	CSSD	20.10.2021	03.10 pm	
21	20.10.2021	11.46 am	02.30 pm		3438	LED Tubelight not working	OT Complex	20.10.2021	04.31 pm	
22	20.10.2021	10.09 am	11.00 am		2890	Cilling Fan not working	Pead.ward	21.10.2021	11.35 am	
23	20.10.2021	10.42 am	03.00 pm		2110	LED 15watt not working	Hematology ICU	22.10.2021	03.44 pm	
24	21.10.2021	11.10 am	11.55 am		2016	Wind Blower not working	MJPJAY ward	22.10.2021	01.00 pm	
25	21.10.2021	11.27 am	12.10 pm		2639	LED Tubelight not working	Cardac OT	22.10.2021	04.30 pm	
26	21.10.2021	11.58 am	02.45 pm		638	Lift No-05 not working	Time Office	21.10.2021	02.45 pm	
27	22.10.2021	12.05 pm	12.05 pm		251	LED Tubelight not working	SS OPD	22.10.2021	12.15 pm	
28	22.10.2021	03.05 pm	03.45 pm		2738	Tharmameter not working	New Deluxe	25.10.2021	04.45 pm	
29	22.10.2021	03.35 pm	04.00 pm		19	Dipawal Lamp not working	Hospital Build.	25.10.2021	11.00 pm	
30	22.10.2021	12.05 pm	12.15 pm		1353	Switch Board not working	MSW	22.10.2021	12.45 pm	
31	22.10.2021	12.45 pm	12.55 pm		334	Switch Board not working	Super Deluxe	22.10.2021	01.15 pm	
32	22.10.2021	12.45 pm	02.40 pm		255	Exhouast Fan not working	MJPJAY ward	24.10.2021	10.00 am	
33	23.10.2021	10.45 am	11.00 am		1111	LED Bulb not working	M.Ortho ward	24.10.2021	10.39 am	
34	24.10.2021	02.40 pm	03.10 pm		1601	Switch Board not working	Ex.Deluxe	25.10.2021	04.45 pm	
Pending work										
1	01.10.2021	11.54 am	12.35 pm		1703	LED 15watt not working	Dyotan Hall	19.10.2021	02.30 pm	
2	01.10.2021	11.00 am	11.25 am		2726	Call Bell not working	New Deluxe			Work in progress
3	04.10.2021	10.00 am	10.15 am		1676	DipFreez not working	Blood bank			Work in progress
4	12.10.2021	12.55 pm	02.40 pm		3636	LED Light not Working	Cardac OT	25.10.2021	03.55 pm	

Total Complaint	38
Pending Complaint	2
Complete Complaint	36
Complaint Precentage	95%


M.Y. Gaikwad
MGM Aurangabad


Electrical Engineer
MGM Aurangabad


Electrical Supervisor
MGM Aurangabad